


Quad Cities 1

1Q/2014 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

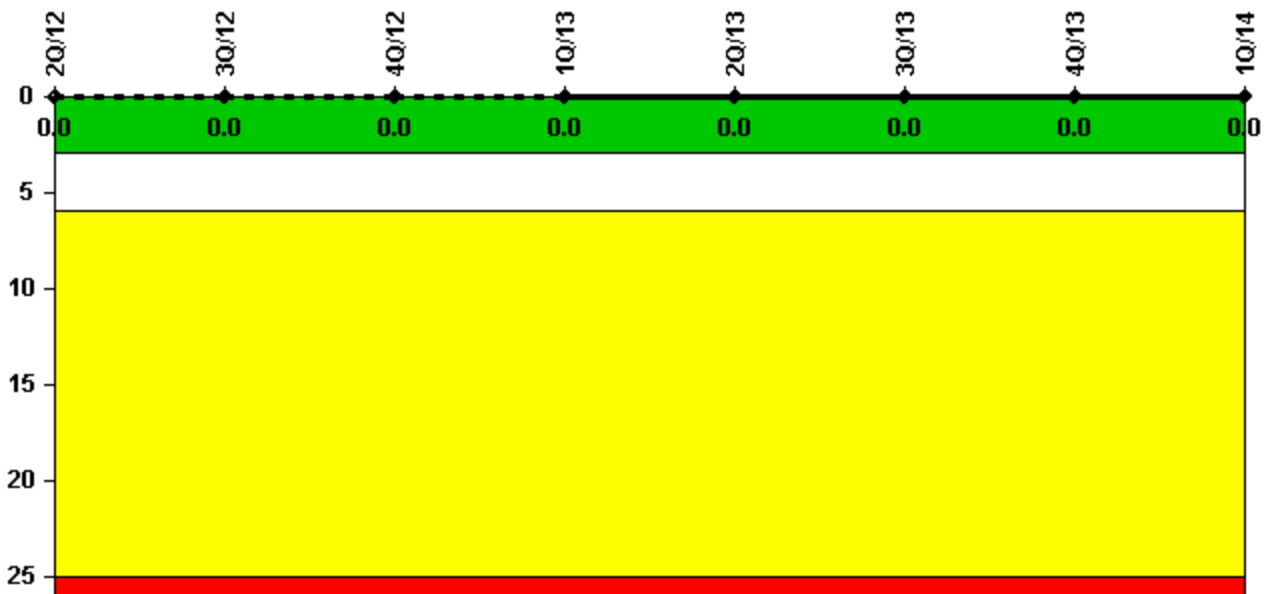


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

| Unplanned Scrams per 7000 Critical Hrs | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|--|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned scrams | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 2184.0 | 2208.0 | 2209.0 | 1656.0 | 2067.9 | 2208.0 | 2209.0 | 2159.0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

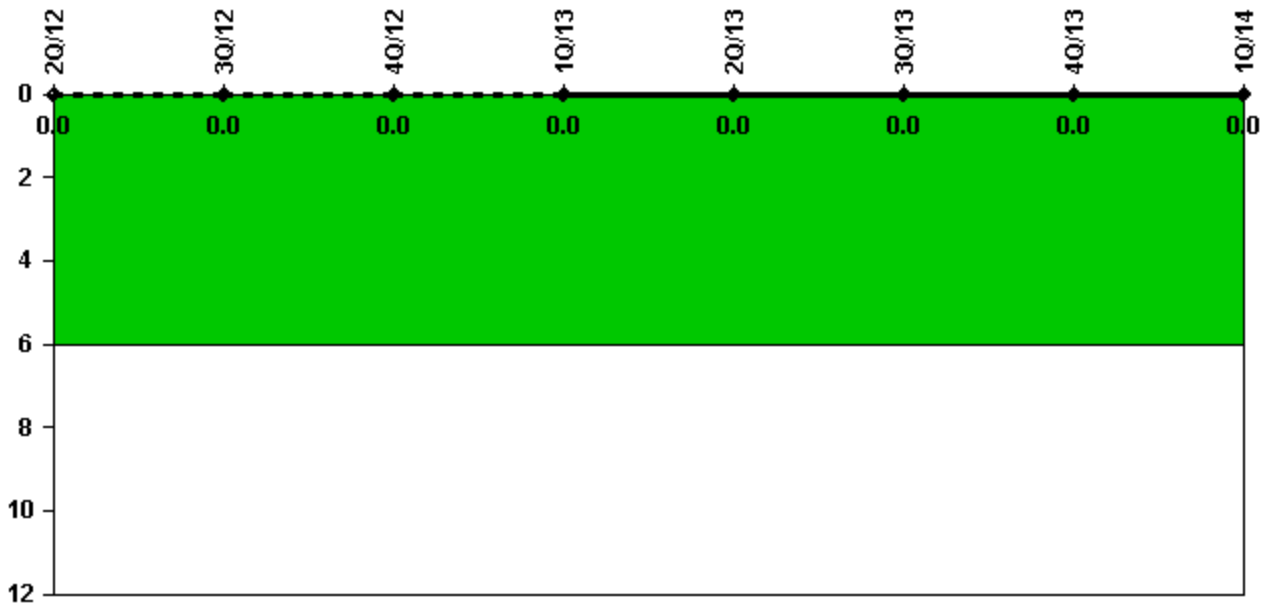


Thresholds: White > 6.0

Notes

| Unplanned Power Changes per 7000 Critical Hrs | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|---|----------|----------|----------|----------|----------|----------|----------|----------|
| Unplanned power changes | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 2184.0 | 2208.0 | 2209.0 | 1656.0 | 2067.9 | 2208.0 | 2209.0 | 2159.0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Unplanned Scrams with Complications

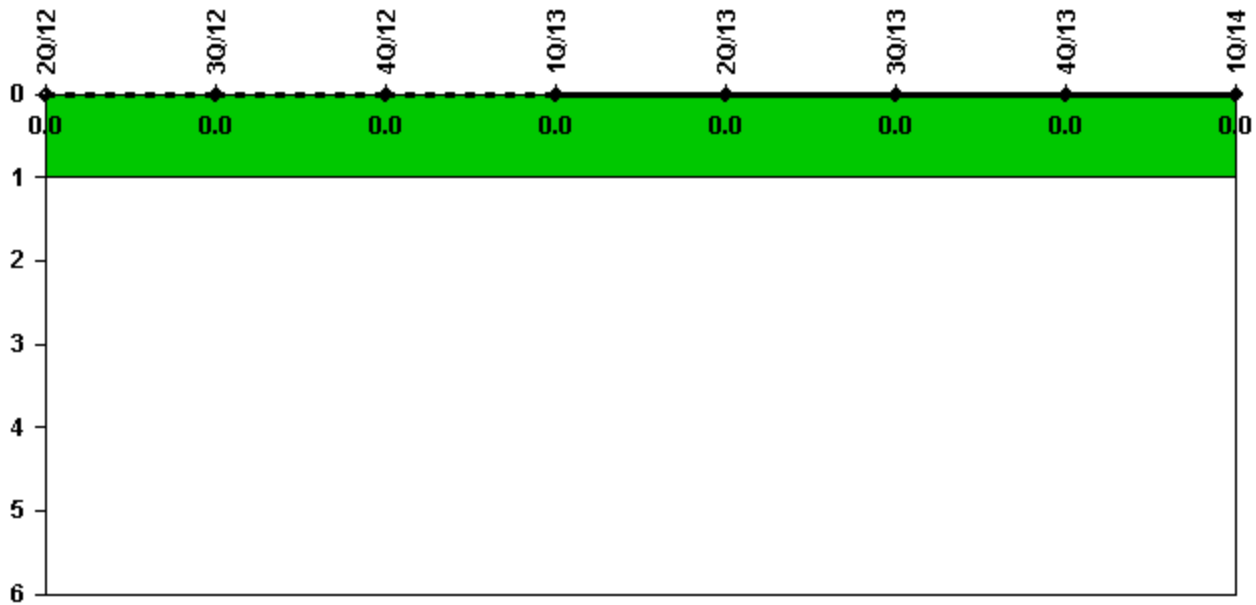


Thresholds: White > 1.0

Notes

| Unplanned Scrams with Complications | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|-------------------------------------|------------|------------|------------|------------|------------|------------|------------|------------|
| Scrams with complications | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | | | | | | | | |
| Indicator value | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |

Licensee Comments: none

Safety System Functional Failures (BWR)

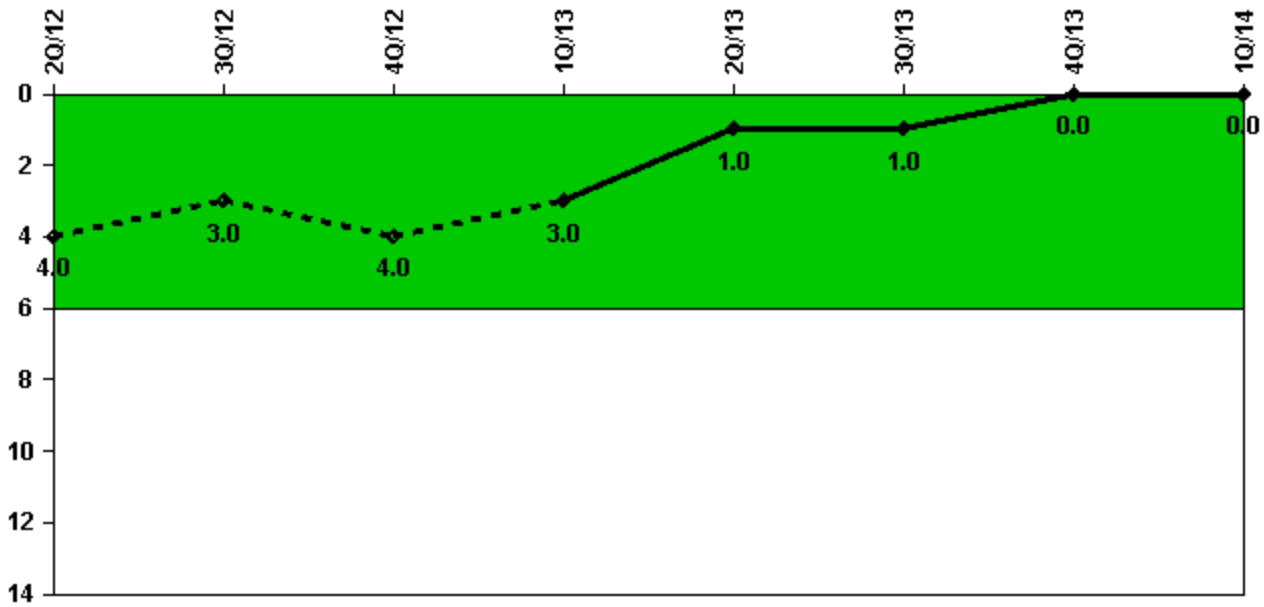

Thresholds: White > 6.0

Notes


| Safety System Functional Failures (BWR) | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|---|----------|----------|----------|----------|----------|----------|----------|----------|
| Safety System Functional Failures | 2 | 0 | 1 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 4 | 3 | 4 | 3 | 1 | 1 | 0 | 0 |

Licensee Comments:

4Q/12: LER 254/2012-004-00, Breach in Secondary Containment (11-5-12), (SSFF applies to both Units 1 and 2).

2Q/12: As part of this 3rd quarter submittal, a change package is being generated for 2nd quarter 2012 to include previously omitted comments pertaining to SSFF. This change is administrative in nature and does not change the color of the indicator. LER 254/2012-002-00, Unit 1 Standby Gas Treatment System Loss of Safety Function Due to Loss of Emergency Power (6-1-12). LER 265/2012-003-00, Unit 2 Auto Reactor Scram Due to DEHC System Failure (6-14-12), (SSFF also applies to Unit 1).

Mitigating Systems Performance Index, Emergency AC Power System

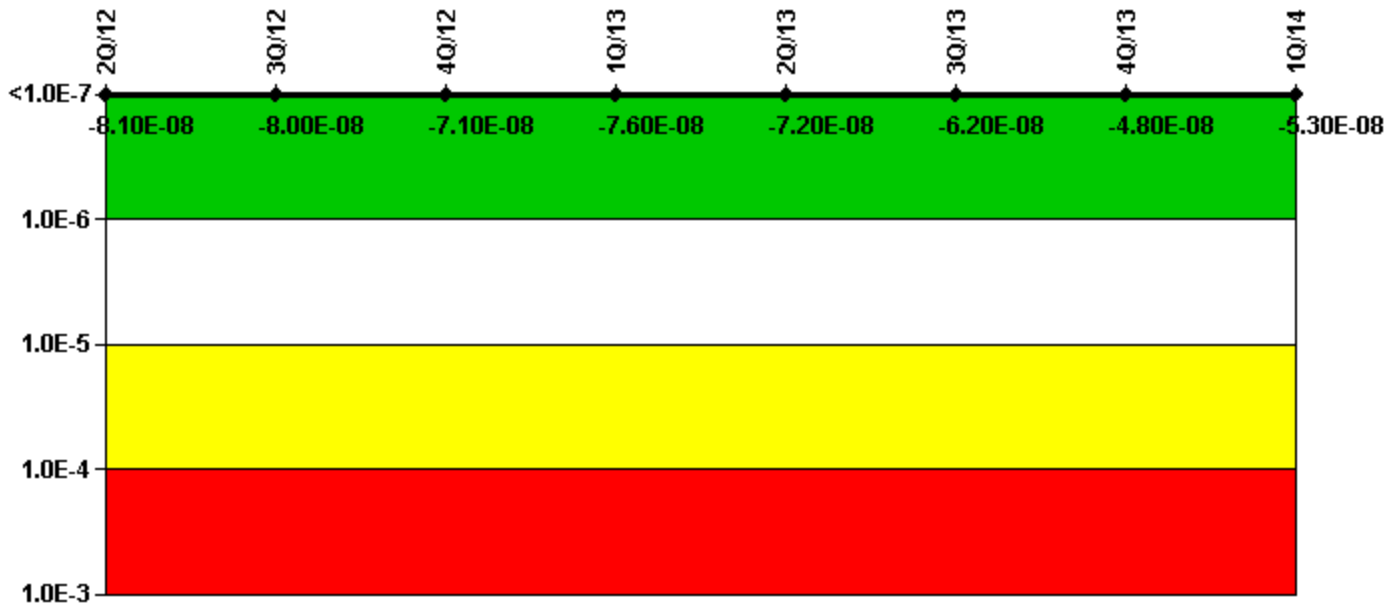


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Emergency AC Power System | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -9.63E-09 | -1.02E-08 | -1.39E-09 | -3.52E-09 | -2.12E-10 | 9.23E-09 | 2.38E-08 | 1.46E-08 |
| URI (Δ CDF) | -7.10E-08 | -6.96E-08 | -6.94E-08 | -7.26E-08 | -7.19E-08 | -7.15E-08 | -7.16E-08 | -6.72E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -8.10E-08 | -8.00E-08 | -7.10E-08 | -7.60E-08 | -7.20E-08 | -6.20E-08 | -4.80E-08 | -5.30E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

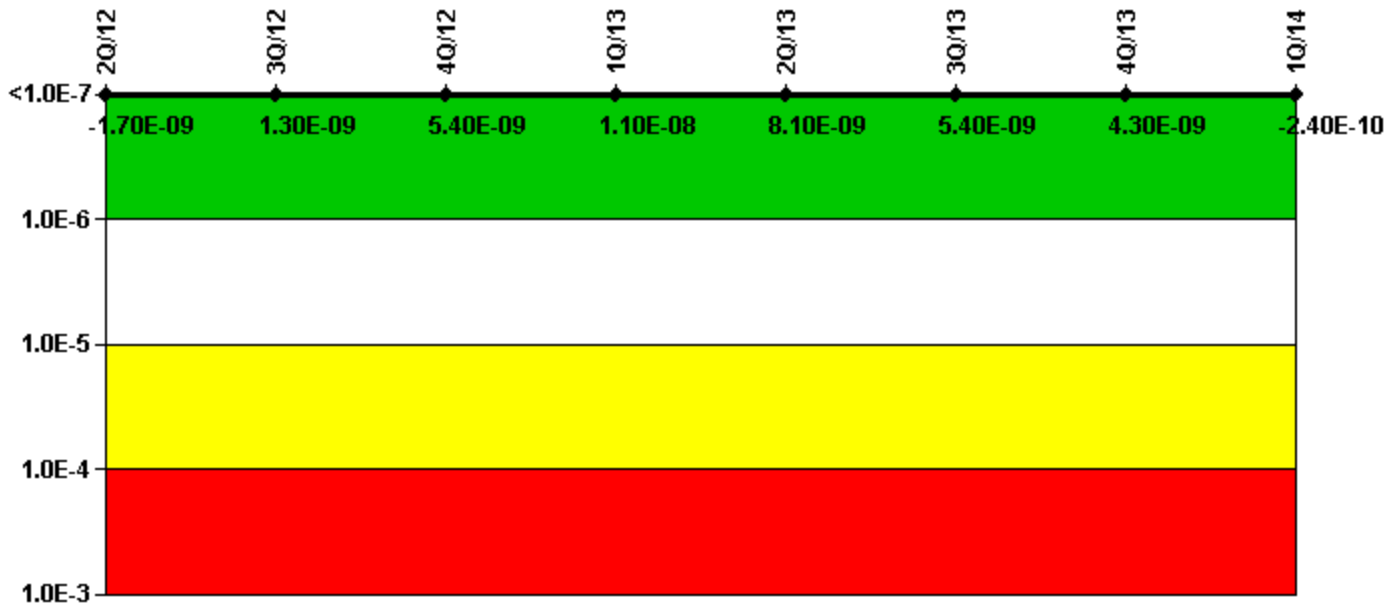


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, High Pressure Injection System | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | 1.27E-08 | 1.44E-08 | 1.85E-08 | 2.43E-08 | 2.30E-08 | 2.03E-08 | 1.92E-08 | 1.41E-08 |
| URI (Δ CDF) | -1.44E-08 | -1.31E-08 | -1.31E-08 | -1.31E-08 | -1.49E-08 | -1.49E-08 | -1.49E-08 | -1.43E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -1.70E-09 | 1.30E-09 | 5.40E-09 | 1.10E-08 | 8.10E-09 | 5.40E-09 | 4.30E-09 | -2.40E-10 |

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

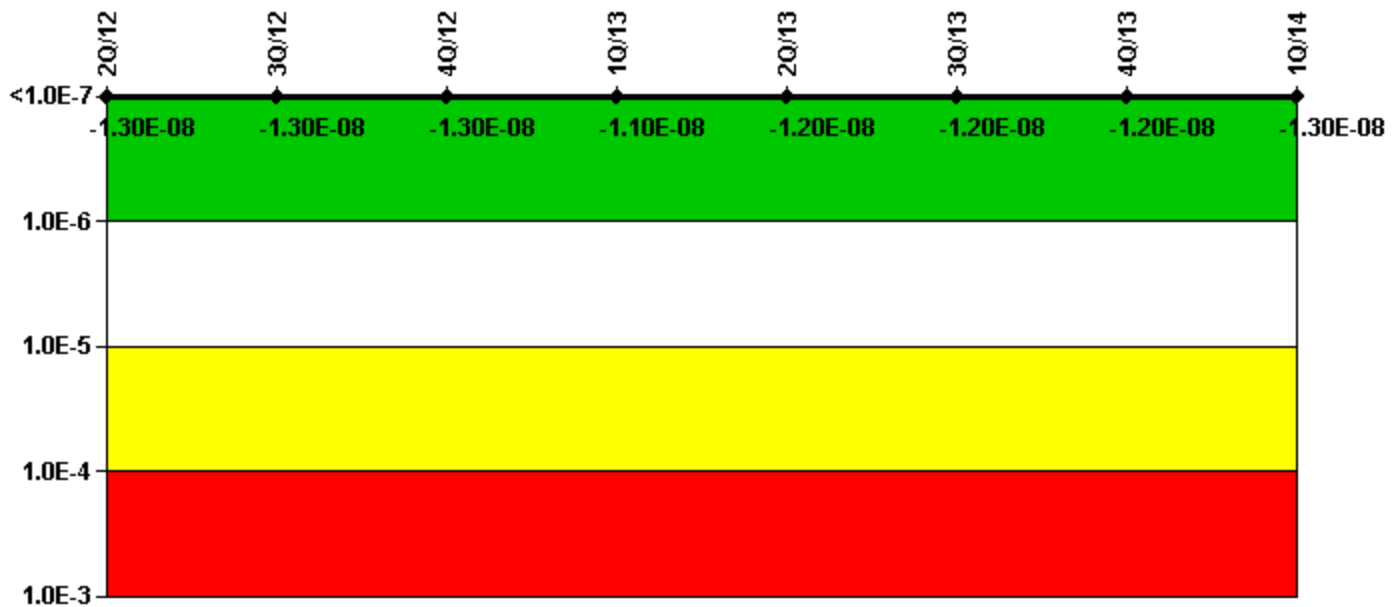


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Heat Removal System | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -7.28E-10 | -1.23E-09 | -6.78E-10 | 1.03E-09 | 6.91E-10 | 1.16E-09 | 1.11E-09 | 4.77E-10 |
| URI (Δ CDF) | -1.21E-08 | -1.21E-08 | -1.21E-08 | -1.21E-08 | -1.26E-08 | -1.31E-08 | -1.31E-08 | -1.31E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -1.30E-08 | -1.30E-08 | -1.30E-08 | -1.10E-08 | -1.20E-08 | -1.20E-08 | -1.20E-08 | -1.30E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

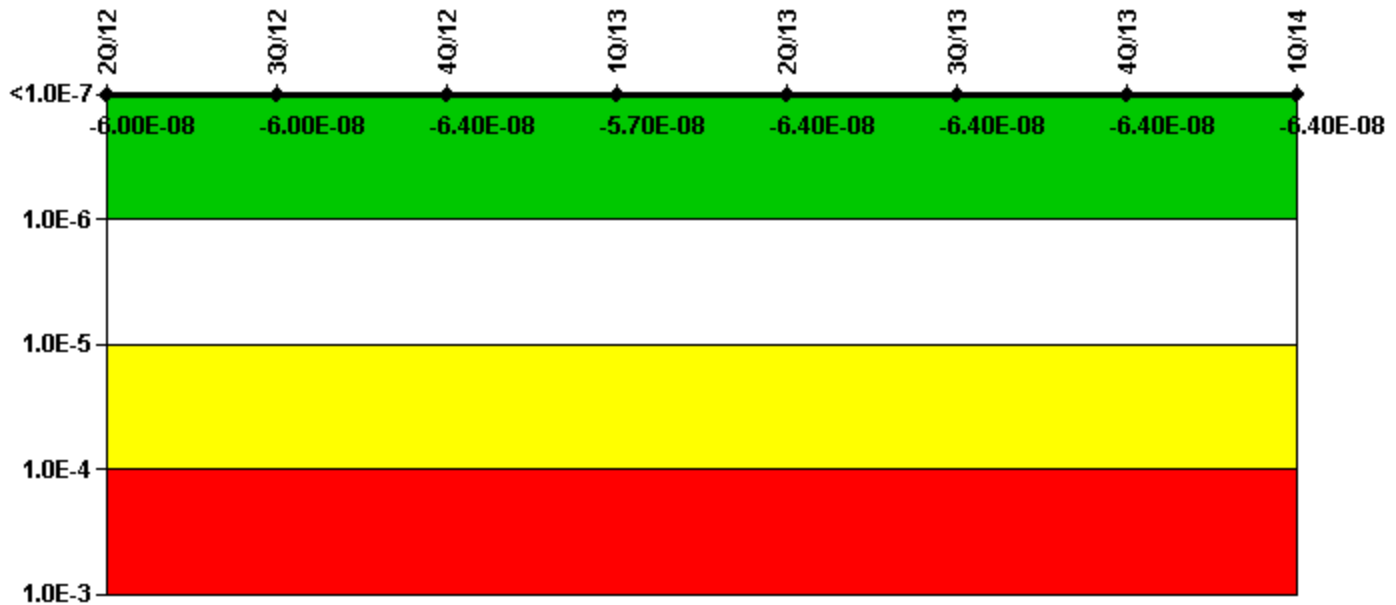


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Residual Heat Removal System | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -1.93E-08 | -1.95E-08 | -2.35E-08 | -1.63E-08 | -2.38E-08 | -2.38E-08 | -2.38E-08 | -2.38E-08 |
| URI (Δ CDF) | -4.06E-08 | -4.06E-08 | -4.06E-08 | -4.06E-08 | -4.06E-08 | -4.06E-08 | -4.06E-08 | -4.06E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -6.00E-08 | -6.00E-08 | -6.40E-08 | -5.70E-08 | -6.40E-08 | -6.40E-08 | -6.40E-08 | -6.40E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

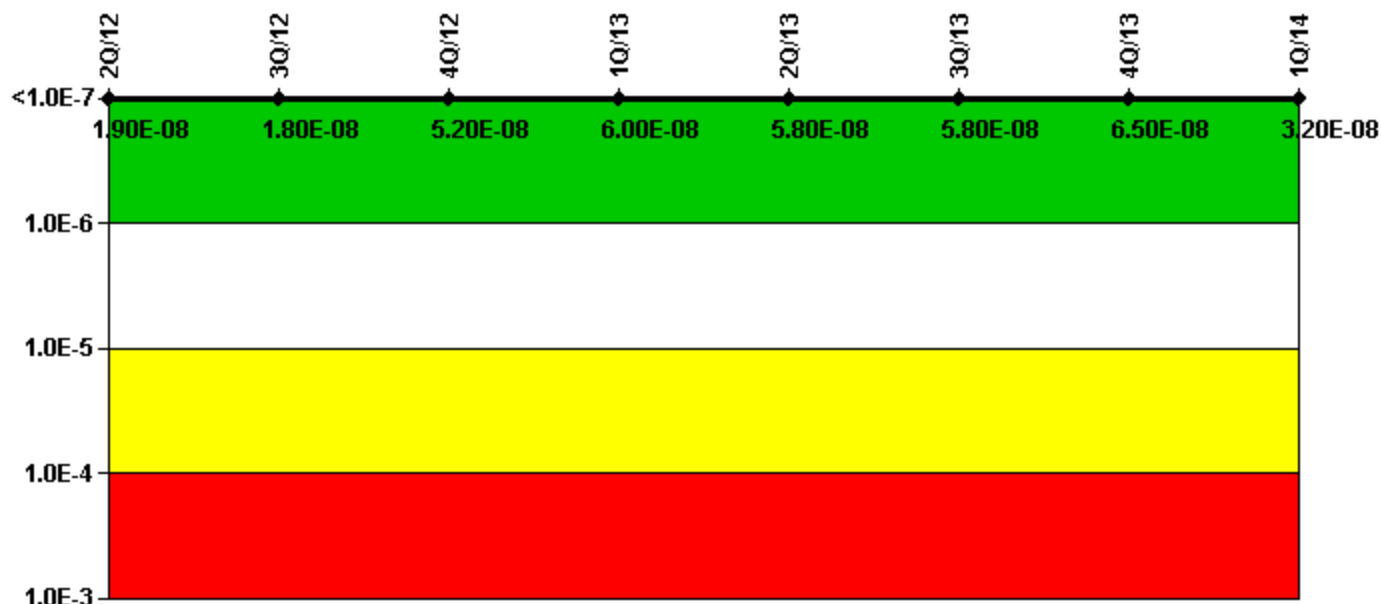

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

| Mitigating Systems Performance Index, Cooling Water Systems | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | 1.91E-08 | 1.90E-08 | 5.27E-08 | 6.05E-08 | 5.89E-08 | 5.86E-08 | 6.52E-08 | 3.23E-08 |
| URI (Δ CDF) | -5.28E-10 | -5.28E-10 | -5.28E-10 | -5.28E-10 | -5.28E-10 | -5.28E-10 | -5.28E-10 | -5.28E-10 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | 1.90E-08 | 1.80E-08 | 5.20E-08 | 6.00E-08 | 5.80E-08 | 5.80E-08 | 6.50E-08 | 3.20E-08 |

Licensee Comments:

1Q/13: February Unavailability Hours were added for 1B RHRWS. This caused a change in MSPI Cooling Water System PI's for first quarter 2013. This did not result in a change in 'color' for the indicator.

Reactor Coolant System Activity

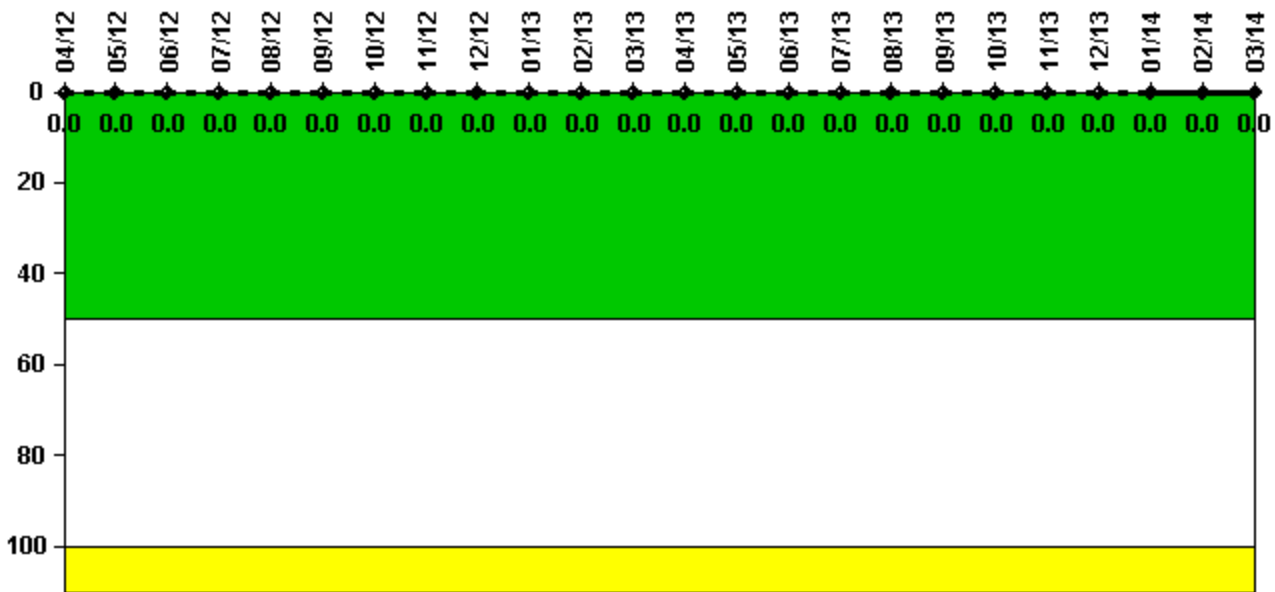


Thresholds: White > 50.0 Yellow > 100.0

Notes

| Reactor Coolant System Activity | 4/12 | 5/12 | 6/12 | 7/12 | 8/12 | 9/12 | 10/12 | 11/12 | 12/12 | 1/13 | 2/13 | 3/13 |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0.000053 | 0.000036 | 0.000030 | 0.000040 | 0.000036 | 0.000047 | 0.000047 | 0.000037 | 0.000035 | 0.000039 | 0.000039 | 0.000034 |
| Technical specification limit | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Reactor Coolant System Activity | 4/13 | 5/13 | 6/13 | 7/13 | 8/13 | 9/13 | 10/13 | 11/13 | 12/13 | 1/14 | 2/14 | 3/14 |
| Maximum activity | 0.000013 | 0.000014 | 0.000010 | 0.000012 | 0.000015 | 0.000009 | 0.000014 | 0.000014 | 0.000014 | 0.000017 | 0.000015 | 0.000014 |
| Technical specification limit | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Reactor Coolant System Leakage

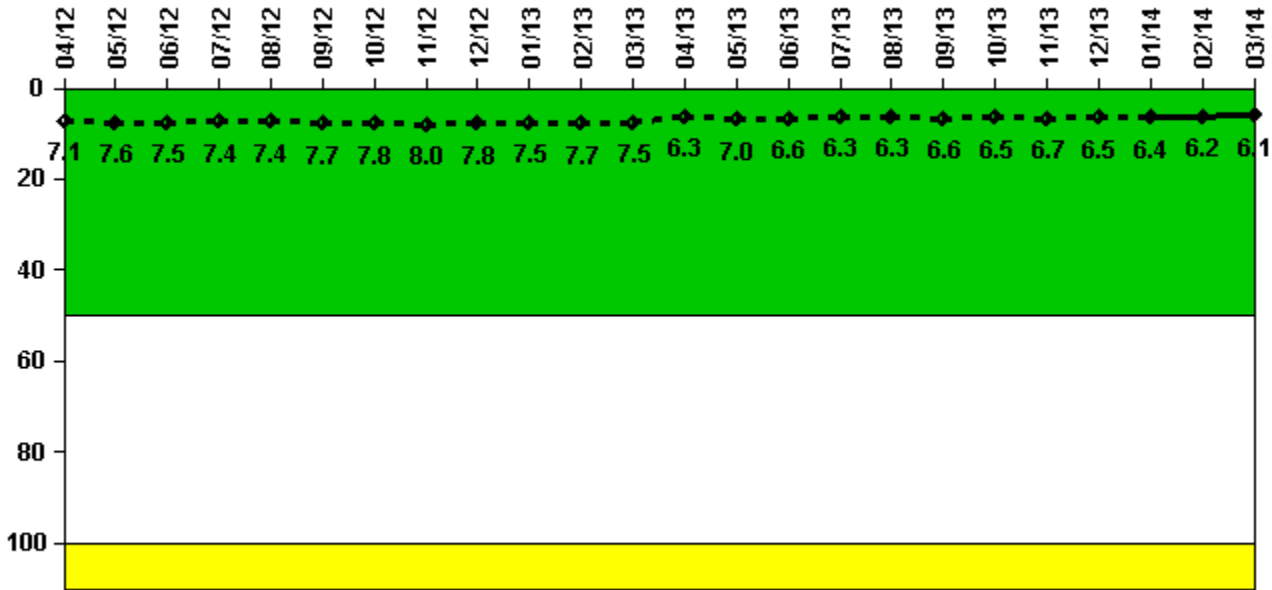


Thresholds: White > 50.0 Yellow > 100.0

Notes

| Reactor Coolant System Leakage | 4/12 | 5/12 | 6/12 | 7/12 | 8/12 | 9/12 | 10/12 | 11/12 | 12/12 | 1/13 | 2/13 | 3/13 |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Maximum leakage | 1.767 | 1.901 | 1.865 | 1.858 | 1.858 | 1.931 | 1.956 | 1.991 | 1.940 | 1.878 | 1.931 | 1.881 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 7.1 | 7.6 | 7.5 | 7.4 | 7.4 | 7.7 | 7.8 | 8.0 | 7.8 | 7.5 | 7.7 | 7.5 |
| Reactor Coolant System Leakage | 4/13 | 5/13 | 6/13 | 7/13 | 8/13 | 9/13 | 10/13 | 11/13 | 12/13 | 1/14 | 2/14 | 3/14 |
| Maximum leakage | 1.580 | 1.760 | 1.640 | 1.572 | 1.563 | 1.656 | 1.628 | 1.676 | 1.629 | 1.592 | 1.558 | 1.526 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 6.3 | 7.0 | 6.6 | 6.3 | 6.3 | 6.6 | 6.5 | 6.7 | 6.5 | 6.4 | 6.2 | 6.1 |

Licensee Comments: none

Drill/Exercise Performance

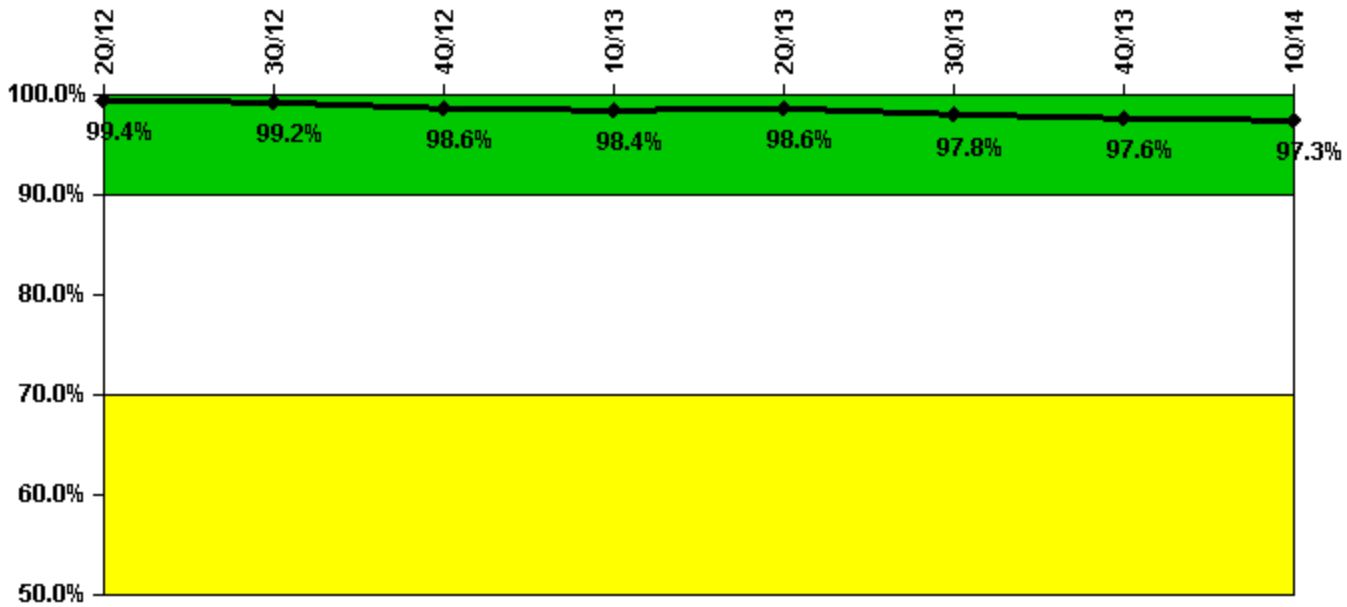

Thresholds: White < 90.0% Yellow < 70.0%


Notes

| Drill/Exercise Performance | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful opportunities | 53.0 | 31.0 | 37.0 | 15.0 | 47.0 | 31.0 | 26.0 | 15.0 |
| Total opportunities | 55.0 | 32.0 | 39.0 | 15.0 | 47.0 | 33.0 | 26.0 | 15.0 |
| Indicator value | 99.4% | 99.2% | 98.6% | 98.4% | 98.6% | 97.8% | 97.6% | 97.3% |

Licensee Comments:

3Q/12: A change package is being submitted for 3rd quarter 2012 to update the September data for Successful drill, exer & event opportunities & Total drill, exer & event opportunities from 7 to 14. This does not affect the color of any indicator.

ERO Drill Participation

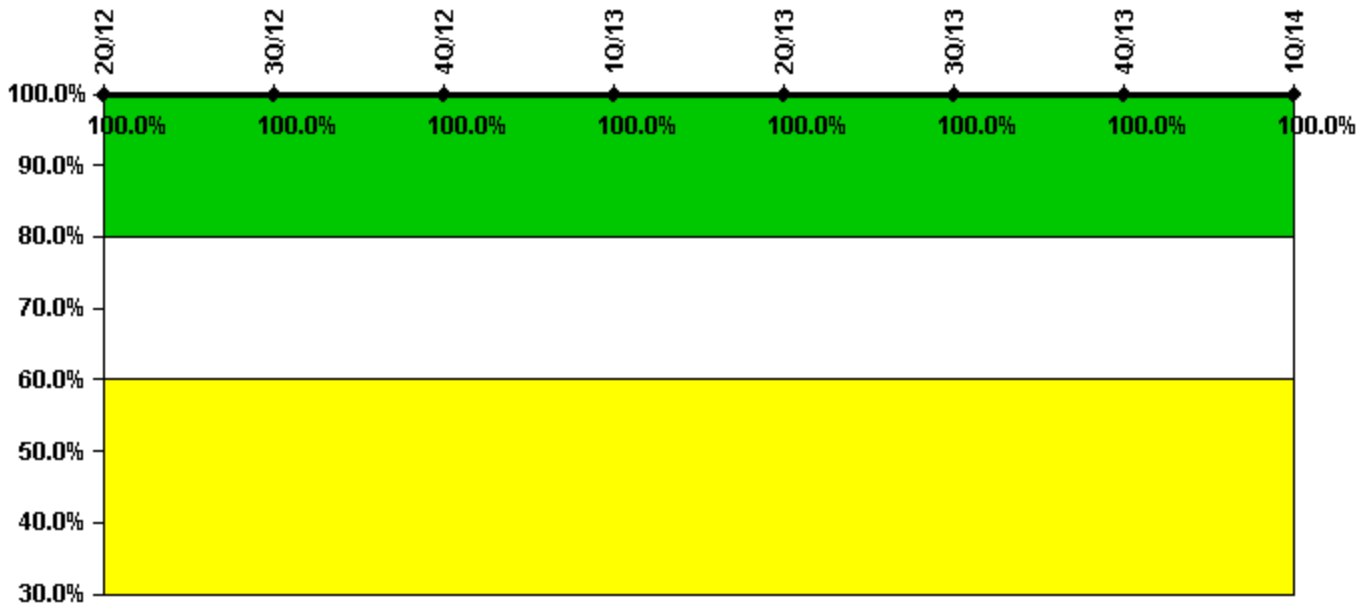


Thresholds: White < 80.0% Yellow < 60.0%

Notes

| ERO Drill Participation | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|-----------------------------|--------|--------|--------|--------|--------|--------|--------|--------|
| Participating Key personnel | 78.0 | 74.0 | 75.0 | 69.0 | 70.0 | 71.0 | 73.0 | 73.0 |
| Total Key personnel | 78.0 | 74.0 | 75.0 | 69.0 | 70.0 | 71.0 | 73.0 | 73.0 |
| Indicator value | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% |

Licensee Comments: none

Alert & Notification System

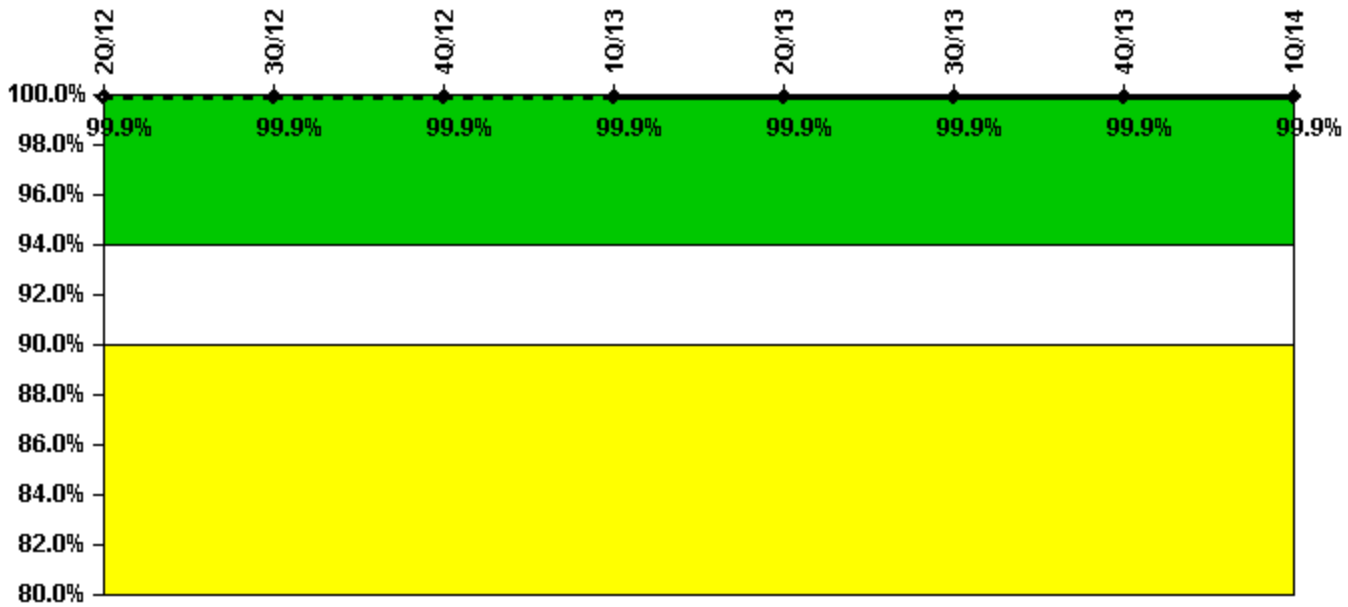


Thresholds: White < 94.0% Yellow < 90.0%

Notes

| Alert & Notification System | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful siren-tests | 2686 | 2640 | 2688 | 2685 | 2684 | 2686 | 2687 | 2641 |
| Total sirens-tests | 2688 | 2646 | 2688 | 2688 | 2688 | 2688 | 2688 | 2646 |
| Indicator value | 99.9% | 99.9% | 99.9% | 99.9% | 99.9% | 99.9% | 99.9% | 99.9% |

Licensee Comments: none

Occupational Exposure Control Effectiveness

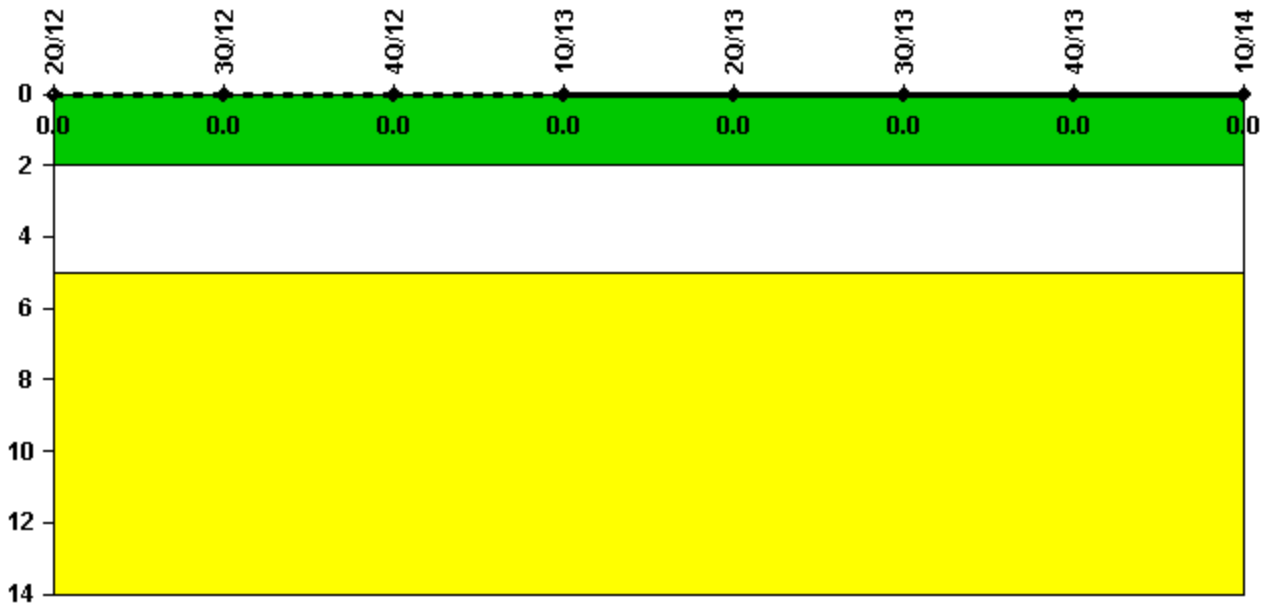


Thresholds: White > 2.0 Yellow > 5.0

Notes

| Occupational Exposure Control Effectiveness | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|---|----------|----------|----------|----------|----------|----------|----------|----------|
| High radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Very high radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Unintended exposure occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

RETS/ODCM Radiological Effluent

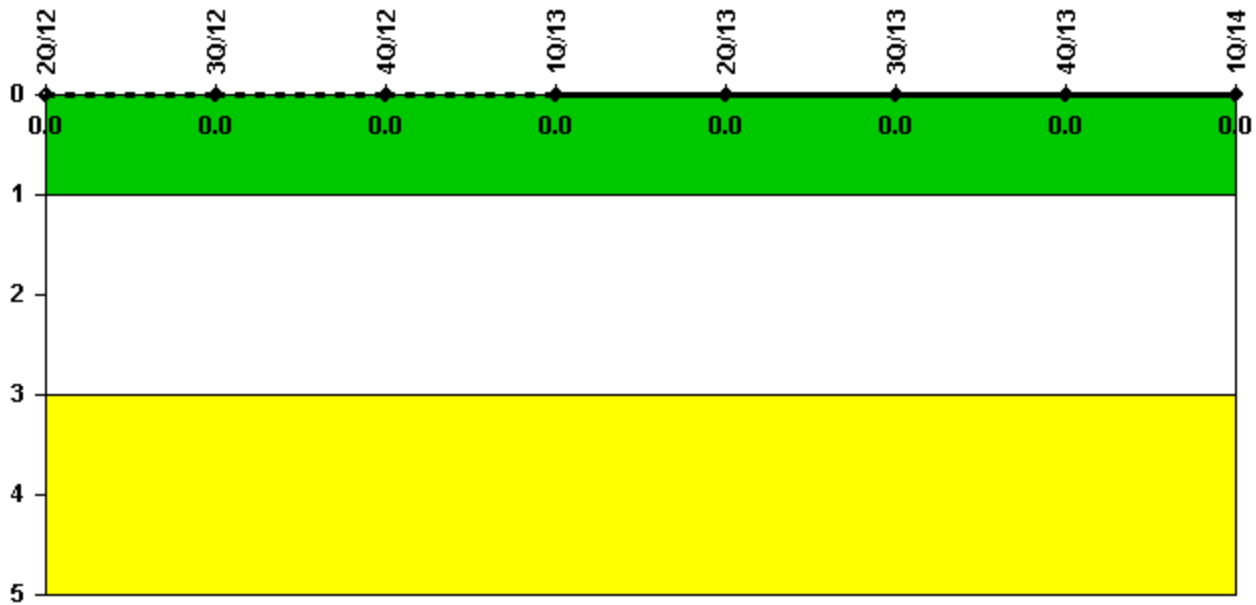

Thresholds: White > 1.0 Yellow > 3.0

Notes

| RETS/ODCM Radiological Effluent | 2Q/12 | 3Q/12 | 4Q/12 | 1Q/13 | 2Q/13 | 3Q/13 | 4Q/13 | 1Q/14 |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|
| RETS/ODCM occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 23, 2014