


Susquehanna 1

1Q/2014 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

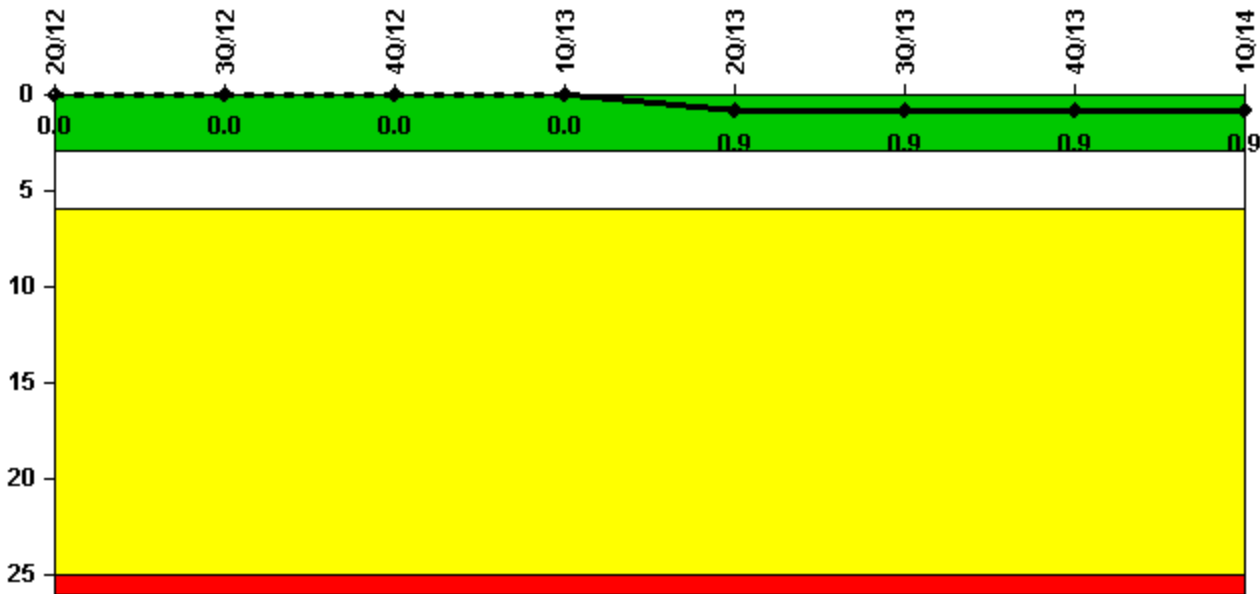


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Unplanned scrams	0	0	0	0	1.0	0	0	0
Critical hours	353.0	2208.0	1792.2	2159.0	1491.3	2208.0	2209.0	2159.0
Indicator value	0	0	0	0	0.9	0.9	0.9	0.9

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

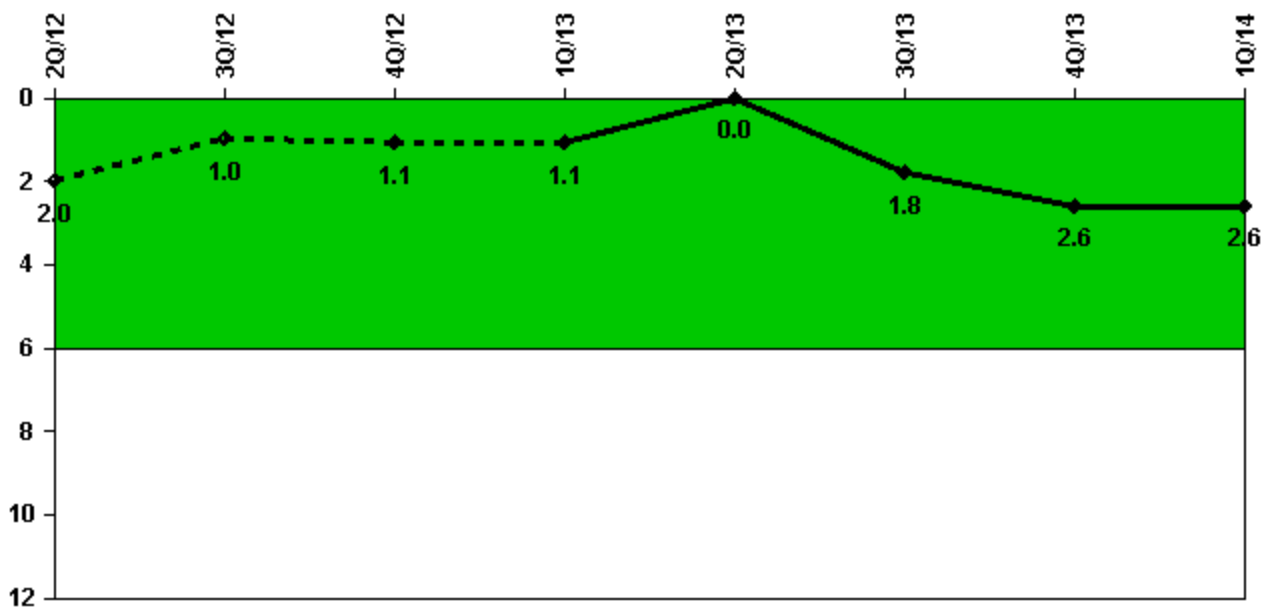


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Unplanned power changes	1.0	0	0	0	0	2.0	1.0	0
Critical hours	353.0	2208.0	1792.2	2159.0	1491.3	2208.0	2209.0	2159.0
Indicator value	2.0	1.0	1.1	1.1	0	1.8	2.6	2.6

Licensee Comments: none

Unplanned Scrams with Complications

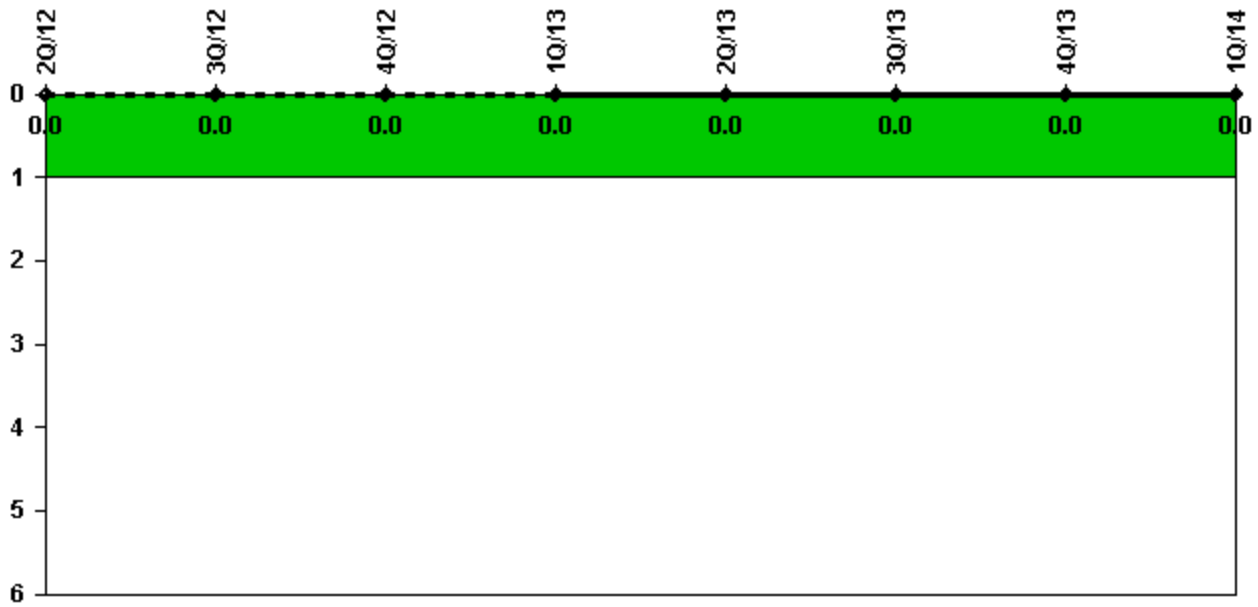


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

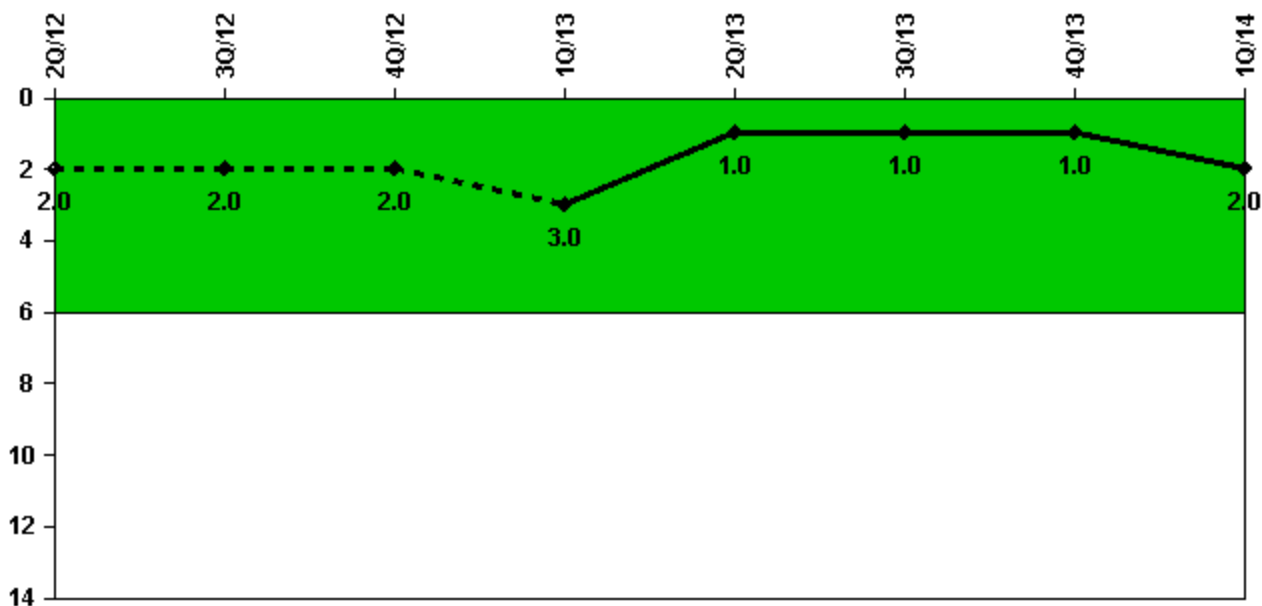

Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Safety System Functional Failures	2	0	0	1	0	0	0	2
Indicator value	2	2	2	3	1	1	1	2


Licensee Comments:

1Q/14: LER 387/2013-007-00:Loss of Secondary Containment due to drawdown test failure, submitted on January 21, 2014

1Q/13: LER 387/2012-010-00:Both Trains of Control Structure HVAC at Susquehanna Were Rendered Inoperable, submitted on February 12, 2013

2Q/12: LER 387/2012-001-00, Both Control Structure Chillers Inoperable, was submitted on May 23, 2012. LER 387/2012-002-00, "B" Control Structure Chiller Inoperable Concurrent with "A" Emergency Diesel Generator Out of Service, was submitted to the NRC on June 4, 2012.

Mitigating Systems Performance Index, Emergency AC Power System

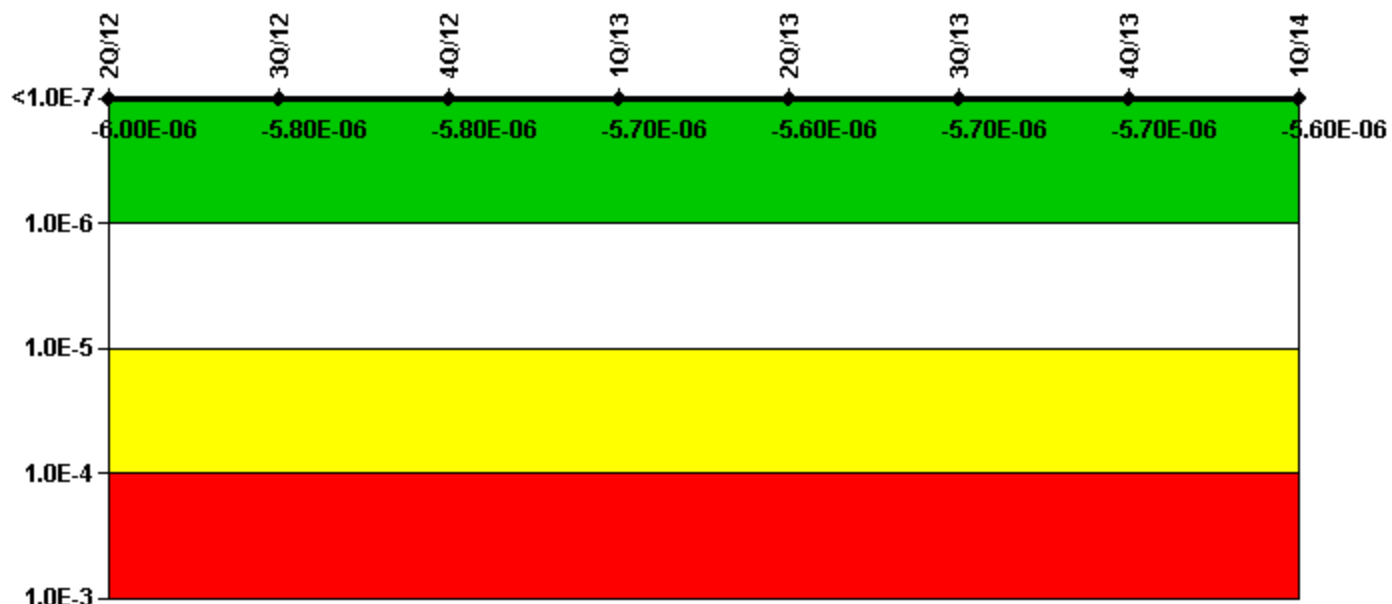

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	2.13E-07	2.04E-07	2.07E-07	2.14E-07	2.16E-07	2.13E-07	2.13E-07	1.99E-07
URI (Δ CDF)	-6.18E-06	-6.03E-06	-5.96E-06	-5.87E-06	-5.83E-06	-5.88E-06	-5.90E-06	-5.81E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.00E-06	-5.80E-06	-5.80E-06	-5.70E-06	-5.60E-06	-5.70E-06	-5.70E-06	-5.60E-06

Licensee Comments:

1Q/14: Risk Cap Invoked.

4Q/13: Risk Cap Invoked.

3Q/13: Risk Cap Invoked.

2Q/13: Risk Cap Invoked.

1Q/13: Risk Cap Invoked.


4Q/12: Risk Cap Invoked.

4Q/12: Risk Cap Invoked.

3Q/12: Risk Cap Invoked.

2Q/12: Risk Cap Invoked.

Mitigating Systems Performance Index, High Pressure Injection System

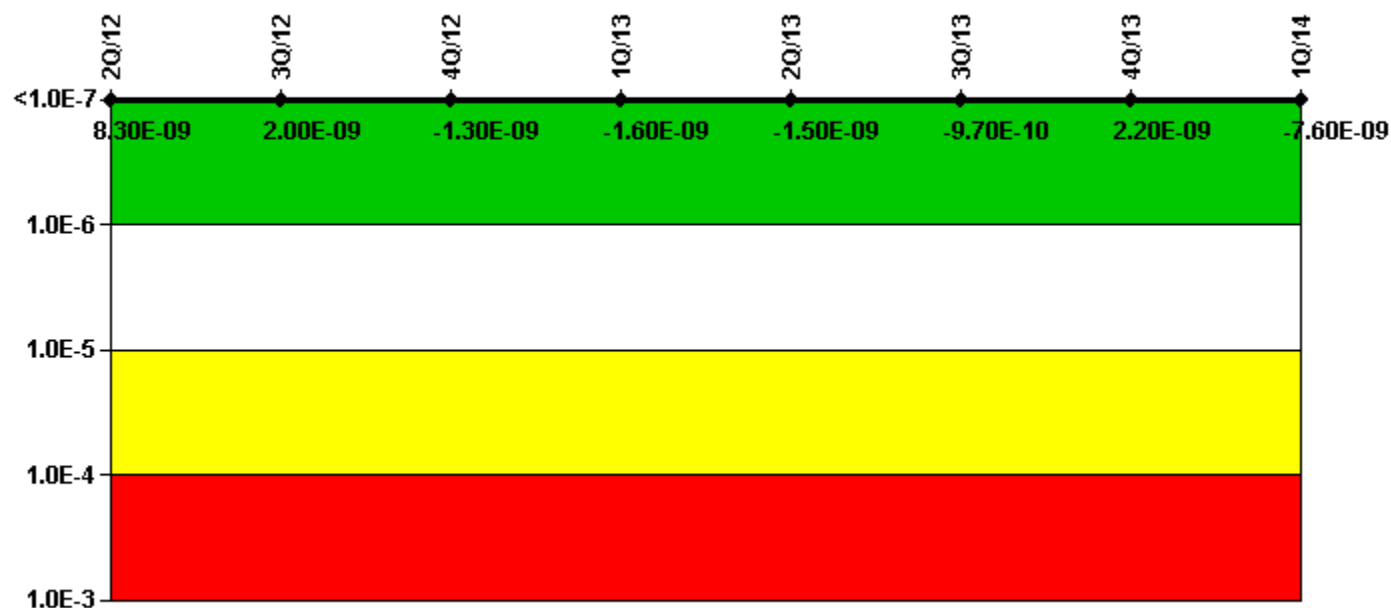


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	1.50E-08	8.70E-09	5.38E-09	5.07E-09	5.14E-09	4.97E-09	8.15E-09	-1.67E-09
URI (Δ CDF)	-6.71E-09	-6.71E-09	-6.71E-09	-6.65E-09	-6.65E-09	-5.94E-09	-5.94E-09	-5.94E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	8.30E-09	2.00E-09	-1.30E-09	-1.60E-09	-1.50E-09	-9.70E-10	2.20E-09	-7.60E-09

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

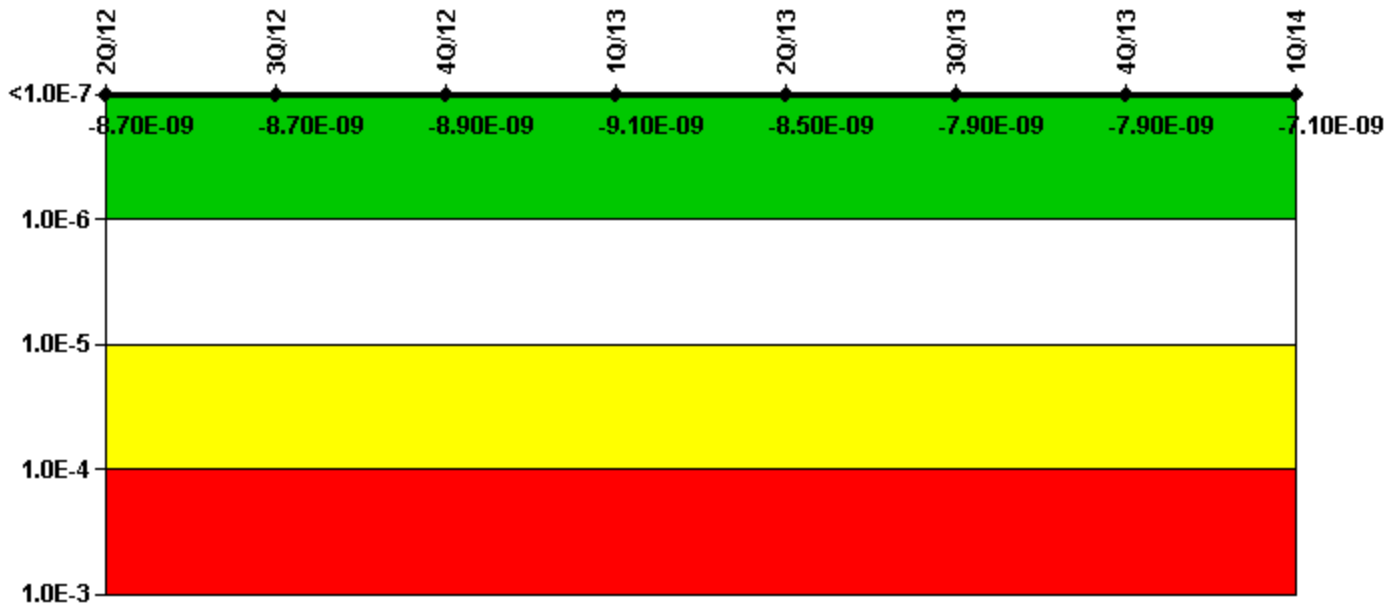


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	-2.68E-10	-2.62E-10	-5.55E-10	-6.68E-10	-6.41E-10	-7.05E-10	-7.05E-10	-2.61E-10
URI (Δ CDF)	-8.39E-09	-8.39E-09	-8.39E-09	-8.39E-09	-7.84E-09	-7.15E-09	-7.15E-09	-6.85E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.70E-09	-8.70E-09	-8.90E-09	-9.10E-09	-8.50E-09	-7.90E-09	-7.90E-09	-7.10E-09

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

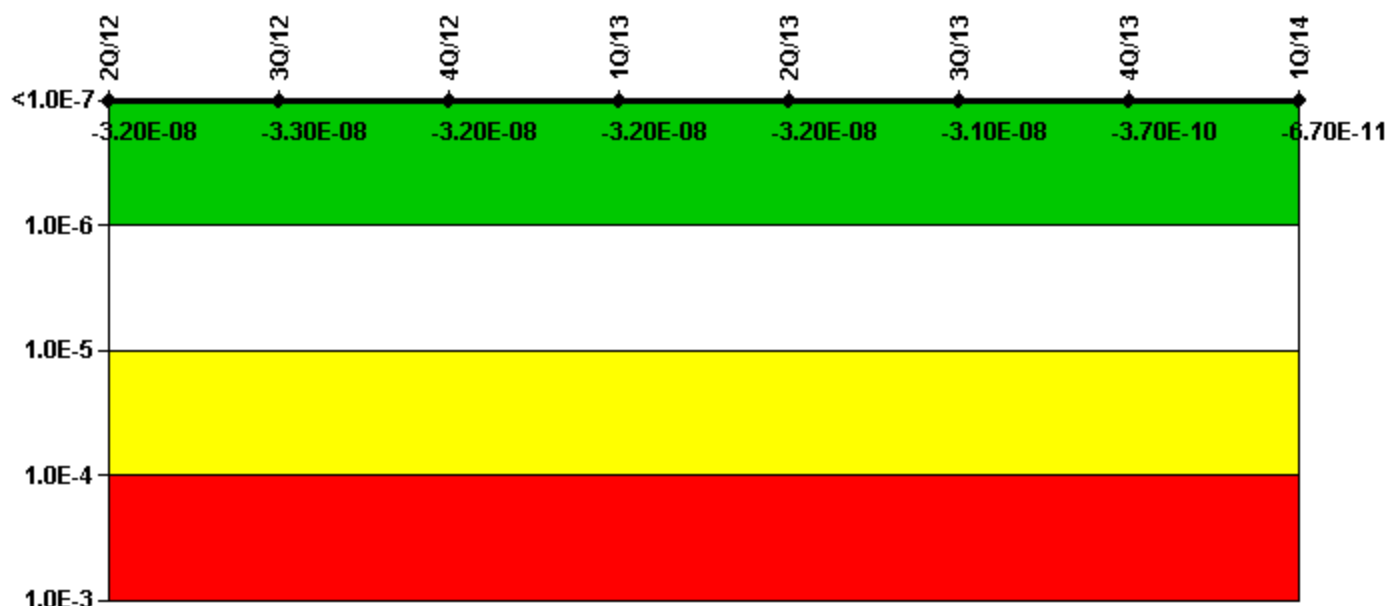

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	2.25E-09	1.38E-09	2.40E-09	1.58E-09	1.62E-09	1.53E-09	6.01E-09	6.09E-09
URI (Δ CDF)	-3.40E-08	-3.40E-08	-3.43E-08	-3.34E-08	-3.35E-08	-3.27E-08	-6.38E-09	-6.15E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.20E-08	-3.30E-08	-3.20E-08	-3.20E-08	-3.20E-08	-3.10E-08	-3.70E-10	-6.70E-11

Licensee Comments:

1Q/14: Previously reported data for Residual Heat Removal Mitigating Systems Performance Index for the months of November and December, 2013 are revised due to an Anti-Rotation Device failure. There is no safety significance associated with these changes. The PI color was green before the data revision and it remains green after the changes.

Mitigating Systems Performance Index, Cooling Water Systems

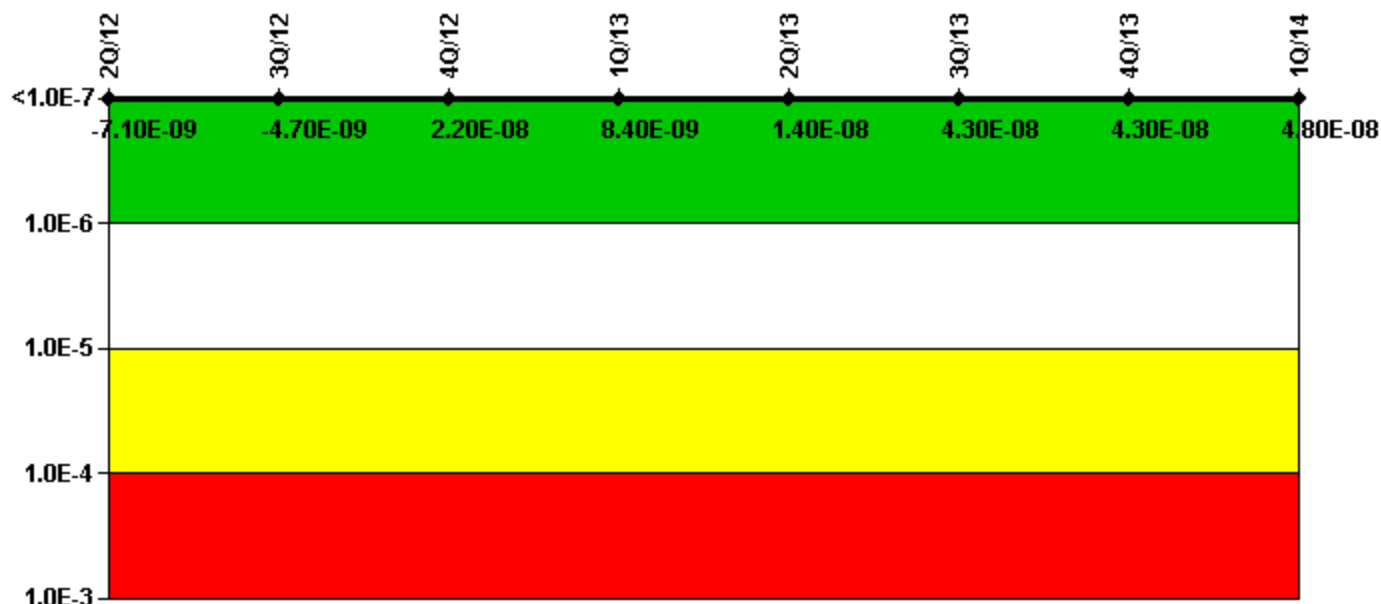


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
UAI (Δ CDF)	2.68E-08	2.94E-08	5.67E-08	4.30E-08	4.84E-08	7.77E-08	7.85E-08	8.28E-08
URI (Δ CDF)	-3.38E-08	-3.42E-08	-3.47E-08	-3.46E-08	-3.48E-08	-3.50E-08	-3.51E-08	-3.51E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.10E-09	-4.70E-09	2.20E-08	8.40E-09	1.40E-08	4.30E-08	4.30E-08	4.80E-08

Licensee Comments: none

Reactor Coolant System Activity

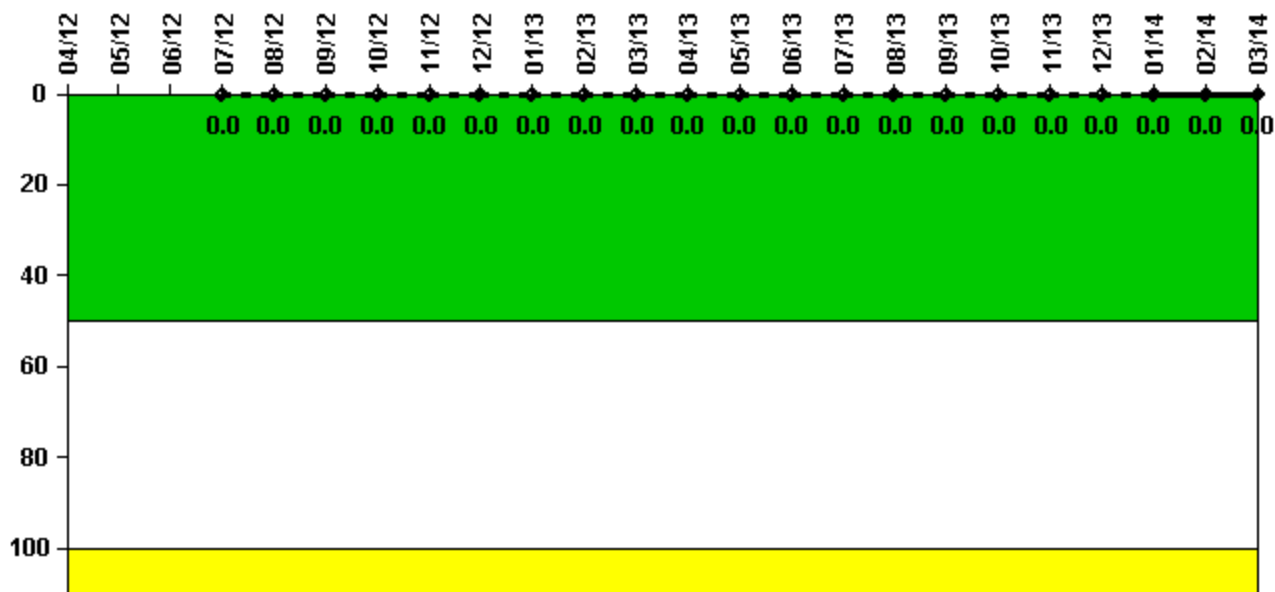

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13
Maximum activity	N/A	N/A	N/A	0.000003	0.000005	0.000006	0.000005	0.000006	0.000007	0.000006	0.000007	0.000007
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	N/A	N/A	N/A	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14
Maximum activity	0.000007	0.000007	0.000007	0.000007	0.000007	0.000008	0.000007	0.000008	0.000008	0.000009	0.000008	0.000010
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

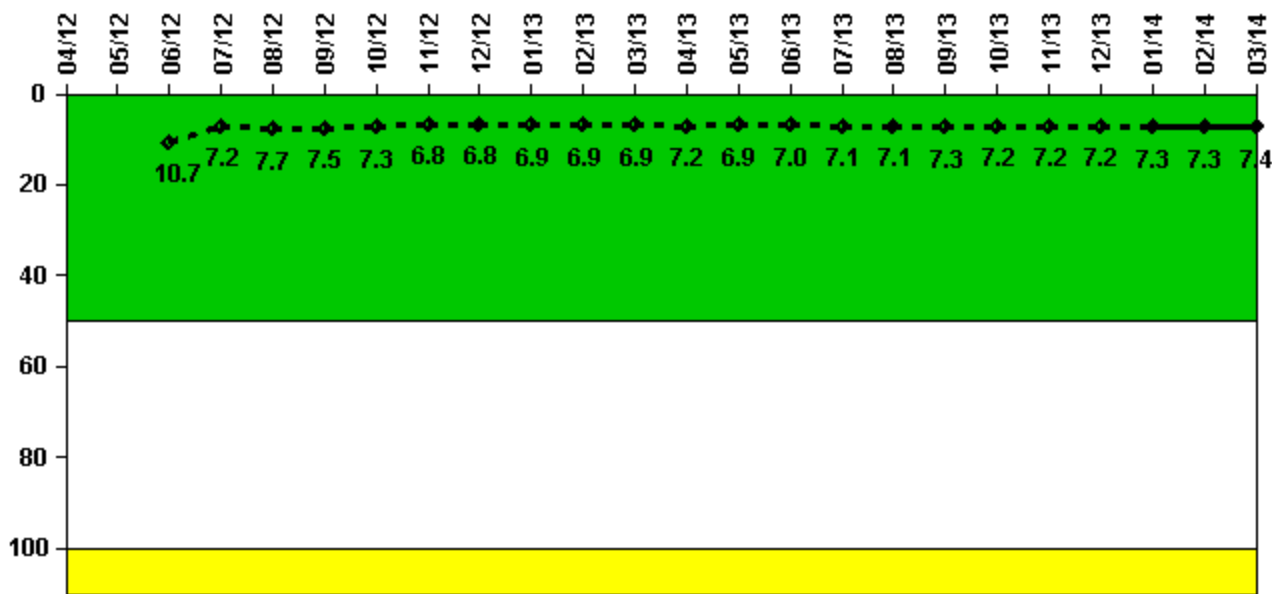

Thresholds: White > 50.0 Yellow > 100.0

Notes


Reactor Coolant System Leakage	4/12	5/12	6/12	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13
Maximum leakage	N/A	N/A	2.680	1.800	1.920	1.880	1.830	1.710	1.710	1.730	1.720	1.720
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	N/A	N/A	10.7	7.2	7.7	7.5	7.3	6.8	6.8	6.9	6.9	6.9

Reactor Coolant System Leakage	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14
Maximum leakage	1.810	1.720	1.740	1.770	1.770	1.820	1.790	1.790	1.810	1.820	1.830	1.850
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.2	6.9	7.0	7.1	7.1	7.3	7.2	7.2	7.2	7.3	7.3	7.4

Licensee Comments:

6/13: Previously reported data for Reactor Coolant System Leakage for the months of July 2012, October 2012, December 2012, and February 2013 is revised due to data entry errors. There is no safety significance associated with these changes. The PI color was green before the data revision and it remains green after the changes.

Drill/Exercise Performance

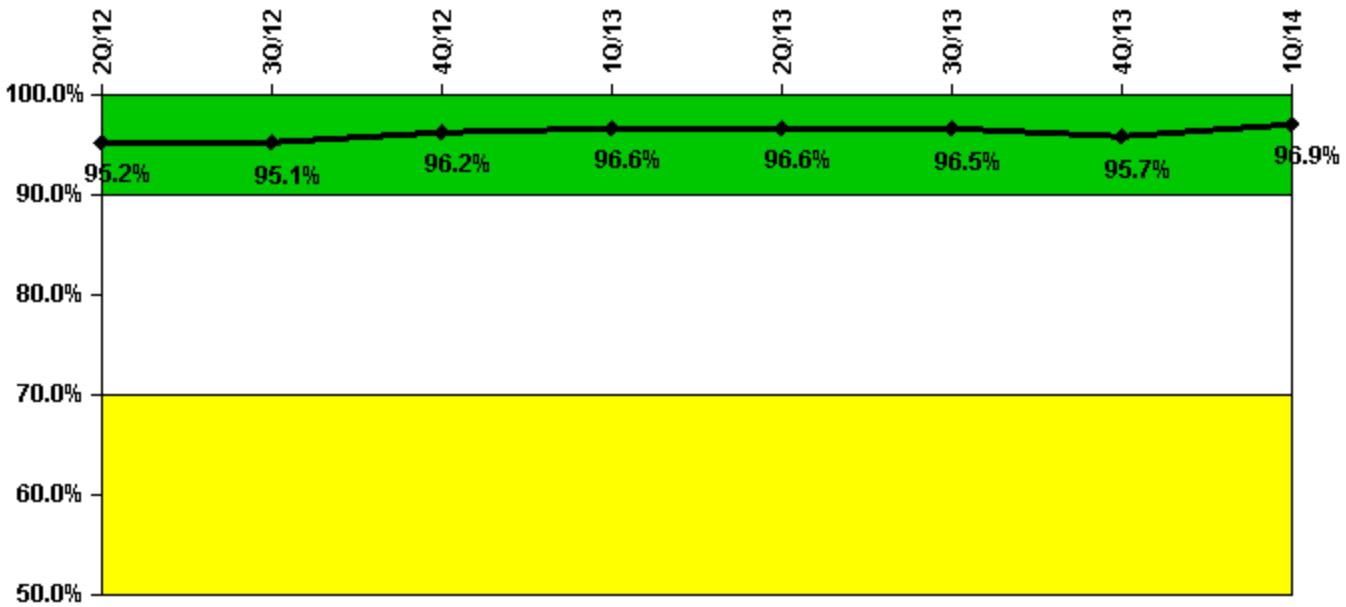


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Successful opportunities	12.0	32.0	7.0	18.0	18.0	19.0	26.0	58.0
Total opportunities	12.0	33.0	8.0	18.0	18.0	20.0	28.0	59.0
Indicator value	95.2%	95.1%	96.2%	96.6%	96.6%	96.5%	95.7%	96.9%

Licensee Comments: none

ERO Drill Participation

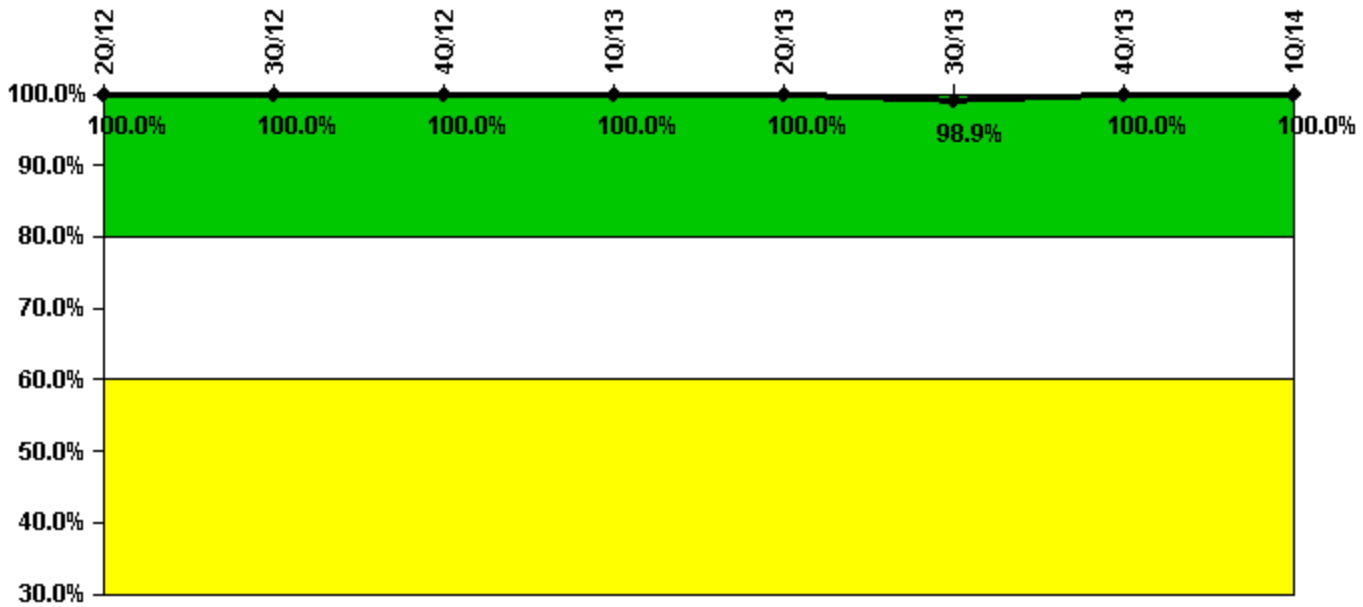


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Participating Key personnel	75.0	74.0	77.0	80.0	82.0	86.0	91.0	94.0
Total Key personnel	75.0	74.0	77.0	80.0	82.0	87.0	91.0	94.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	98.9%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

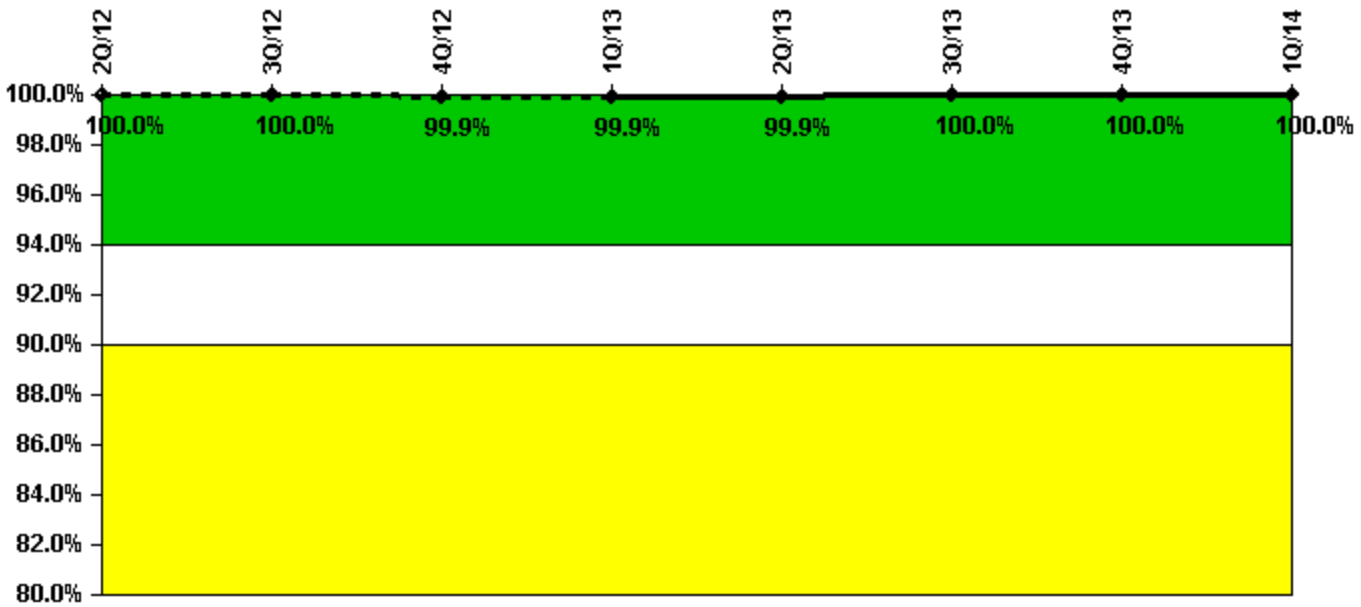


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
Successful siren-tests	532	607	531	608	532	608	532	608
Total sirens-tests	532	608	532	608	532	608	532	608
Indicator value	100.0%	100.0%	99.9%	99.9%	99.9%	100.0%	100.0%	100.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

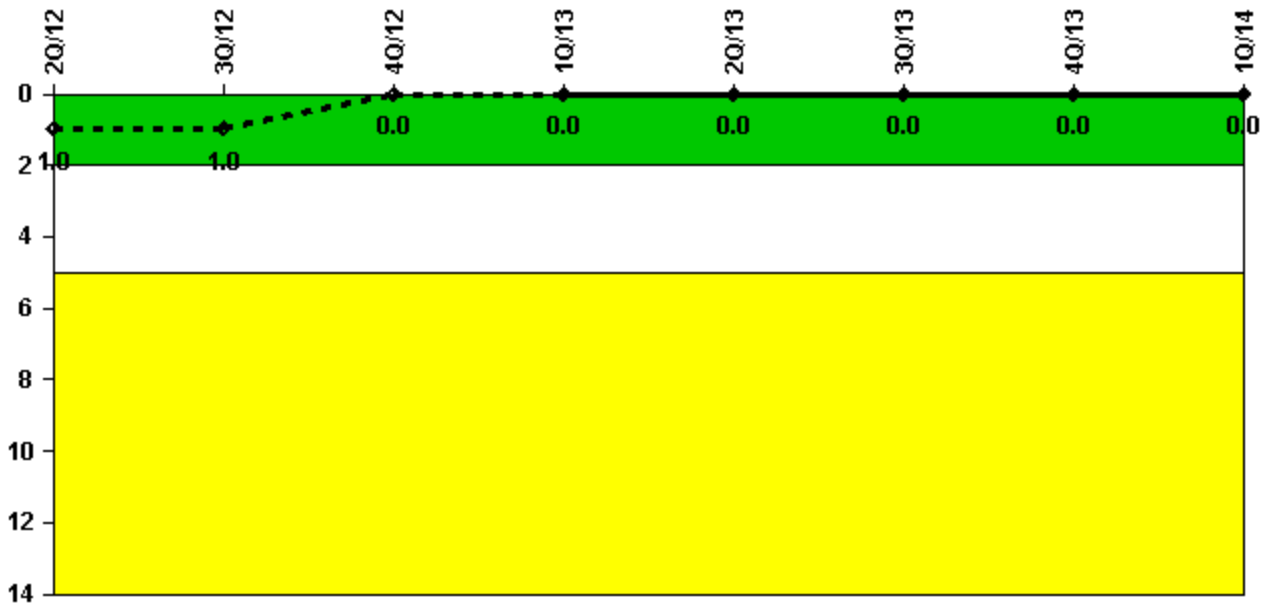


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	1	1	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

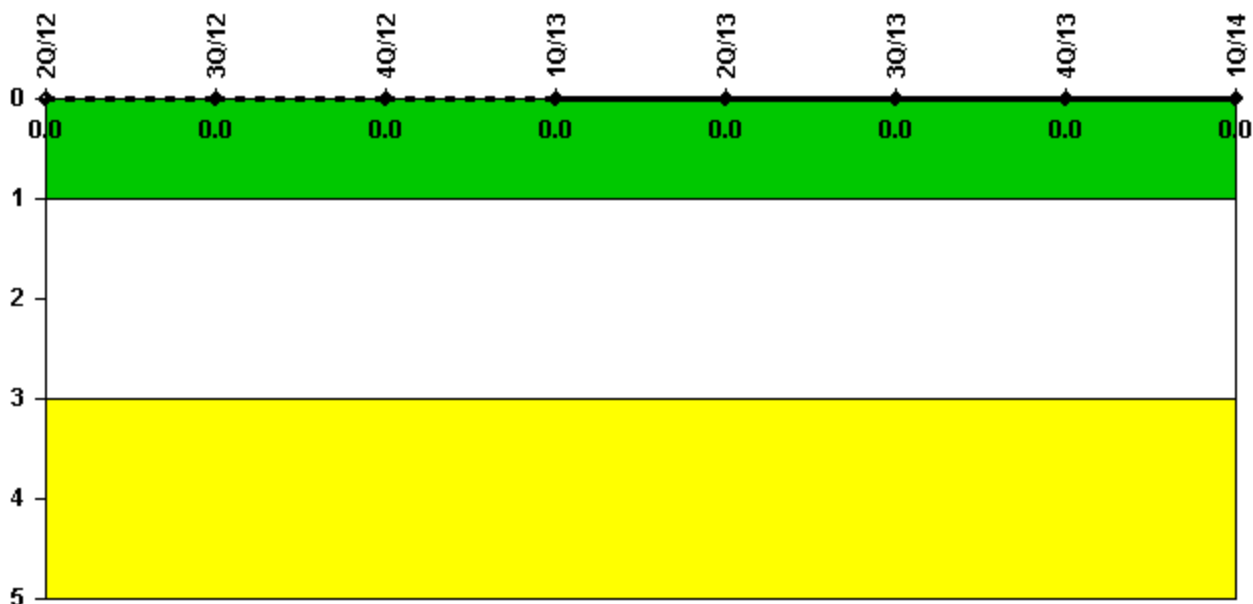

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 23, 2014