


# Ginna

## 2Q/2014 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

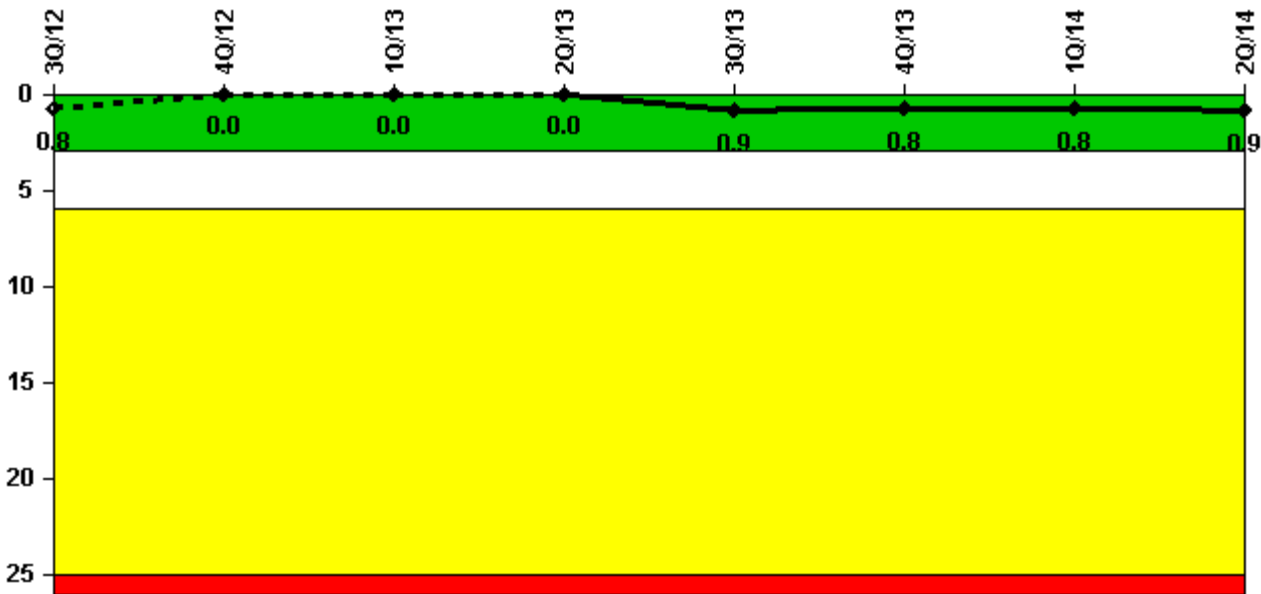


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Unplanned scrams	0	0	0	0	1.0	0	0	0
Critical hours	2208.0	1518.9	2159.0	2184.0	2130.0	2209.0	2159.0	1617.0
<b>Indicator value</b>	<b>0.8</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0.9</b>	<b>0.8</b>	<b>0.8</b>	<b>0.9</b>

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

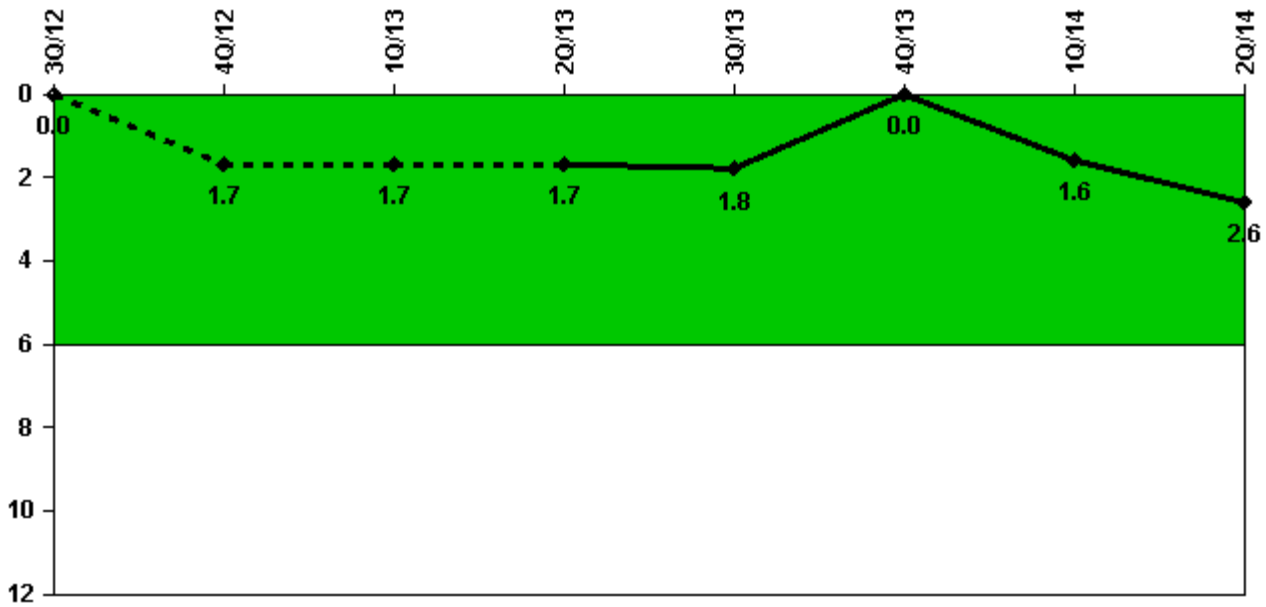

Thresholds: White > 6.0


#### Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Unplanned power changes	0	2.0	0	0	0	0	2.0	1.0
Critical hours	2208.0	1518.9	2159.0	2184.0	2130.0	2209.0	2159.0	1617.0
<b>Indicator value</b>	<b>0</b>	<b>1.7</b>	<b>1.7</b>	<b>1.7</b>	<b>1.8</b>	<b>0</b>	<b>1.6</b>	<b>2.6</b>

Licensee Comments:

1Q/14: After further review of the data it has been determined that the unplanned downpower in January 2014 is more correctly counted as two separate Initiating Events instead of one, as previously reported. The performance indicator remains in the 'Green' performance band.

### Unplanned Scrams with Complications

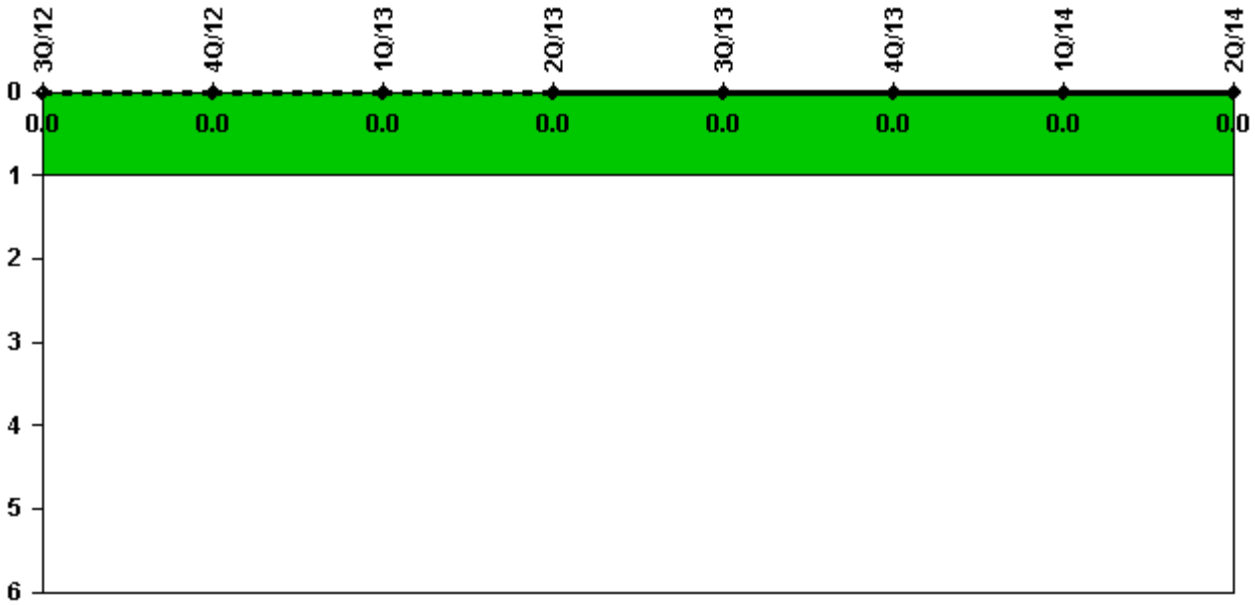


Thresholds: White > 1.0

#### Notes

Unplanned Scrams with Complications	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Scrams with complications	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>

Licensee Comments: none

### Safety System Functional Failures (PWR)

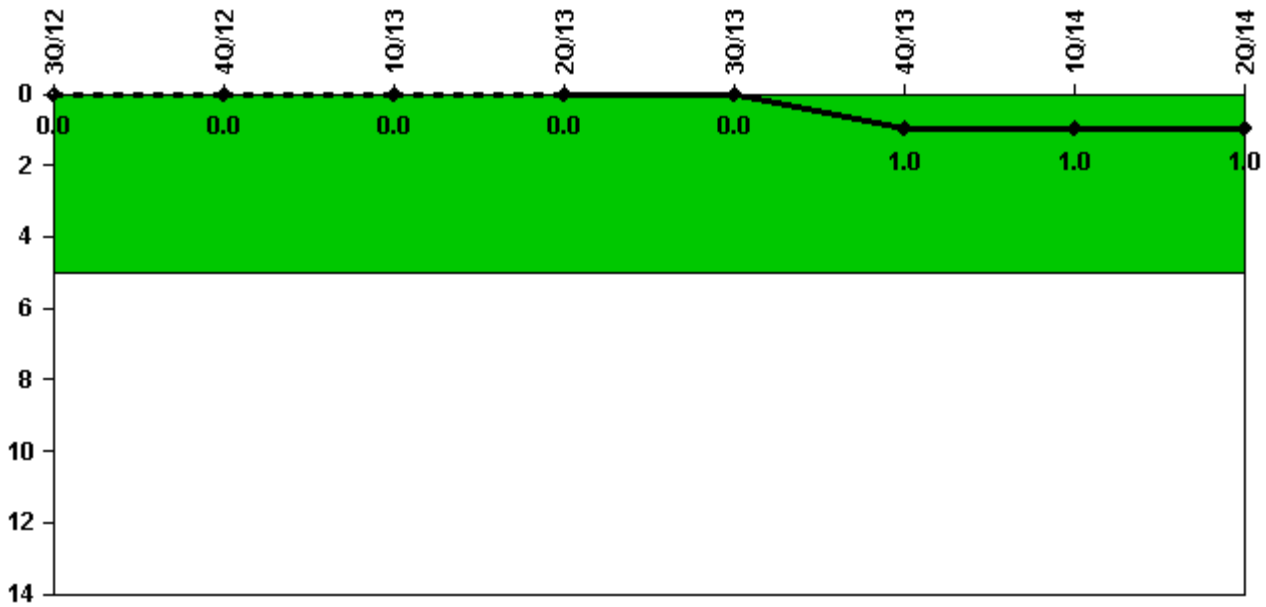


Thresholds: White > 5.0

#### Notes

Safety System Functional Failures (PWR)	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Safety System Functional Failures	0	0	0	0	0	1	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>1</b>	<b>1</b>	<b>1</b>

Licensee Comments: none

### Mitigating Systems Performance Index, Emergency AC Power System

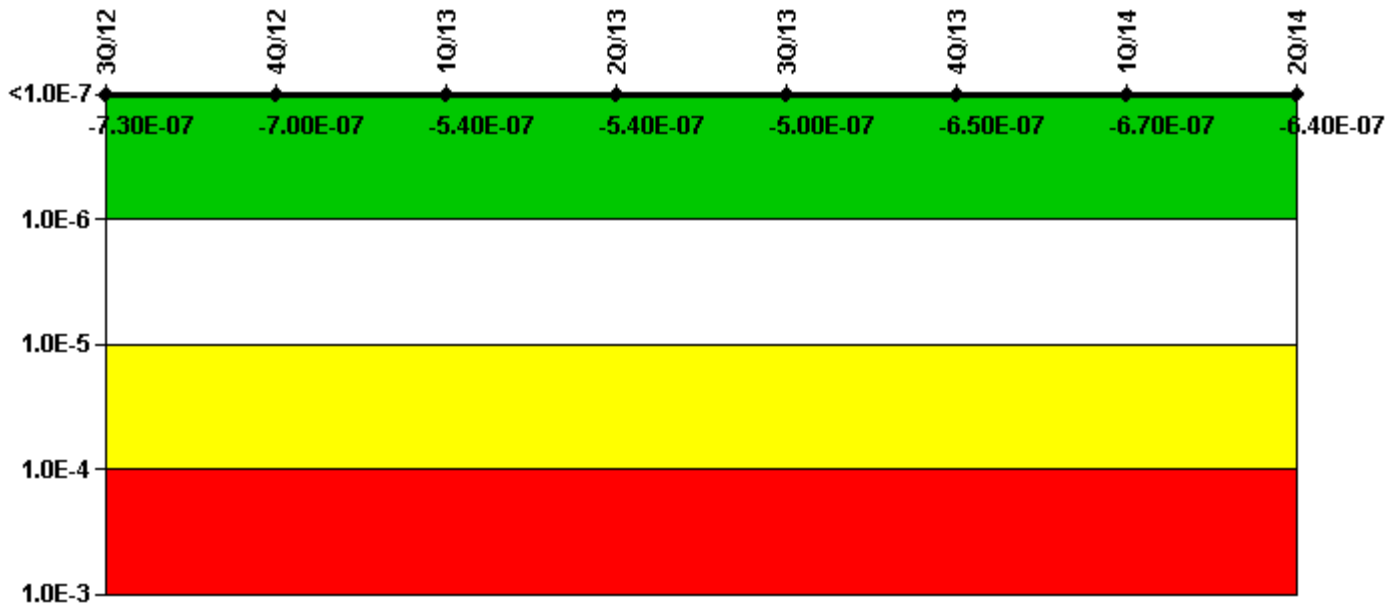

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes


Mitigating Systems Performance Index, Emergency AC Power System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI ( $\Delta$ CDF)	-1.21E-07	-1.19E-07	3.95E-08	3.02E-08	6.72E-08	-1.19E-07	-1.39E-07	-1.39E-07
URI ( $\Delta$ CDF)	-6.10E-07	-5.86E-07	-5.77E-07	-5.69E-07	-5.64E-07	-5.36E-07	-5.28E-07	-5.00E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
<b>Indicator value</b>	<b>-7.30E-07</b>	<b>-7.00E-07</b>	<b>-5.40E-07</b>	<b>-5.40E-07</b>	<b>-5.00E-07</b>	<b>-6.50E-07</b>	<b>-6.70E-07</b>	<b>-6.40E-07</b>

#### Licensee Comments:

2Q/14: The reservoir cup of an oil mister for the A EDG air start motor was found disconnected in March. The event is not classified as an MSPI failure. Engineering analysis has confirmed the operability assessment of the EDG while the oiler cup was disconnected.

1Q/14: The reservoir cup of an oil mister for the A EDG air start motor was found disconnected in March. The event is not classified as an MSPI failure. A confirmatory analysis will supplement the Apparent Cause Evaluation to document the basis for this conclusion.

### Mitigating Systems Performance Index, High Pressure Injection System

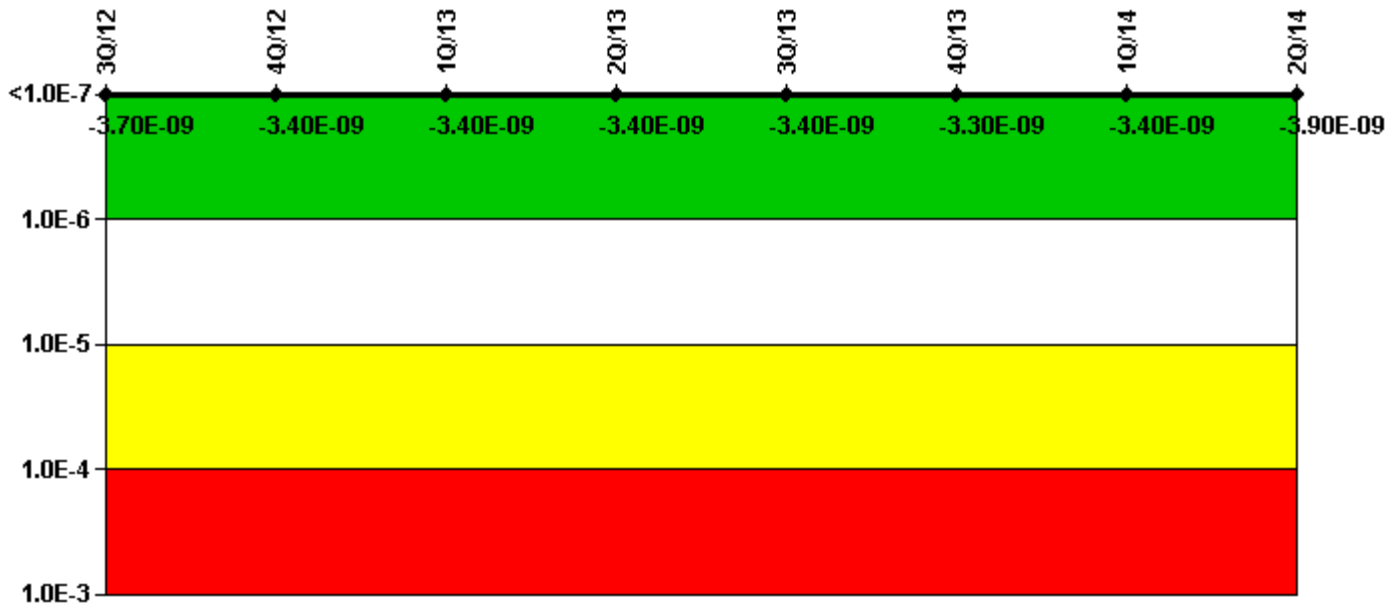


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI ( $\Delta$ CDF)	7.42E-10	1.09E-09	1.07E-09	1.07E-09	1.08E-09	1.13E-09	1.08E-09	6.01E-10
URI ( $\Delta$ CDF)	-4.47E-09	-4.46E-09	-4.46E-09	-4.46E-09	-4.46E-09	-4.46E-09	-4.46E-09	-4.46E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.70E-09	-3.40E-09	-3.40E-09	-3.40E-09	-3.40E-09	-3.30E-09	-3.40E-09	-3.90E-09

Licensee Comments: none

### Mitigating Systems Performance Index, Heat Removal System

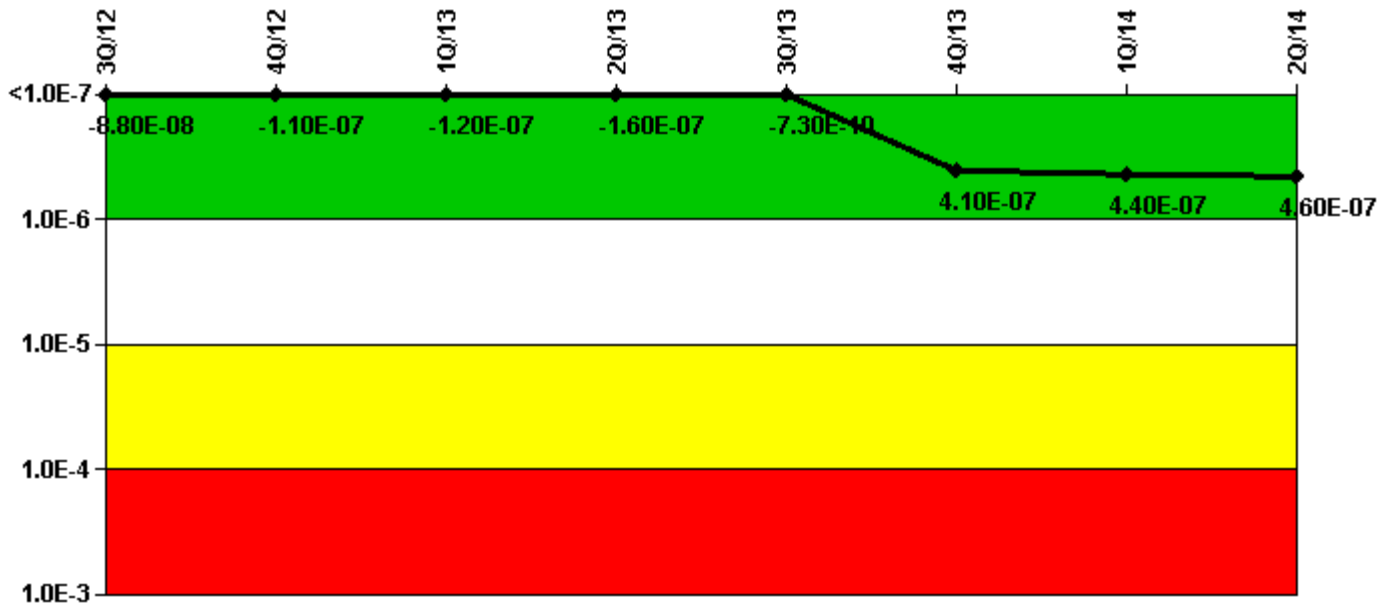


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI ( $\Delta$ CDF)	1.03E-07	7.67E-08	5.11E-08	7.24E-09	1.13E-08	1.80E-08	1.79E-08	3.50E-08
URI ( $\Delta$ CDF)	-1.90E-07	-1.86E-07	-1.76E-07	-1.70E-07	-1.20E-08	3.95E-07	4.18E-07	4.27E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.80E-08	-1.10E-07	-1.20E-07	-1.60E-07	-7.30E-10	4.10E-07	4.40E-07	4.60E-07

Licensee Comments: none

### Mitigating Systems Performance Index, Residual Heat Removal System

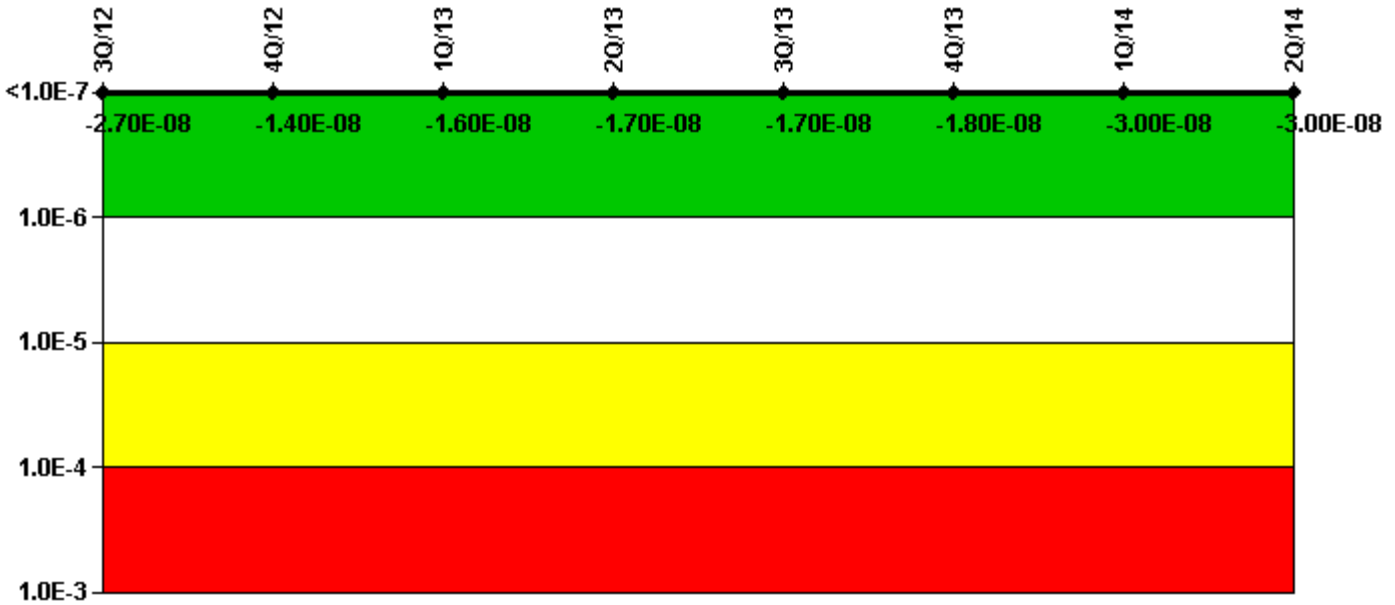

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI ( $\Delta$ CDF)	-5.02E-09	7.54E-09	5.11E-09	4.61E-09	4.48E-09	3.72E-09	-8.64E-09	-8.64E-09
URI ( $\Delta$ CDF)	-2.16E-08	-2.15E-08	-2.15E-08	-2.15E-08	-2.15E-08	-2.15E-08	-2.15E-08	-2.15E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.70E-08	-1.40E-08	-1.60E-08	-1.70E-08	-1.70E-08	-1.80E-08	-3.00E-08	-3.00E-08

Licensee Comments: none



### Mitigating Systems Performance Index, Cooling Water Systems

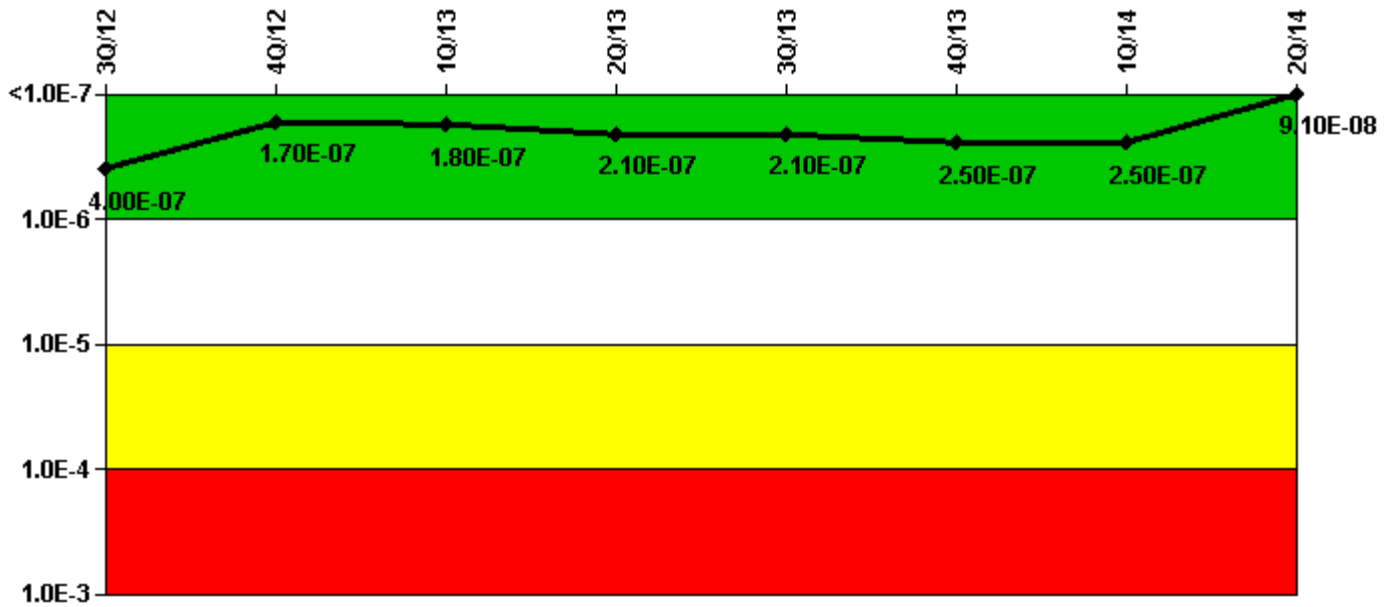


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI ( $\Delta$ CDF)	9.85E-08	3.35E-08	3.69E-08	3.71E-08	3.98E-08	4.26E-08	4.71E-08	4.45E-08
URI ( $\Delta$ CDF)	2.97E-07	1.40E-07	1.40E-07	1.73E-07	1.73E-07	2.06E-07	2.06E-07	4.61E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	4.00E-07	1.70E-07	1.80E-07	2.10E-07	2.10E-07	2.50E-07	2.50E-07	9.10E-08

Licensee Comments: none

### Reactor Coolant System Activity

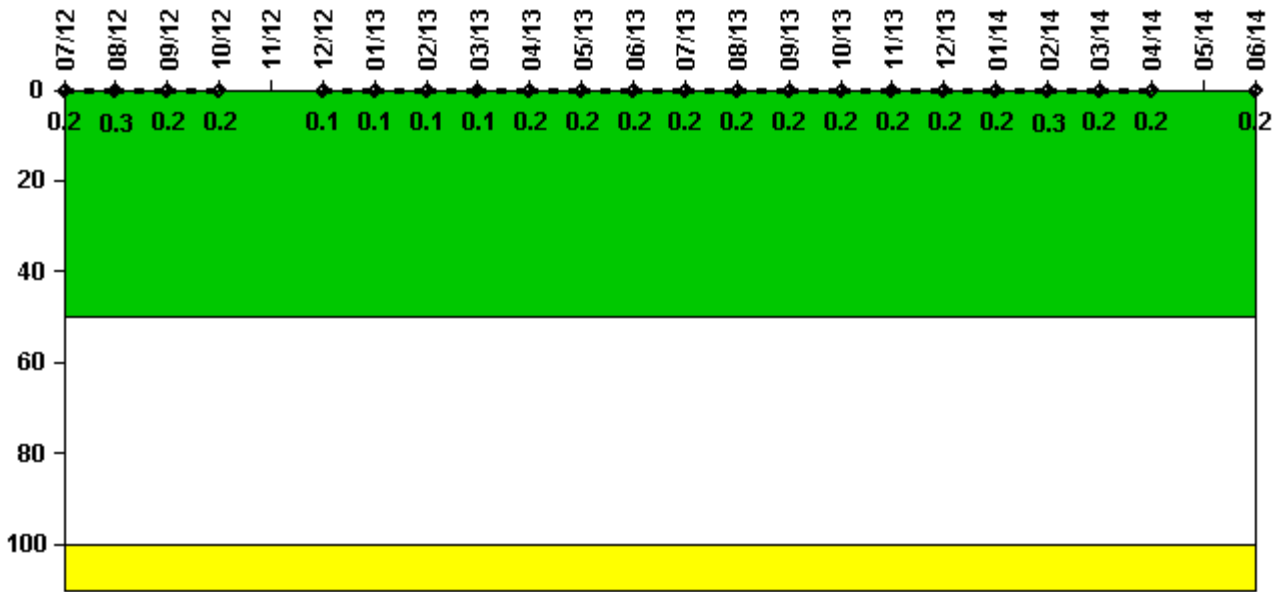

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Activity	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13
Maximum activity	0.002480	0.002850	0.002310	0.002420	N/A	0.001100	0.001470	0.001380	0.001360	0.002450	0.001680	0.001760
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.3	0.2	0.2	N/A	0.1	0.1	0.1	0.1	0.2	0.2	0.2

Reactor Coolant System Activity	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum activity	0.001660	0.002080	0.002340	0.002090	0.002150	0.002290	0.002470	0.002820	0.002170	0.002240	N/A	0.001500
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.3	0.2	0.2	N/A	0.2

Licensee Comments: none

### Reactor Coolant System Leakage

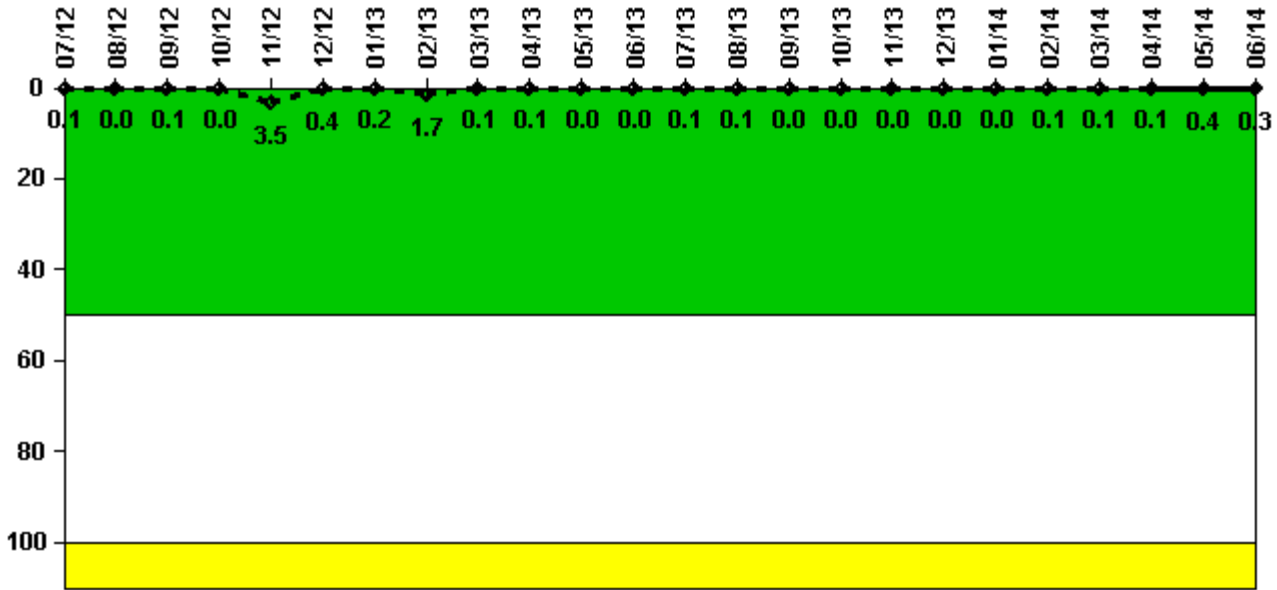


Thresholds: White > 50.0 Yellow > 100.0

#### Notes

Reactor Coolant System Leakage	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13
Maximum leakage	0.005	0.004	0.009	0.004	0.347	0.036	0.024	0.165	0.009	0.006	0.004	0.004
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
<b>Indicator value</b>	<b>0.1</b>	<b>0</b>	<b>0.1</b>	<b>0</b>	<b>3.5</b>	<b>0.4</b>	<b>0.2</b>	<b>1.7</b>	<b>0.1</b>	<b>0.1</b>	<b>0</b>	<b>0</b>
Reactor Coolant System Leakage	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum leakage	0.007	0.005	0.004	0.004	0.003	0.004	0.004	0.005	0.008	0.011	0.039	0.027
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
<b>Indicator value</b>	<b>0.1</b>	<b>0.1</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.4</b>	<b>0.3</b>

Licensee Comments: none

### Drill/Exercise Performance

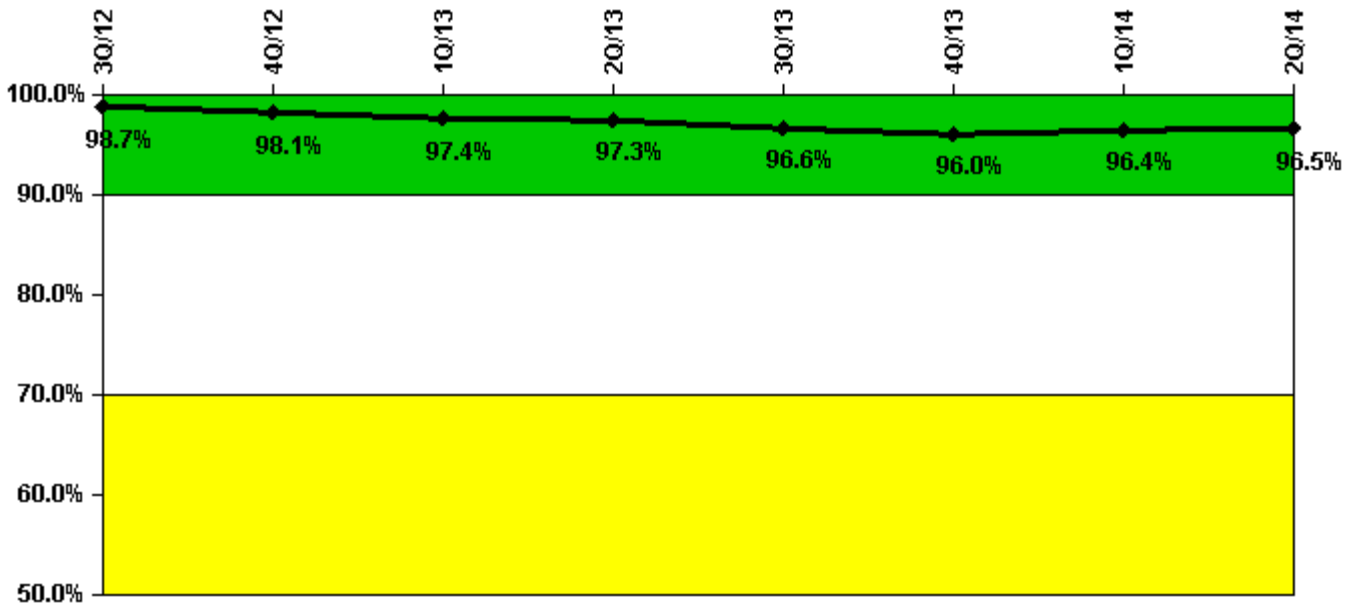


Thresholds: White < 90.0% Yellow < 70.0%

#### Notes

Drill/Exercise Performance	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Successful opportunities	19.0	59.0	20.0	29.0	27.0	71.0	92.0	40.0
Total opportunities	19.0	60.0	22.0	30.0	29.0	75.0	94.0	41.0
Indicator value	98.7%	98.1%	97.4%	97.3%	96.6%	96.0%	96.4%	96.5%

Licensee Comments: none

### ERO Drill Participation

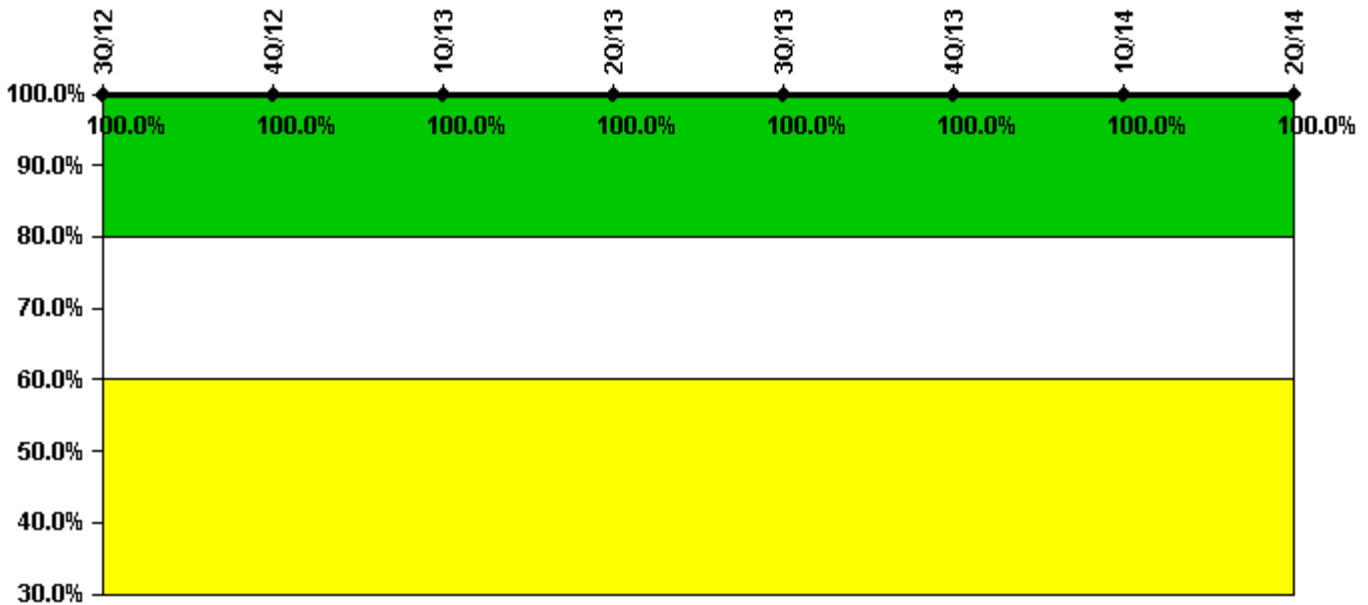


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Participating Key personnel	64.0	62.0	67.0	67.0	65.0	66.0	47.0	49.0
Total Key personnel	64.0	62.0	67.0	67.0	65.0	66.0	47.0	49.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

### Alert & Notification System

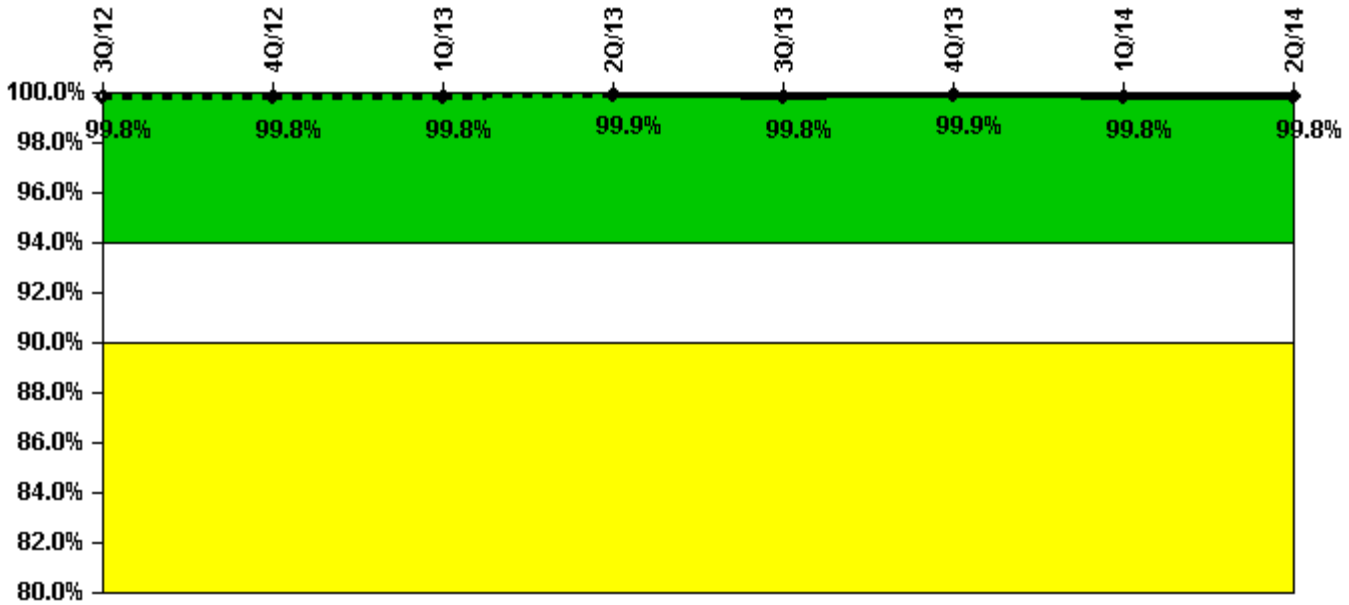

Thresholds: White < 94.0% Yellow < 90.0%


#### Notes

Alert & Notification System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Successful siren-tests	1246	1246	1343	1245	1245	1248	1241	1343
Total sirens-tests	1248	1248	1344	1247	1248	1248	1248	1344
Indicator value	99.8%	99.8%	99.8%	99.9%	99.8%	99.9%	99.8%	99.8%

#### Licensee Comments:

1Q/13: Upon review of previously submitted Alert and Notification System (ANS) data for the month of January 2013, it was determined that one (1) siren failure had occurred that was not initially reported. The color for this performance indicator remains green.

### Occupational Exposure Control Effectiveness

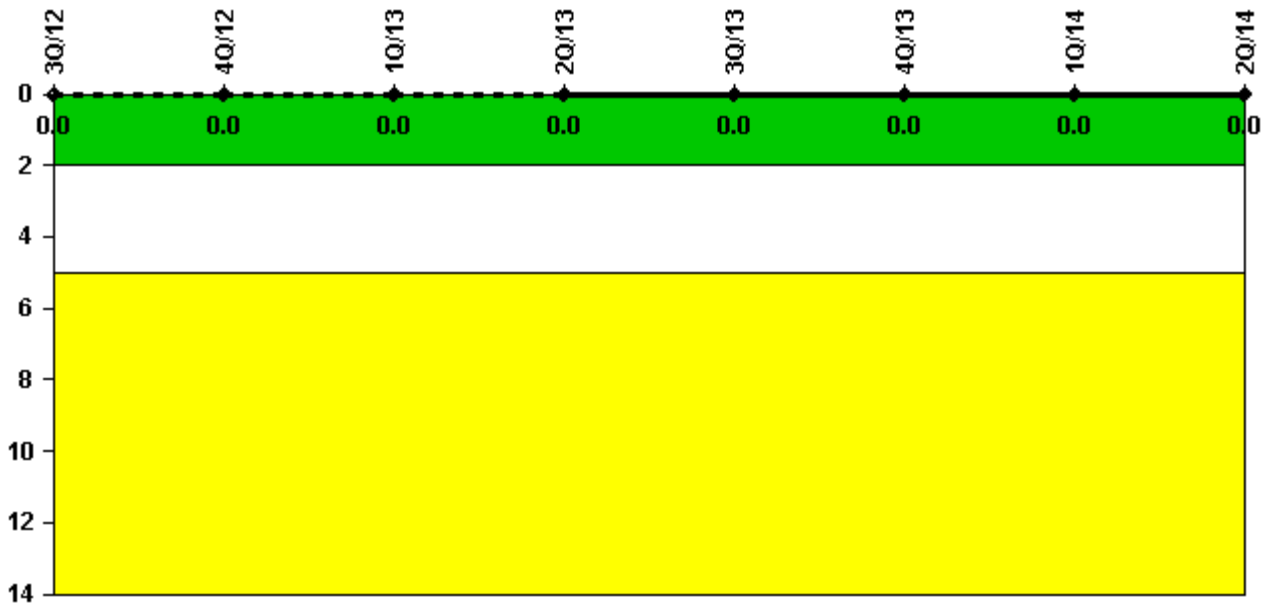


Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### RETS/ODCM Radiological Effluent

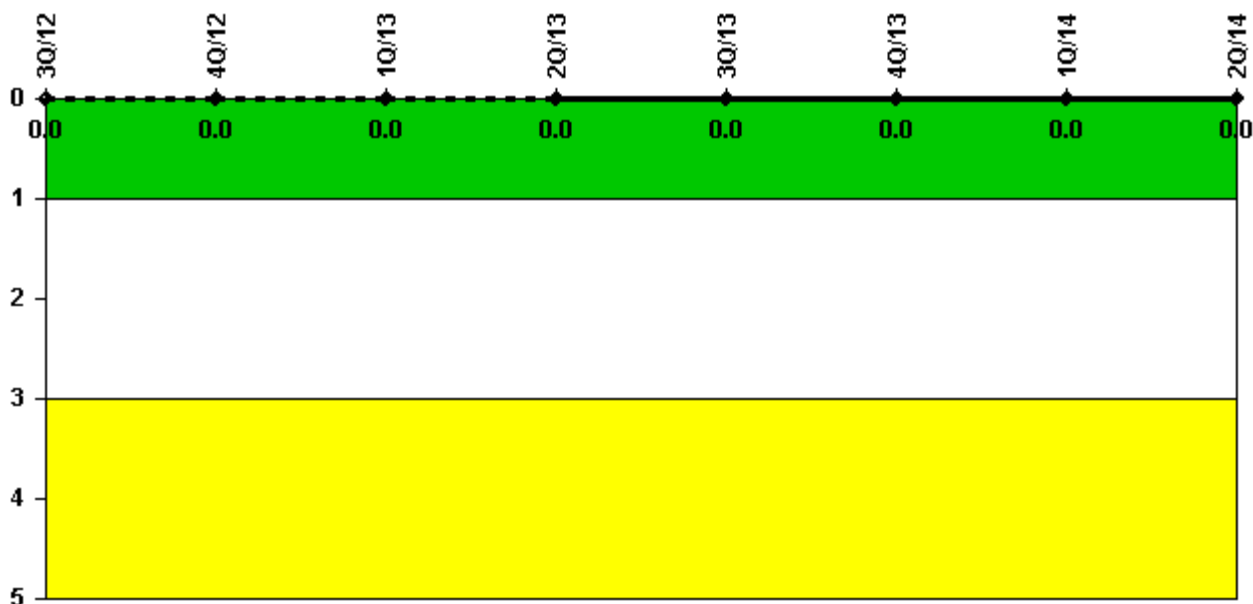

Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.



 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

*Last Modified: July 31, 2014*