


# La Salle 1

## 2Q/2014 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

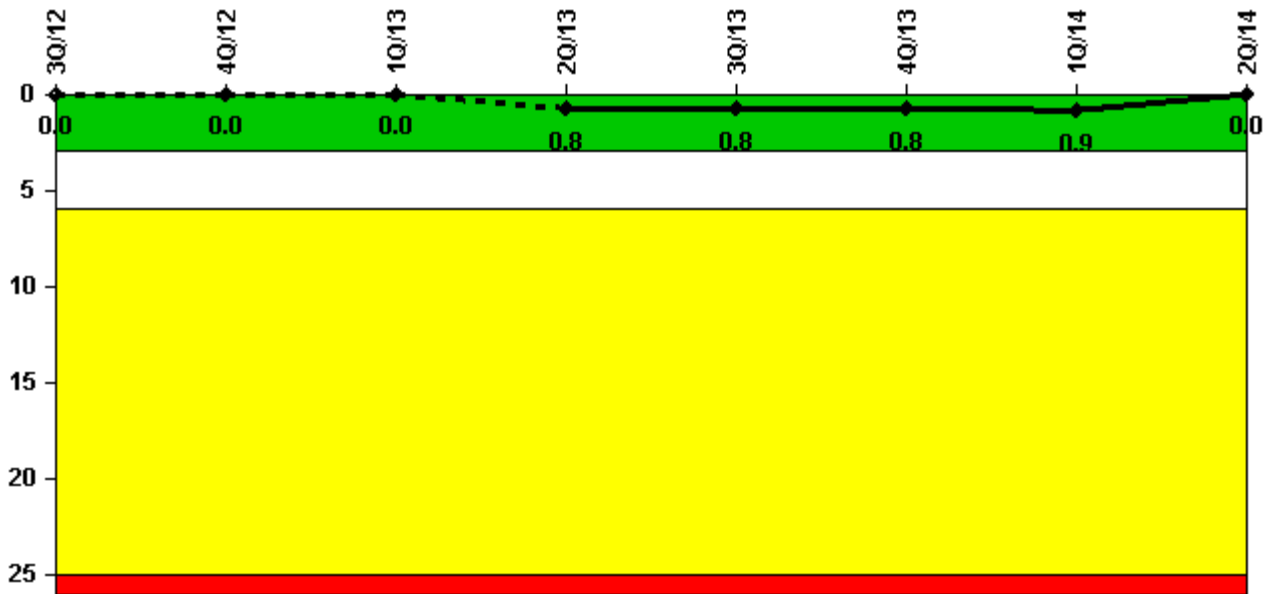

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


### Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Unplanned scrams	0	0	0	1.0	0	0	0	0
Critical hours	2208.0	2209.0	2159.0	1954.2	2208.0	2209.0	1754.0	2184.0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0.8</b>	<b>0.8</b>	<b>0.8</b>	<b>0.9</b>	<b>0</b>

Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.

### Unplanned Power Changes per 7000 Critical Hrs

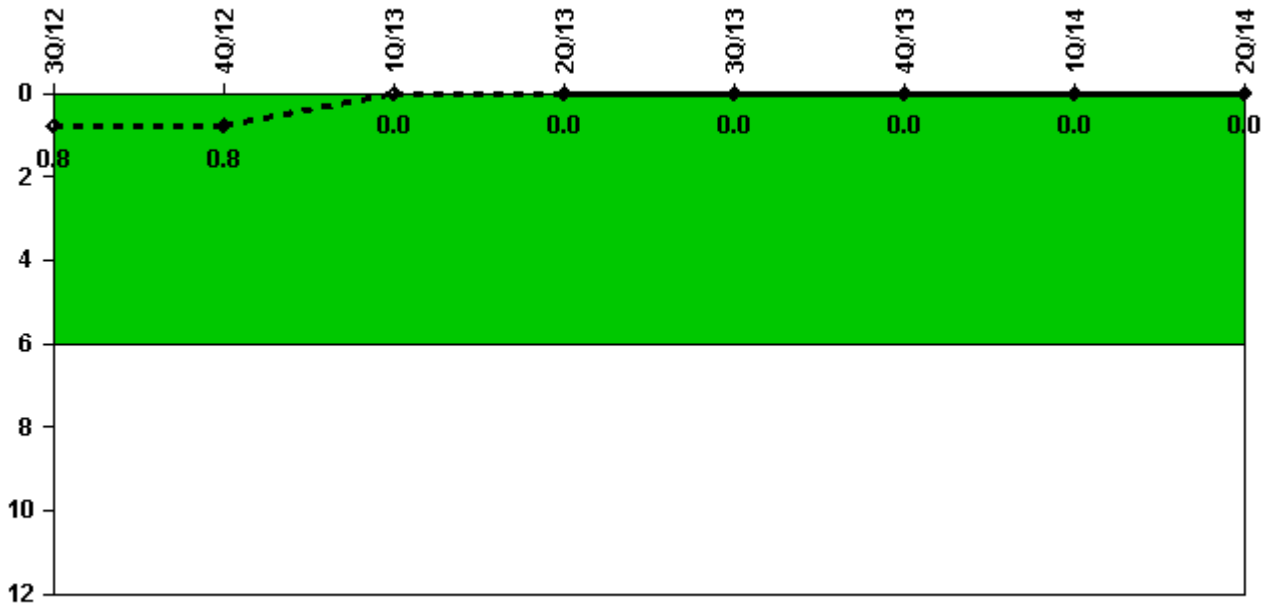

Thresholds: White > 6.0


#### Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2208.0	2209.0	2159.0	1954.2	2208.0	2209.0	1754.0	2184.0
<b>Indicator value</b>	<b>0.8</b>	<b>0.8</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.

### Unplanned Scrams with Complications

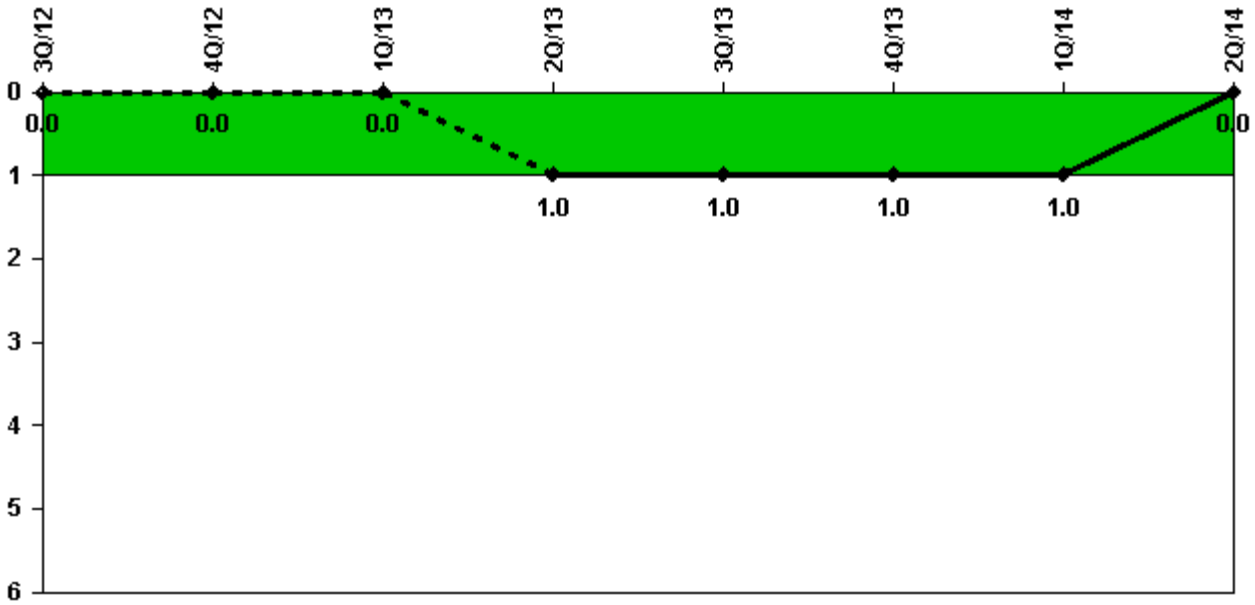


Thresholds: White > 1.0

#### Notes

Unplanned Scrams with Complications	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Scrams with complications	0	0	0	1.0	0	0	0	0
Indicator value	0.0	0.0	0.0	1.0	1.0	1.0	1.0	0.0

Licensee Comments: none

### Safety System Functional Failures (BWR)

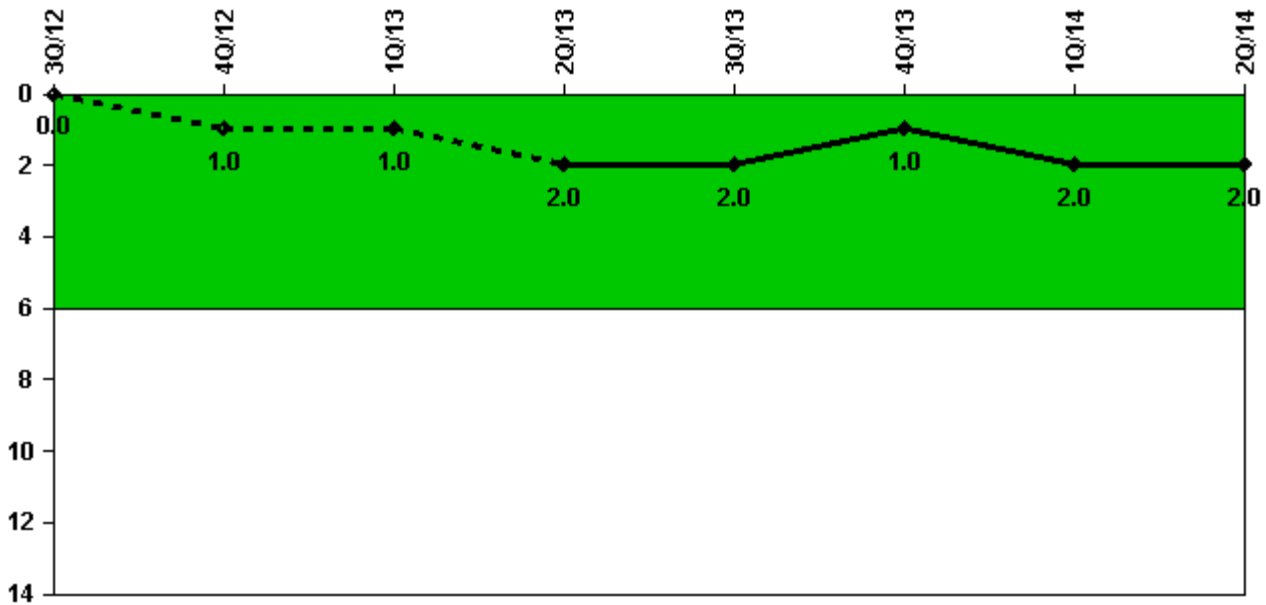

Thresholds: White > 6.0

#### Notes

Safety System Functional Failures (BWR)	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Safety System Functional Failures	0	1	0	1	0	0	1	1
<b>Indicator value</b>	<b>0</b>	<b>1</b>	<b>1</b>	<b>2</b>	<b>2</b>	<b>1</b>	<b>2</b>	<b>2</b>

Licensee Comments:

2Q/14: LER 373-2014-002-00.

1Q/14: LER 373-2013-008-00. Also, Unit 1 Safety System Functional Failures for April 2013 were changed from 1 to 0, as an engineering evaluation determined that the secondary containment inoperability did not result in a loss of safety function as defined by NEI 99-02. See LER 373-2013-001-02. Unit 1 Safety System Functional Failures for June 2013 were changed from 2 to 1, as further review determined that the April LOOP event was not reportable under 10 CFR 50.73(a)(2)(v)(D). See LER 373-2013-002-02. Unit 1 Safety System Functional Failures for December 2013 were changed from 1 to 0, as an engineering evaluation determined that the secondary containment inoperability did not result in a loss of safety function as defined by NEI 99-02. See LER 373-2013-007-01.

4Q/13: LER 373-2013-007


4Q/13: LER 373-2013-007-00

2Q/13: LERs 373-2013-001-00, 373-2013-002-00, and 373-2013-003-00.

2Q/13: LERs 373-2013-001, 373-2013-002, and 373-2013-003

4Q/12: LER 373-2012-001-00

### Mitigating Systems Performance Index, Emergency AC Power System

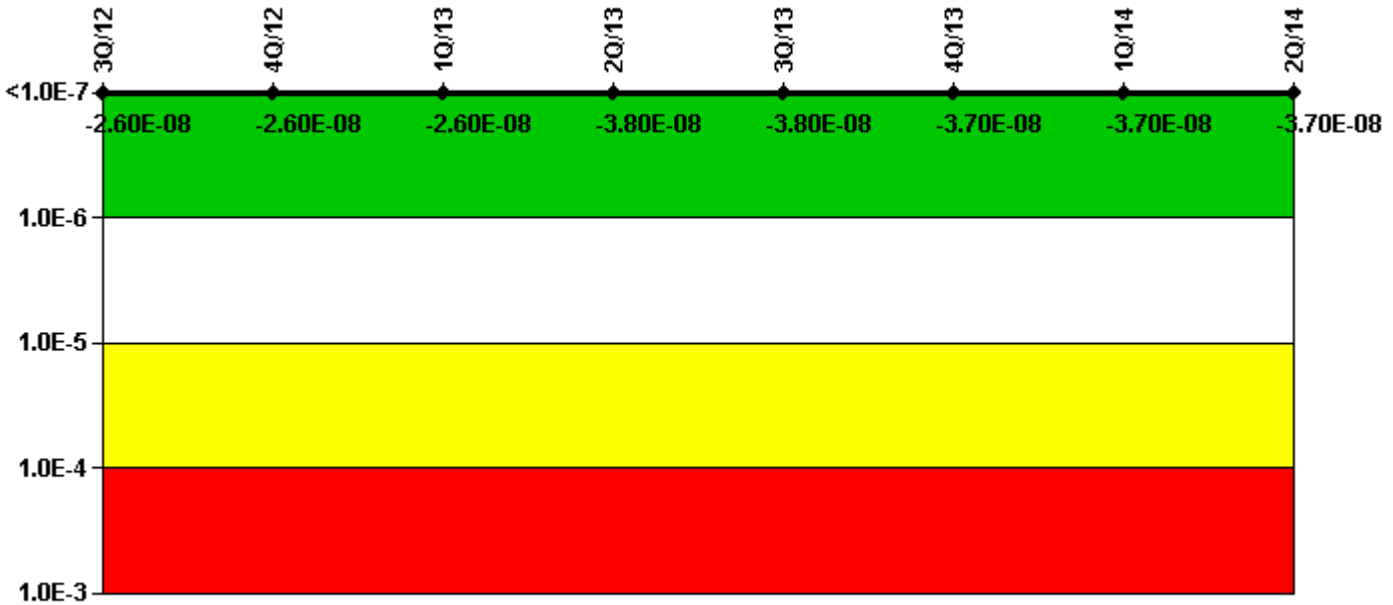

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes


Mitigating Systems Performance Index, Emergency AC Power System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI ( $\Delta$ CDF)	-4.09E-09	-4.09E-09	-4.09E-09	-6.29E-09	-6.29E-09	-6.29E-09	-6.29E-09	-6.29E-09
URI ( $\Delta$ CDF)	-2.22E-08	-2.20E-08	-2.18E-08	-3.17E-08	-3.15E-08	-3.12E-08	-3.09E-08	-3.06E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.60E-08	-2.60E-08	-2.60E-08	-3.80E-08	-3.80E-08	-3.70E-08	-3.70E-08	-3.70E-08

#### Licensee Comments:

3Q/13: Changed PRA Parameter(s). A new PRA model (2011A) was approved the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model and implemented for the 2nd Quarter of 2013.

2Q/13: Changed PRA Parameter(s). A new PRA model (2011A) was approved and implemented in the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model, effective for the 2nd Quarter of 2013.

### Mitigating Systems Performance Index, High Pressure Injection System

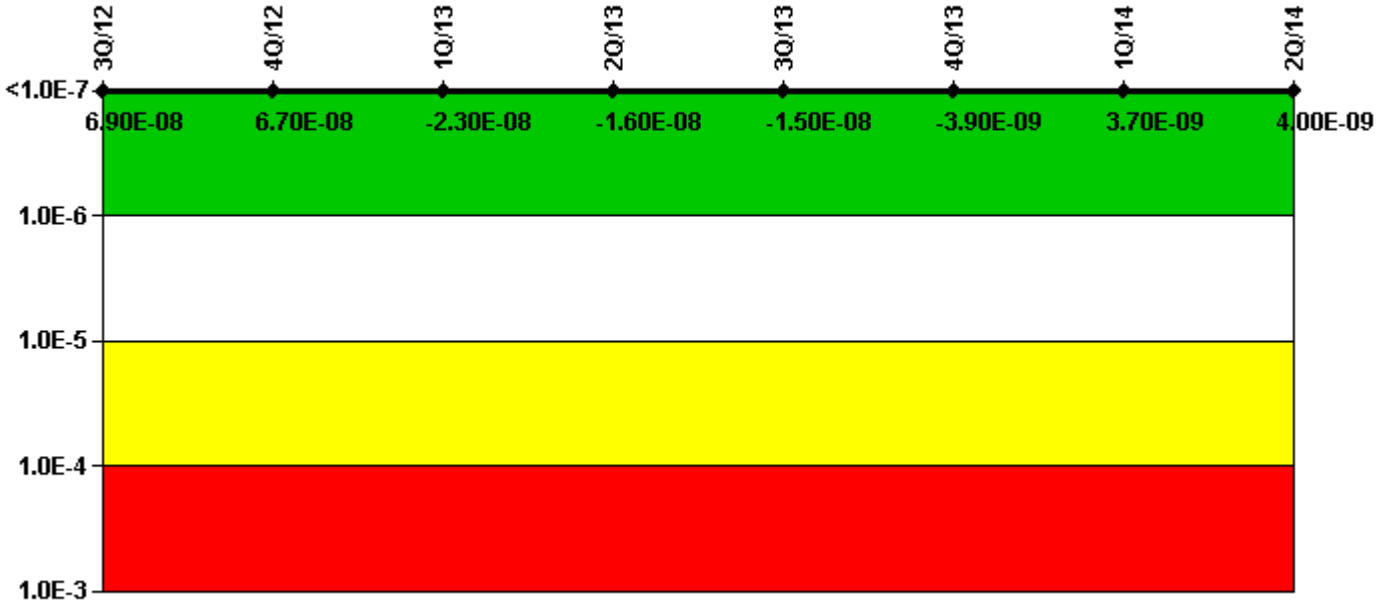

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI ( $\Delta$ CDF)	3.16E-09	1.95E-10	-2.20E-09	-1.43E-09	-2.71E-10	1.01E-08	1.75E-08	1.75E-08
URI ( $\Delta$ CDF)	6.54E-08	6.64E-08	-2.10E-08	-1.45E-08	-1.42E-08	-1.40E-08	-1.37E-08	-1.35E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	<b>6.90E-08</b>	<b>6.70E-08</b>	<b>-2.30E-08</b>	<b>-1.60E-08</b>	<b>-1.50E-08</b>	<b>-3.90E-09</b>	<b>3.70E-09</b>	<b>4.00E-09</b>

#### Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.


3Q/13: A new PRA model (2011A) was approved the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model and implemented for the 2nd Quarter of 2013.

3Q/13: Changed PRA Parameter(s). A new PRA model (2011A) was approved the 1st Quarter of 2013. PRA

coefficients were updated in CDE to reflect the new model and implemented for the 2nd Quarter of 2013.

2Q/13: Changed PRA Parameter(s). A new PRA model (2011A) was approved and implemented in the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model, effective for the 2nd Quarter of 2013.

### Mitigating Systems Performance Index, Heat Removal System

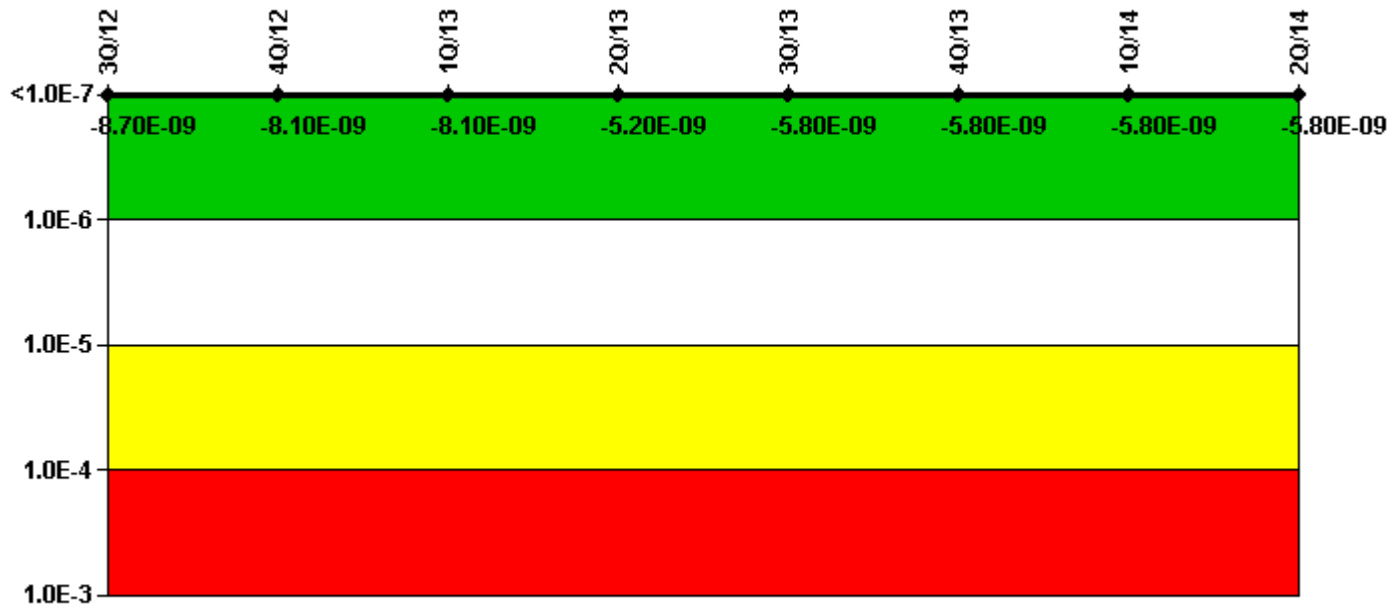

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

### Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI (ΔCDF)	-1.89E-09	-1.29E-09	-1.33E-09	-5.65E-10	-1.16E-09	-1.16E-09	-1.15E-09	-1.15E-09
URI (ΔCDF)	-6.79E-09	-6.79E-09	-6.79E-09	-4.66E-09	-4.66E-09	-4.66E-09	-4.66E-09	-4.66E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
<b>Indicator value</b>	<b>-8.70E-09</b>	<b>-8.10E-09</b>	<b>-8.10E-09</b>	<b>-5.20E-09</b>	<b>-5.80E-09</b>	<b>-5.80E-09</b>	<b>-5.80E-09</b>	<b>-5.80E-09</b>

Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI

indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.

3Q/13: Changed PRA Parameter(s). A new PRA model (2011A) was approved the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model and implemented for the 2nd Quarter of 2013.

2Q/13: A new PRA model (2011A) was approved and implemented in the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model, effective for the 2nd Quarter of 2013.

2Q/13: Changed PRA Parameter(s). A new PRA model (2011A) was approved and implemented in the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model, effective for the 2nd Quarter of 2013.

### Mitigating Systems Performance Index, Residual Heat Removal System



Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI ( $\Delta$ CDF)	-1.81E-08	-1.17E-08	-1.41E-08	1.13E-09	2.35E-10	-5.60E-09	3.52E-09	4.07E-09
URI ( $\Delta$ CDF)	-8.44E-08	-8.44E-08	-8.44E-08	-4.94E-08	-4.94E-08	-4.94E-08	-4.94E-08	-4.94E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
	-1.00E-	-9.60E-	-9.90E-	-4.80E-	-4.90E-	-5.50E-	-4.60E-	-4.50E-



Indicator value	07	08	08	08	08	08	08	08
-----------------	----	----	----	----	----	----	----	----

Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.


3Q/13: Changed PRA Parameter(s). A new PRA model (2011A) was approved the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model and implemented for the 2nd Quarter of 2013.

3Q/13: A new PRA model (2011A) was approved the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model and implemented for the 2nd Quarter of 2013.

2Q/13: A new PRA model (2011A) was approved and implemented in the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model, effective for the 2nd Quarter of 2013.

2Q/13: Changed PRA Parameter(s). A new PRA model (2011A) was approved and implemented in the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model, effective for the 2nd Quarter of 2013.

**Mitigating Systems Performance Index, Cooling Water Systems**

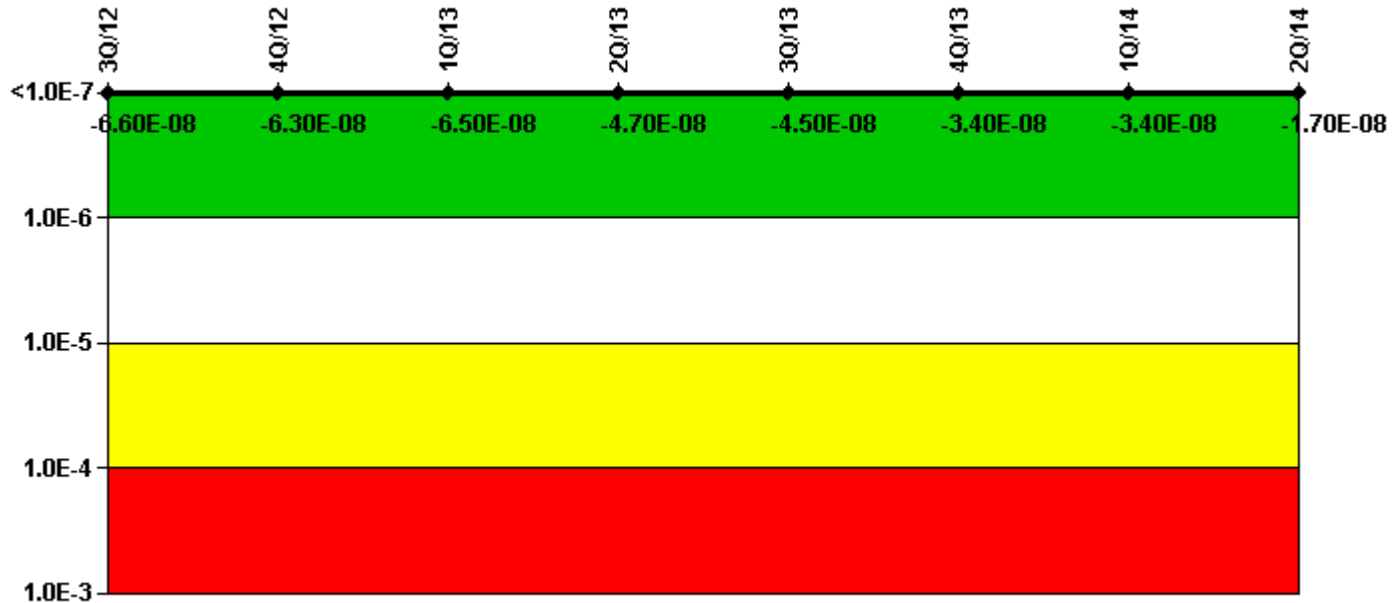

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

**Notes**

<b>Mitigating Systems Performance Index, Cooling Water Systems</b>	<b>3Q/12</b>	<b>4Q/12</b>	<b>1Q/13</b>	<b>2Q/13</b>	<b>3Q/13</b>	<b>4Q/13</b>	<b>1Q/14</b>	<b>2Q/14</b>
UAI ( $\Delta$ CDF)	3.84E-08	4.13E-08	3.99E-08	1.62E-08	1.80E-08	2.89E-08	2.95E-08	4.62E-08
URI ( $\Delta$ CDF)	-1.05E-07	-1.05E-07	-1.05E-07	-6.33E-08	-6.33E-08	-6.33E-08	-6.33E-08	-6.33E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
<b>Indicator value</b>	<b>-6.60E-08</b>	<b>-6.30E-08</b>	<b>-6.50E-08</b>	<b>-4.70E-08</b>	<b>-4.50E-08</b>	<b>-3.40E-08</b>	<b>-3.40E-08</b>	<b>-1.70E-08</b>

## Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.


3Q/13: Changed PRA Parameter(s). A new PRA model (2011A) was approved the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model and implemented for the 2nd Quarter of 2013.

3Q/13: A new PRA model (2011A) was approved the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model and implemented for the 2nd Quarter of 2013.

2Q/13: A new PRA model (2011A) was approved and implemented in the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model, effective for the 2nd Quarter of 2013.

2Q/13: Changed PRA Parameter(s). A new PRA model (2011A) was approved and implemented in the 1st Quarter of 2013. PRA coefficients were updated in CDE to reflect the new model, effective for the 2nd Quarter of 2013.

### Reactor Coolant System Activity

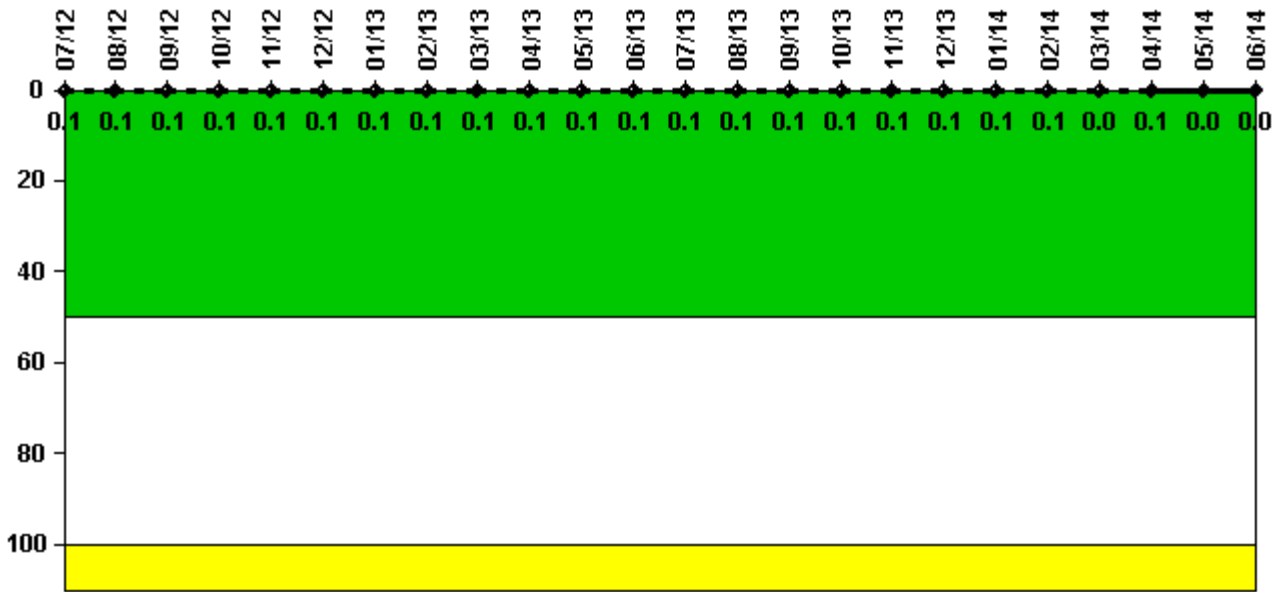


Thresholds: White > 50.0 Yellow > 100.0

### Notes

Reactor Coolant System Activity	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13
Maximum activity	0.000110	0.000101	0.000118	0.000162	0.000121	0.000136	0.000134	0.000134	0.000157	0.000159	0.000149	0.000178
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Reactor Coolant System Activity	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum activity	0.000215	0.000282	0.000183	0.000170	0.000167	0.000212	0.000151	0.000132	0.000059	0.000122	0.000078	0.000093
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0	0.1	0	0

Licensee Comments: none

### Reactor Coolant System Leakage

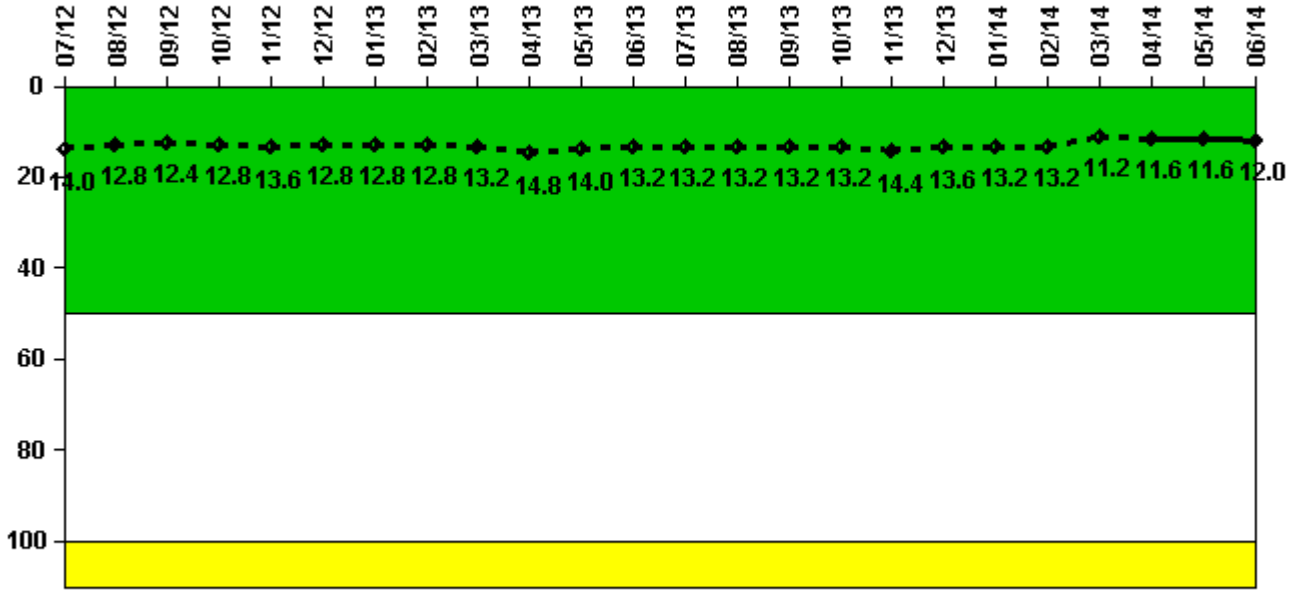

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Leakage	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13
Maximum leakage	3.500	3.200	3.100	3.200	3.400	3.200	3.200	3.200	3.300	3.700	3.500	3.300
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	14.0	12.8	12.4	12.8	13.6	12.8	12.8	12.8	13.2	14.8	14.0	13.2

Reactor Coolant System Leakage	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum leakage	3.300	3.300	3.300	3.300	3.600	3.400	3.300	3.300	2.800	2.900	2.900	3.000
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	13.2	13.2	13.2	13.2	14.4	13.6	13.2	13.2	11.2	11.6	11.6	12.0

Licensee Comments: none

### Drill/Exercise Performance

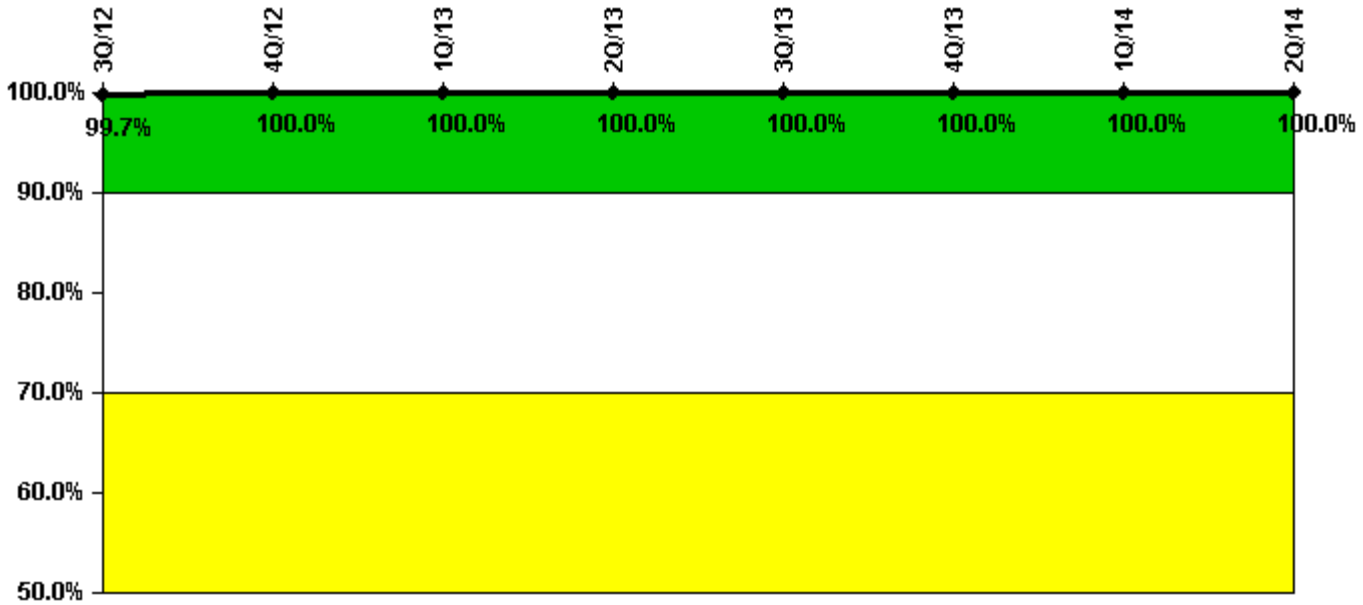

Thresholds: White < 90.0% Yellow < 70.0%


#### Notes

Drill/Exercise Performance	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Successful opportunities	23.0	33.0	10.0	49.0	30.0	34.0	17.0	36.0
Total opportunities	23.0	33.0	10.0	49.0	30.0	34.0	17.0	36.0
Indicator value	99.7%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

#### Licensee Comments:

2Q/14: An internal review identified additional drill/exercise performance opportunities that should have been counted in the 4th quarter 2013. For October 2013 the number of both the total and successful opportunities was increased from 12 to 16. This correction did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.

### ERO Drill Participation

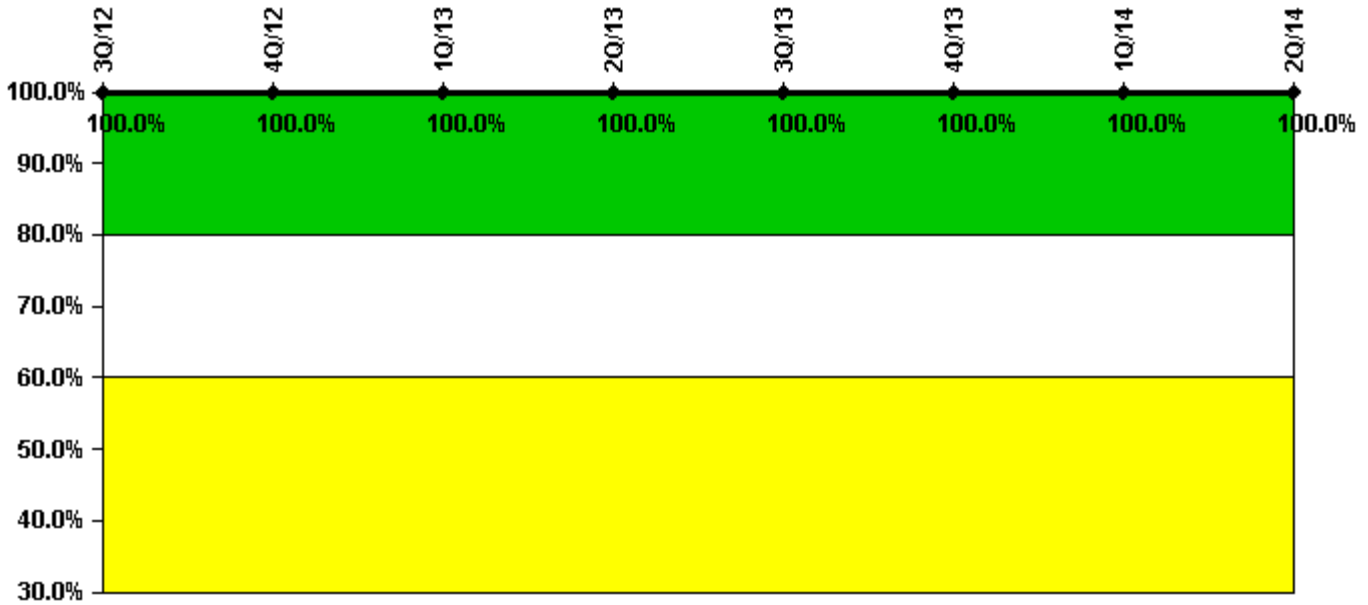


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Participating Key personnel	69.0	71.0	70.0	68.0	68.0	67.0	65.0	63.0
Total Key personnel	69.0	71.0	70.0	68.0	68.0	67.0	65.0	63.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

### Alert & Notification System

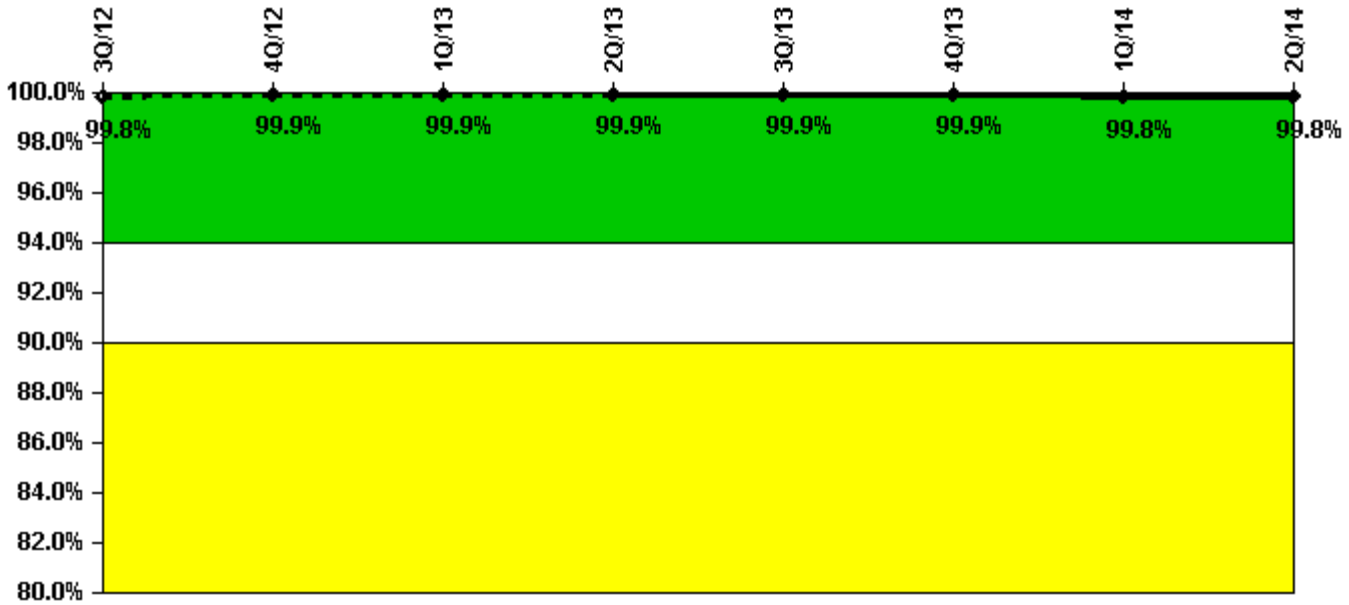


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Successful siren-tests	2137	2175	2175	2170	2176	2175	2131	2171
Total sirens-tests	2142	2176	2176	2176	2176	2176	2142	2176
Indicator value	99.8%	99.9%	99.9%	99.9%	99.9%	99.9%	99.8%	99.8%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

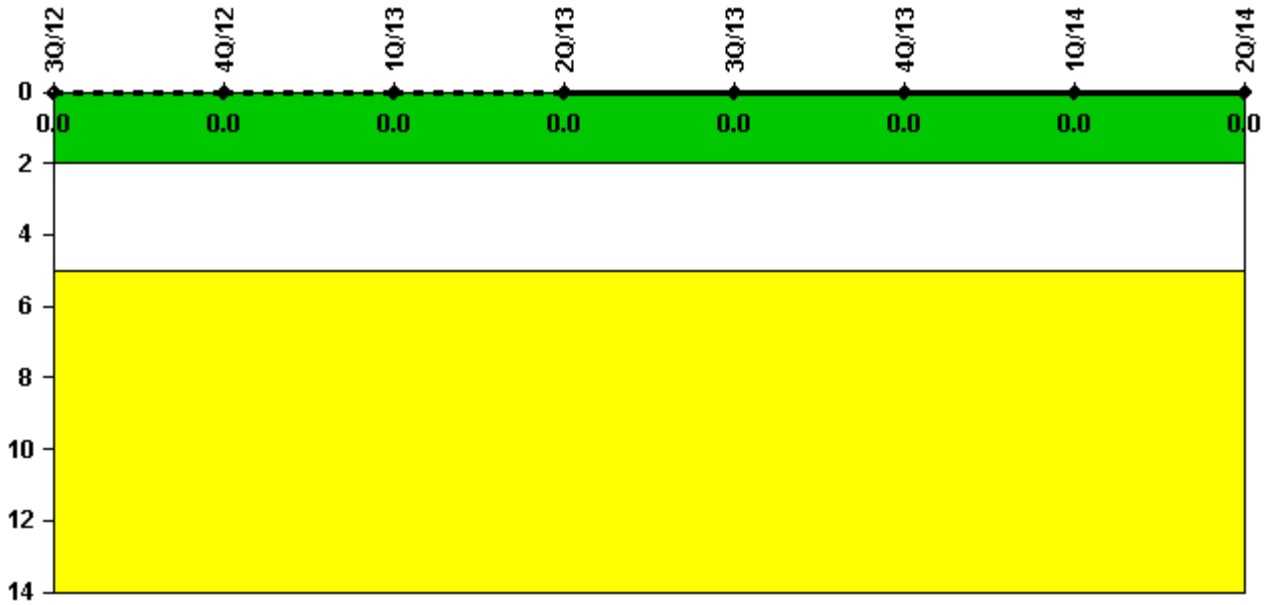

Thresholds: White > 2.0 Yellow > 5.0


#### Notes

Occupational Exposure Control Effectiveness	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none



### RETS/ODCM Radiological Effluent

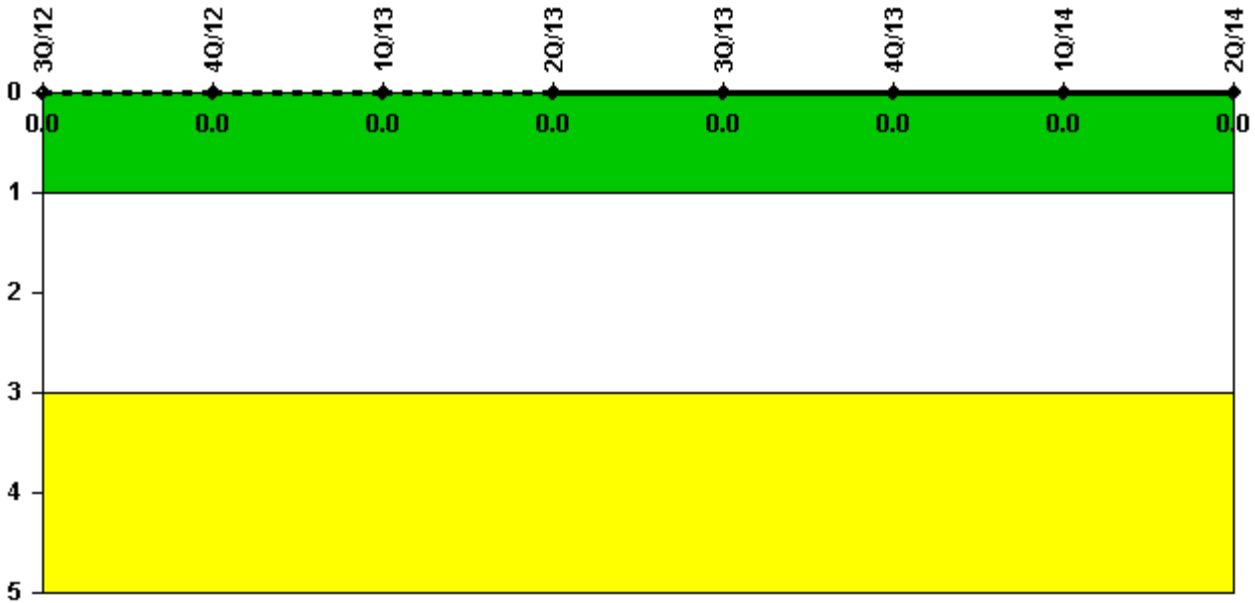

Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

*Last Modified: July 31, 2014*