


Saint Lucie 1

2Q/2014 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

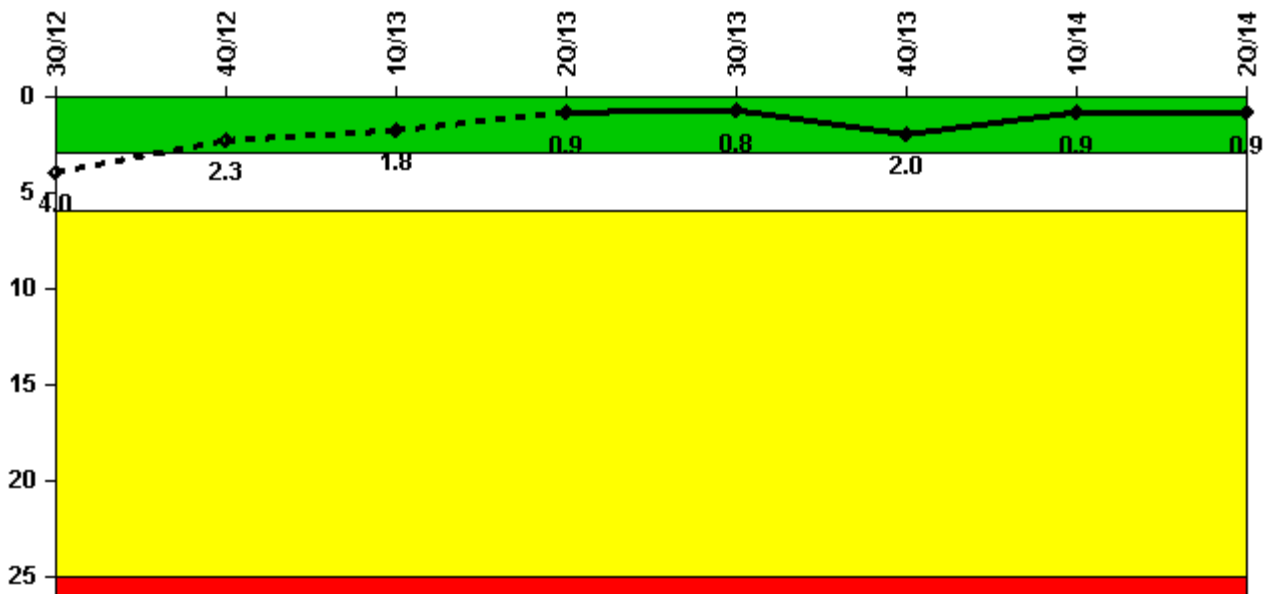


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Unplanned scrams	0	0	1.0	0	0	1.0	0	0
Critical hours	2080.6	2209.0	1698.6	2184.0	2184.0	1103.9	2159.0	2184.0
Indicator value	4.0	2.3	1.8	0.9	0.8	2.0	0.9	0.9

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

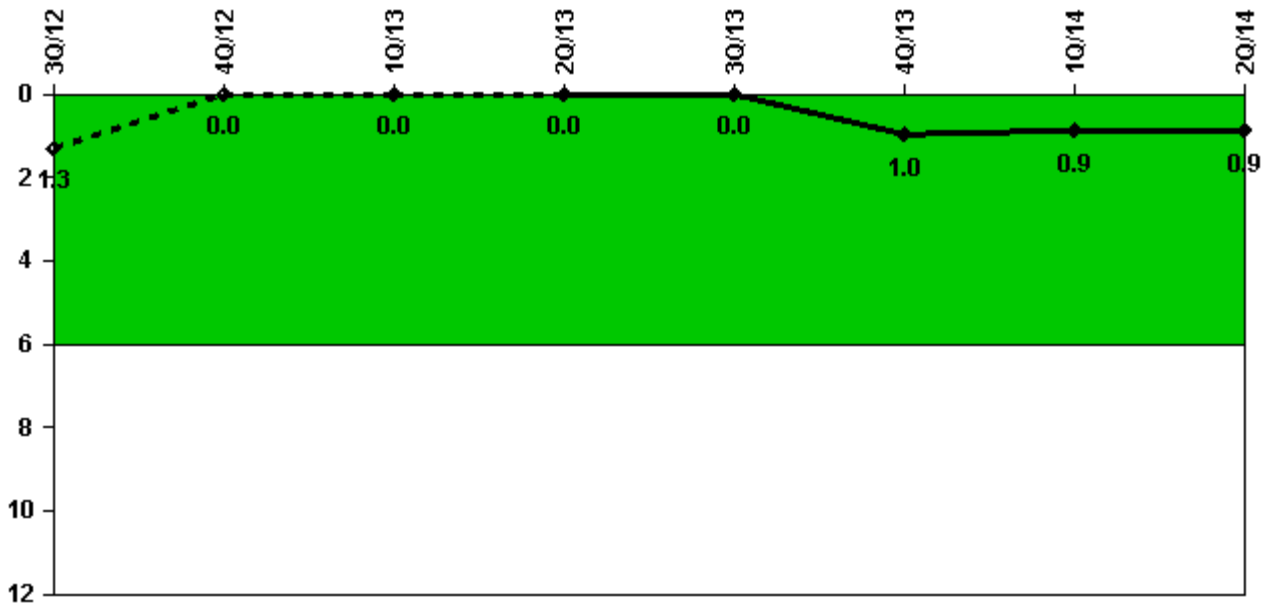

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Unplanned power changes	0	0	0	0	0	1.0	0	0
Critical hours	2080.6	2209.0	1698.6	2184.0	2184.0	1103.9	2159.0	2184.0
Indicator value	1.3	0	0	0	0	1.0	0.9	0.9

Licensee Comments:

1Q/14: Subsequent analysis of the February 2014 1A EDG failure determined that there was no MSPI failure associated with the event. The failure record was corrected to reflect no MSPI failure.

Unplanned Scrams with Complications

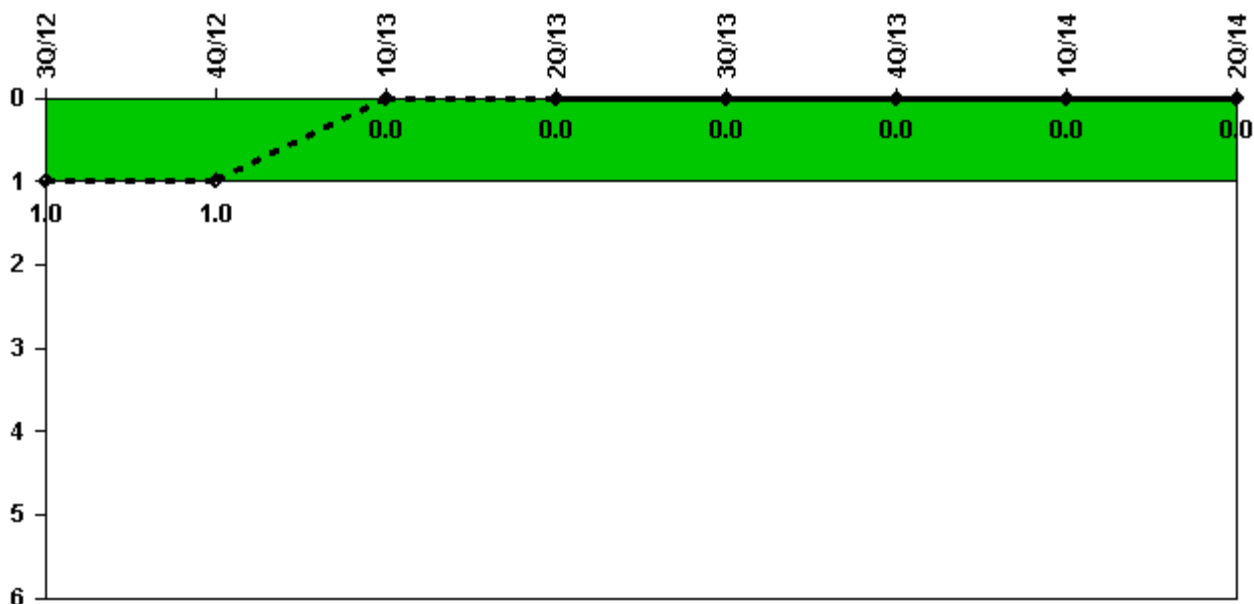


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

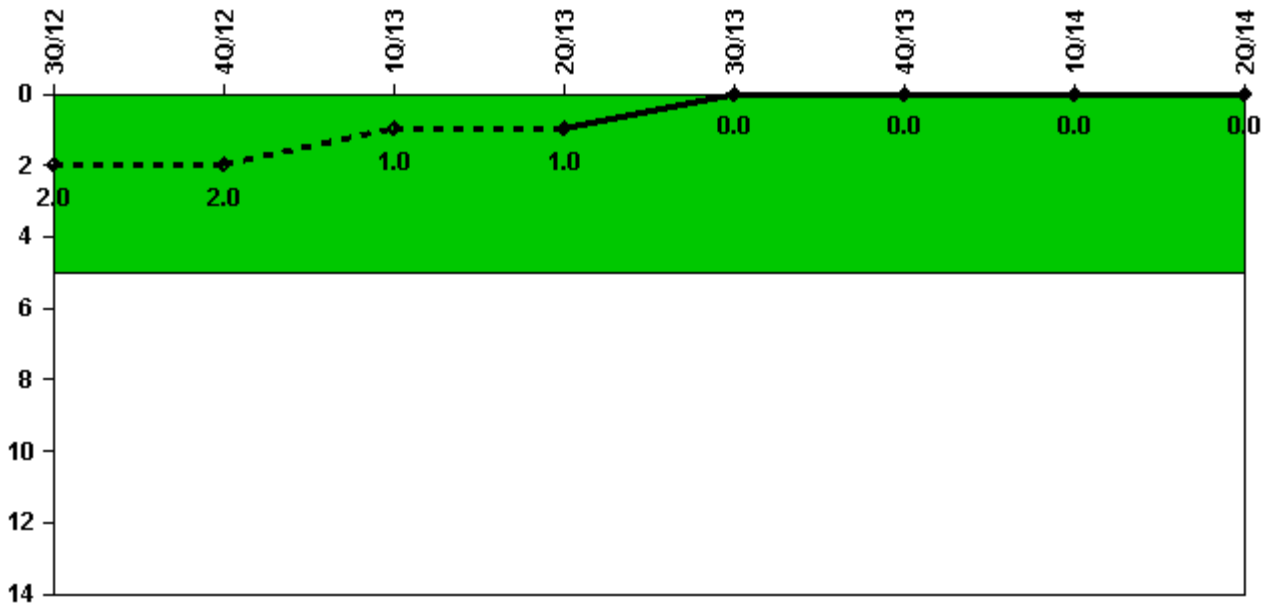

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Safety System Functional Failures	1	0	0	0	0	0	0	0
Indicator value	2	2	1	1	0	0	0	0

Licensee Comments:

3Q/12: August SSFF documented in LER 50-355/2012-007-00

Mitigating Systems Performance Index, Emergency AC Power System

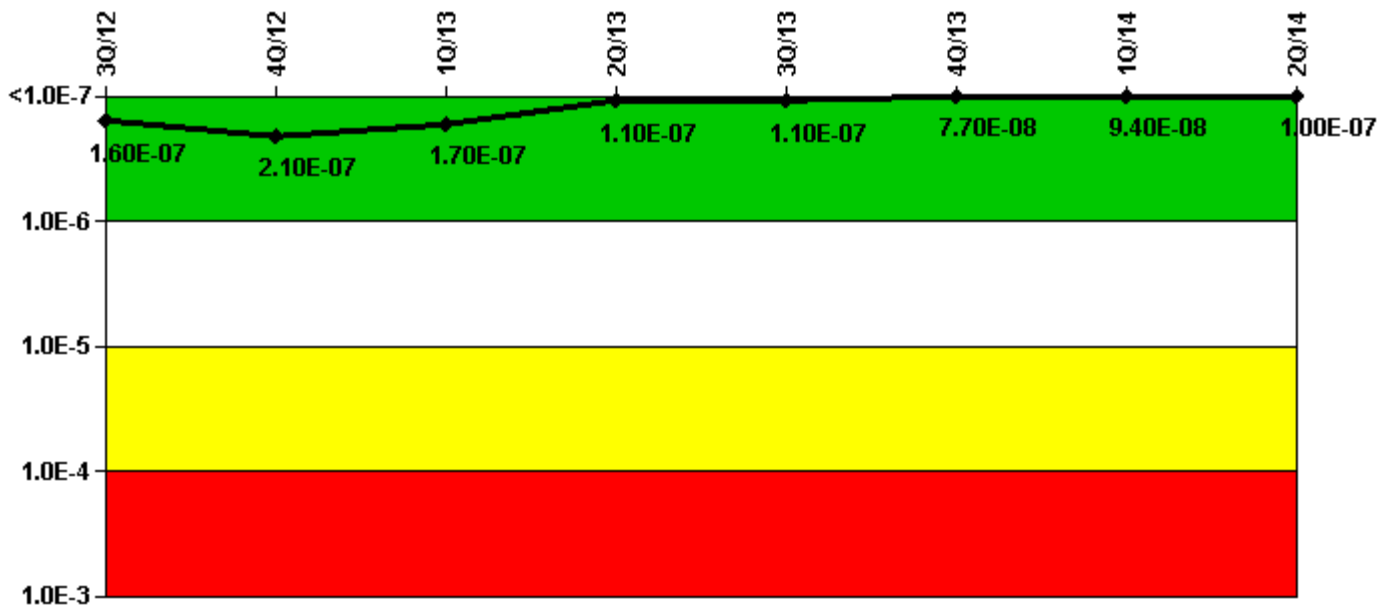

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Emergency AC Power System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI (ΔCDF)	7.22E-08	8.54E-08	8.64E-08	6.20E-08	5.61E-08	2.50E-08	4.20E-08	5.06E-08
URI (ΔCDF)	8.54E-08	1.22E-07	8.62E-08	5.06E-08	5.10E-08	5.15E-08	5.19E-08	5.24E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.60E-07	2.10E-07	1.70E-07	1.10E-07	1.10E-07	7.70E-08	9.40E-08	1.00E-07

Licensee Comments:

4Q/12: October 2012 Failure not originally submitted with 4Q/2012 Data Submittal. The failure record was entered January 2014. Subsequent change files are associated with the new MSPI calculations.

3Q/12: Changed PRA Parameter(s).

Mitigating Systems Performance Index, High Pressure Injection System

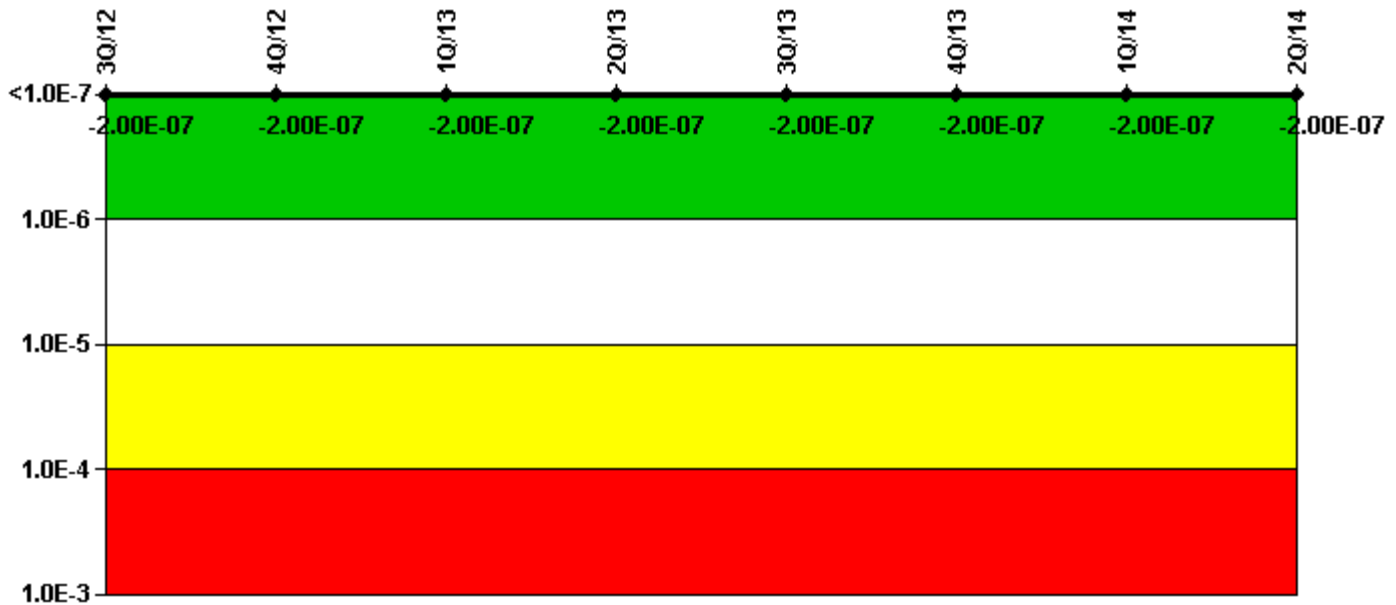

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI (Δ CDF)	-3.36E-08	-3.36E-08	-3.36E-08	-3.36E-08	-3.36E-08	-3.36E-08	-3.36E-08	-3.36E-08
URI (Δ CDF)	-1.63E-07	-1.63E-07	-1.63E-07	-1.63E-07	-1.63E-07	-1.63E-07	-1.63E-07	-1.63E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07

Licensee Comments:

3Q/12: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Heat Removal System

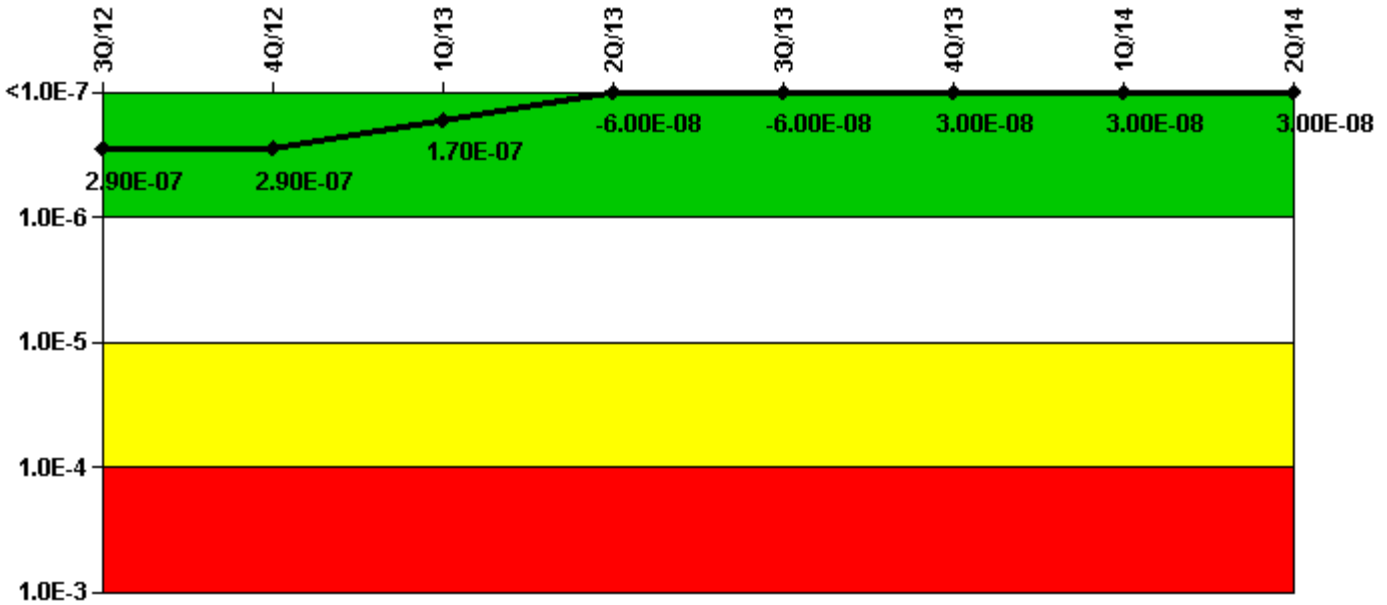

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI (Δ CDF)	1.45E-08	1.45E-08	1.15E-08	-1.31E-08	-1.30E-08	-9.39E-09	-9.39E-09	-9.39E-09
URI (Δ CDF)	2.73E-07	2.73E-07	1.56E-07	-4.67E-08	-4.67E-08	3.92E-08	3.92E-08	3.92E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.90E-07	2.90E-07	1.70E-07	-6.00E-08	-6.00E-08	3.00E-08	3.00E-08	3.00E-08

Licensee Comments:

3Q/12: Changed PRA Parameter(s). Q3 2012, Unit 1 AFW excluded MV-08-13 and MV-08-14 from scope due to low birnbaum, manual recovery action only. Unit 2 AFW excluded MV-09-13 and MV-09-14 from scope

Mitigating Systems Performance Index, Residual Heat Removal System

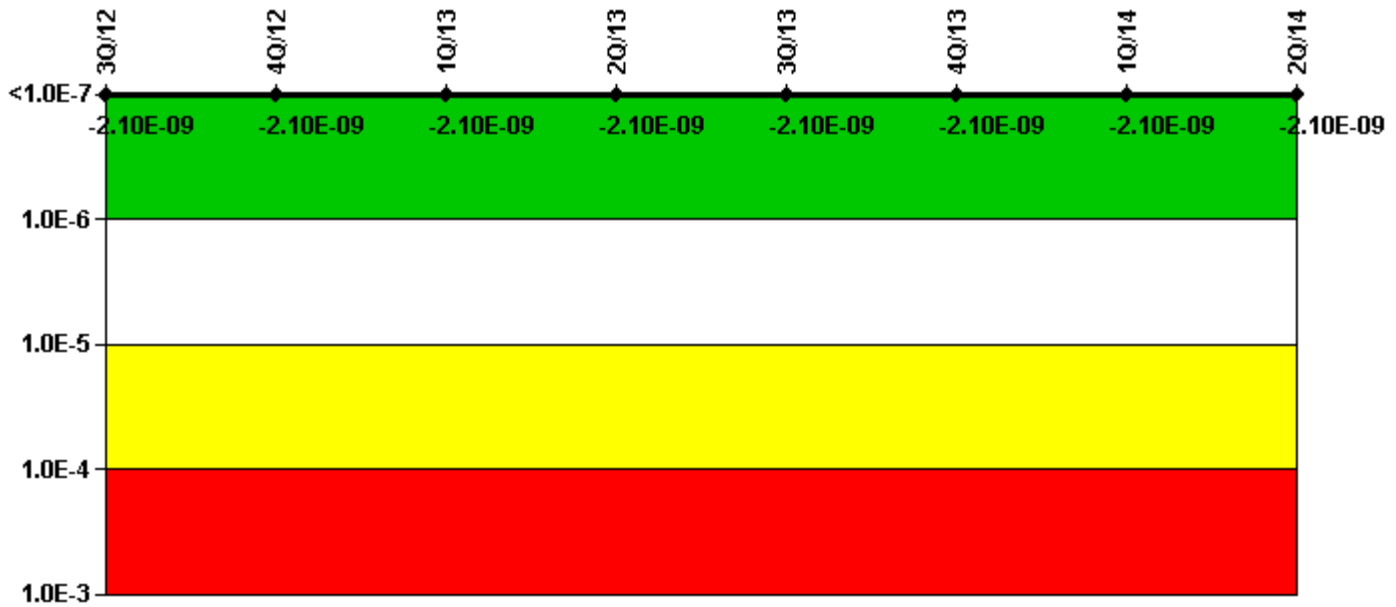

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI (Δ CDF)	-1.41E-10	-1.41E-10	-1.41E-10	-1.41E-10	-1.41E-10	-1.41E-10	-1.41E-10	-1.41E-10
URI (Δ CDF)	-1.96E-09	-1.96E-09	-1.96E-09	-1.96E-09	-1.96E-09	-1.96E-09	-1.96E-09	-1.96E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.10E-09	-2.10E-09	-2.10E-09	-2.10E-09	-2.10E-09	-2.10E-09	-2.10E-09	-2.10E-09

Licensee Comments:

3Q/12: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Cooling Water Systems

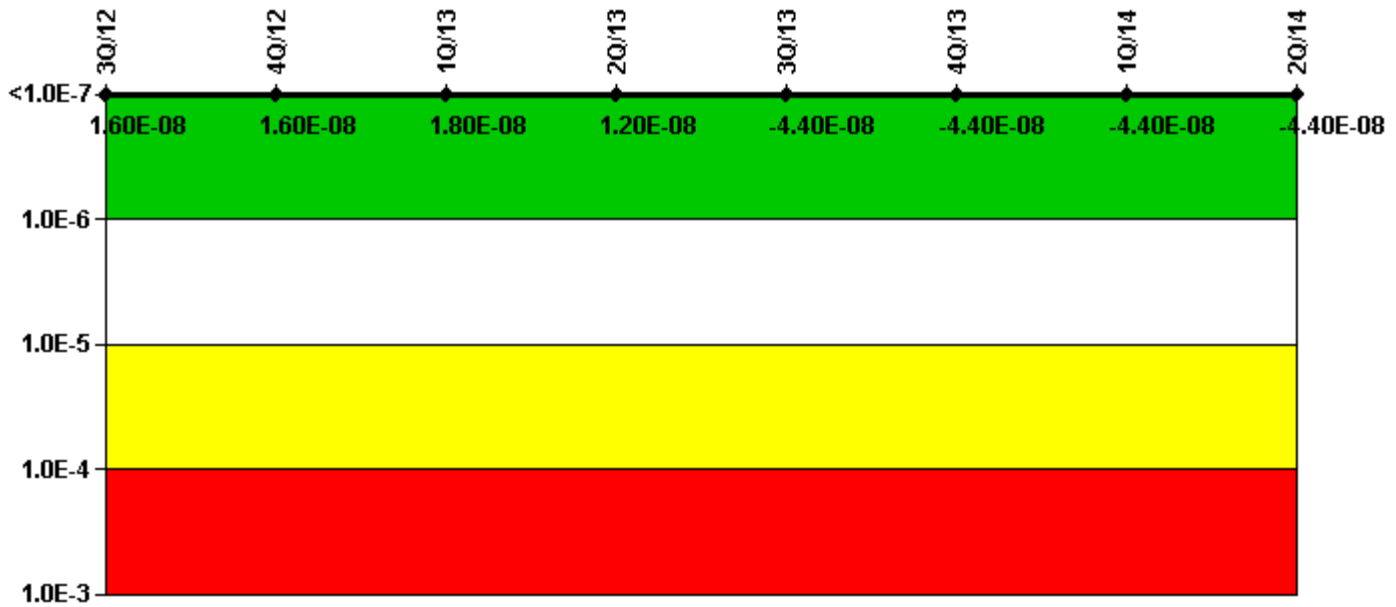

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
UAI (Δ CDF)	2.84E-08	2.85E-08	2.98E-08	2.40E-08	-3.22E-08	-3.22E-08	-3.22E-08	-3.22E-08
URI (Δ CDF)	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.60E-08	1.60E-08	1.80E-08	1.20E-08	-4.40E-08	-4.40E-08	-4.40E-08	-4.40E-08

Licensee Comments:

3Q/12: Changed PRA Parameter(s).

Reactor Coolant System Activity

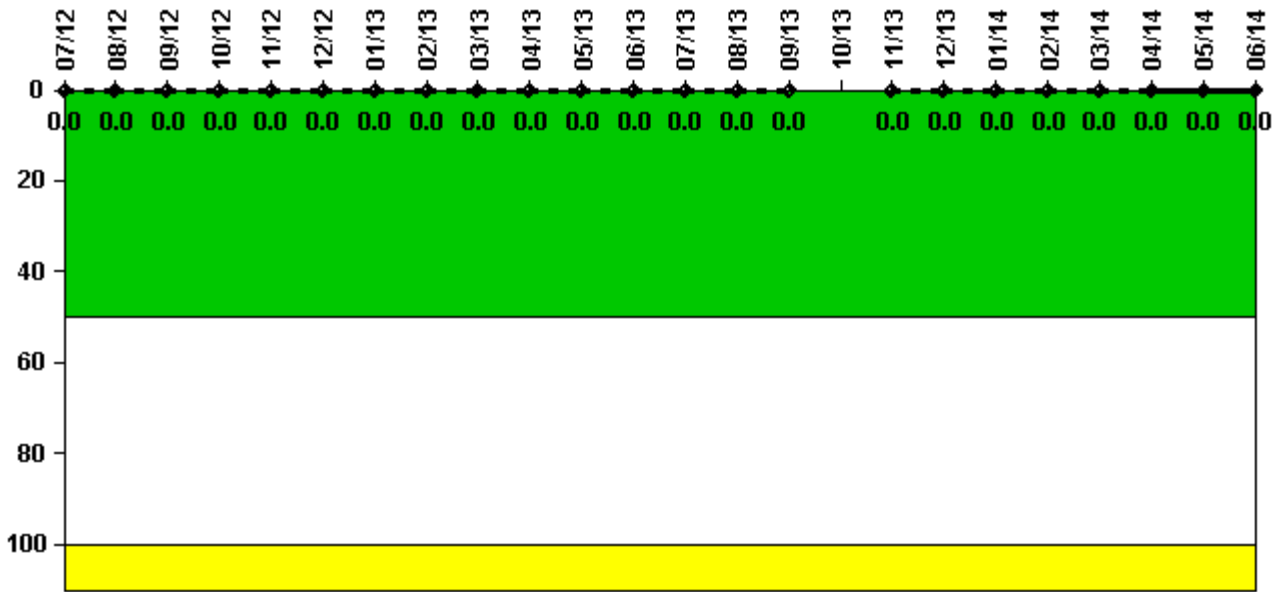


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13
Maximum activity	0.000221	0.000293	0.000323	0.000429	0.000299	0.000304	0.000329	0.000310	0.000324	0.000329	0.000354	0.000325
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum activity	0.000340	0.000391	0.000409	N/A	0.000222	0.000221	0.000241	0.000280	0.000327	0.000335	0.000307	0.000306
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	N/A	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

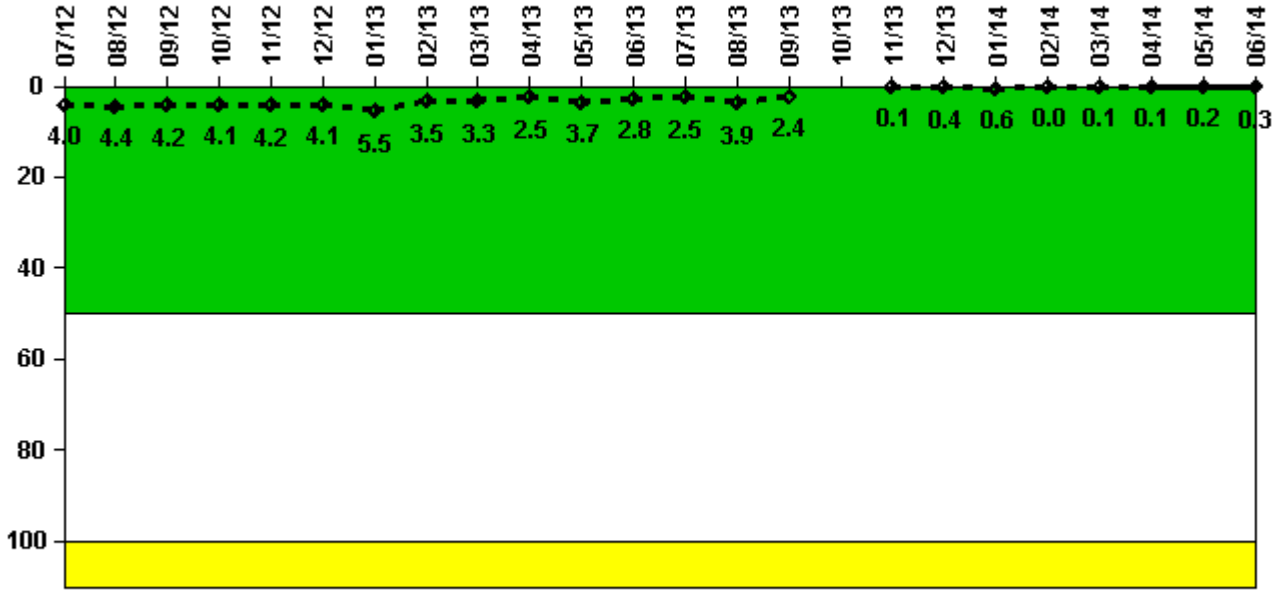


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13
Maximum leakage	0.398	0.443	0.423	0.410	0.420	0.410	0.551	0.346	0.329	0.249	0.374	0.280
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	4.0	4.4	4.2	4.1	4.2	4.1	5.5	3.5	3.3	2.5	3.7	2.8
Reactor Coolant System Leakage	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum leakage	0.249	0.389	0.240	N/A	0.010	0.042	0.063	0.003	0.010	0.011	0.015	0.029
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.5	3.9	2.4	N/A	0.1	0.4	0.6	0	0.1	0.1	0.2	0.3

Licensee Comments: none

Drill/Exercise Performance

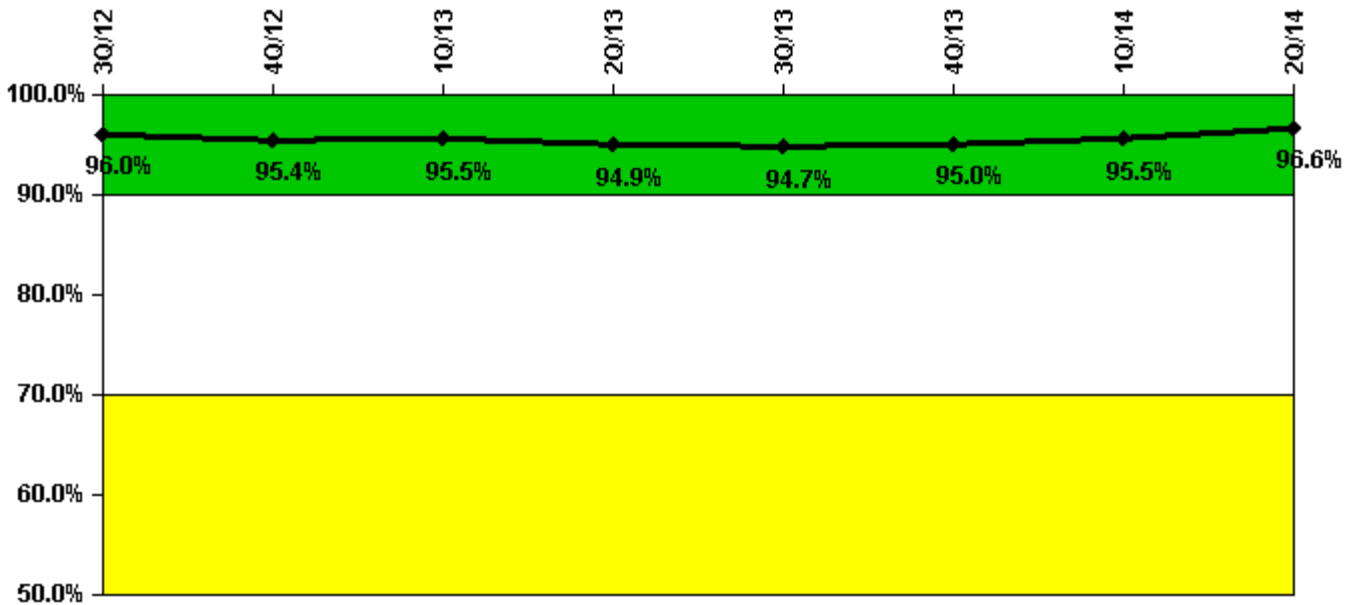

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Successful opportunities	49.0	0	95.0	56.0	79.0	29.0	50.0	43.0
Total opportunities	54.0	0	99.0	58.0	81.0	30.0	50.0	43.0
Indicator value	96.0%	95.4%	95.5%	94.9%	94.7%	95.0%	95.5%	96.6%

Licensee Comments:

2Q/13: Change to June 13 total drill, exercise and event opportunities

ERO Drill Participation

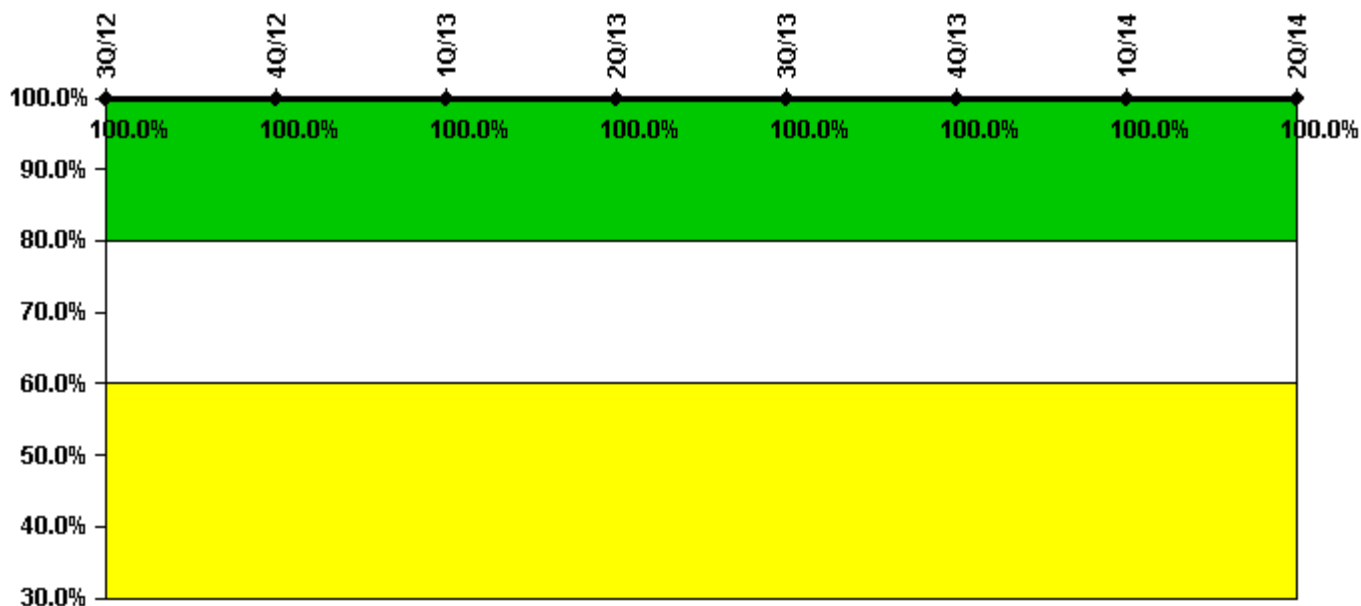


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Participating Key personnel	93.0	93.0	106.0	102.0	109.0	113.0	114.0	107.0
Total Key personnel	93.0	93.0	106.0	102.0	109.0	113.0	114.0	107.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

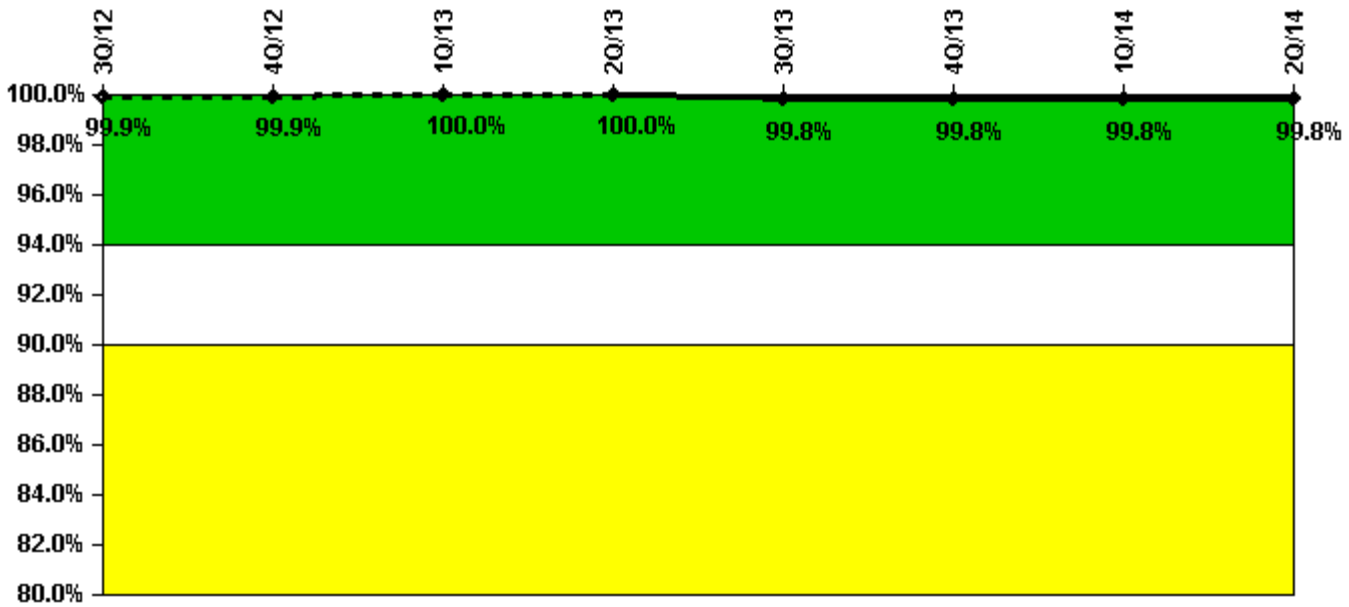


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
Successful siren-tests	630	720	629	720	626	715	719	630
Total sirens-tests	630	720	630	720	630	715	720	630
Indicator value	99.9%	99.9%	100.0%	100.0%	99.8%	99.8%	99.8%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

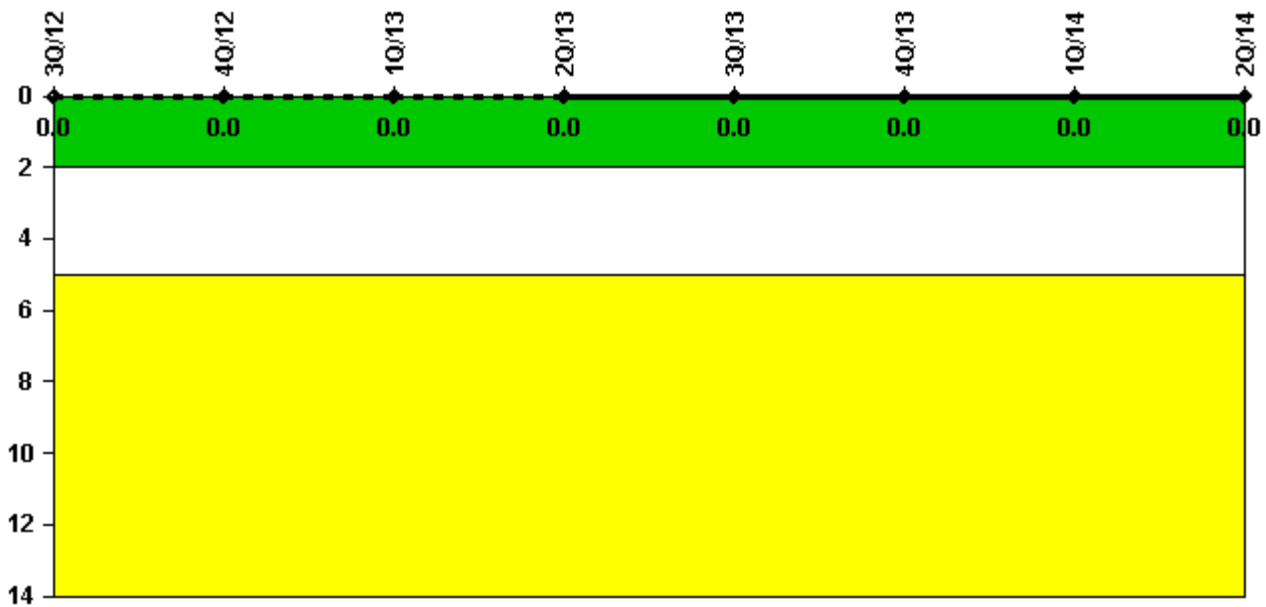


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

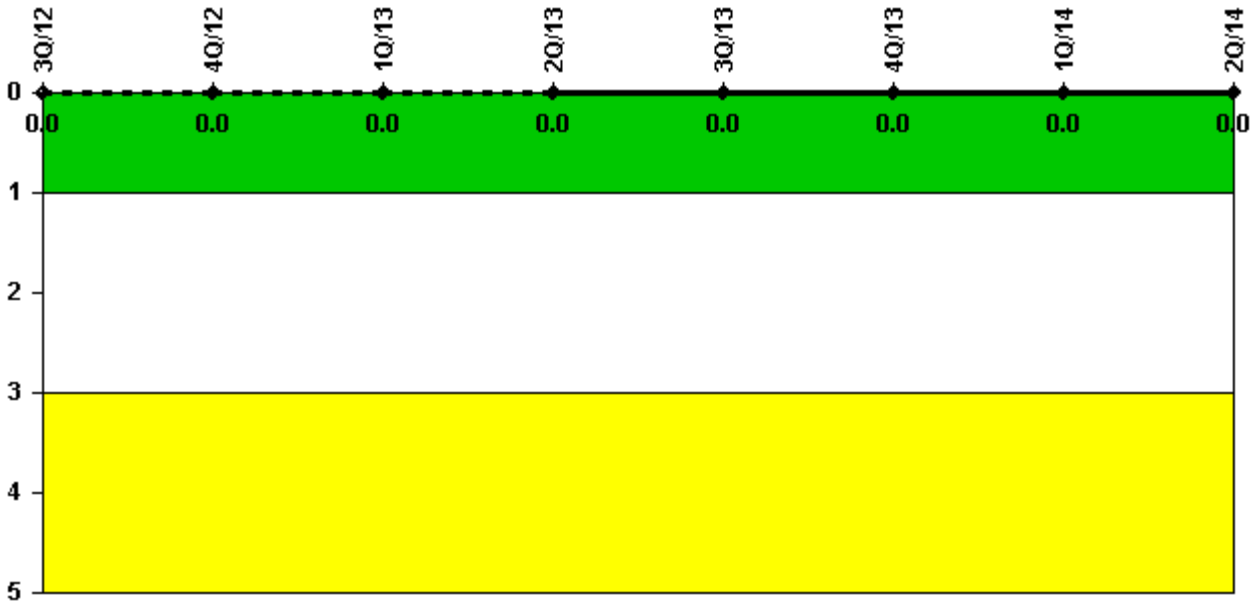

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/12	4Q/12	1Q/13	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: July 31, 2014