


Saint Lucie 1

1Q/2015 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

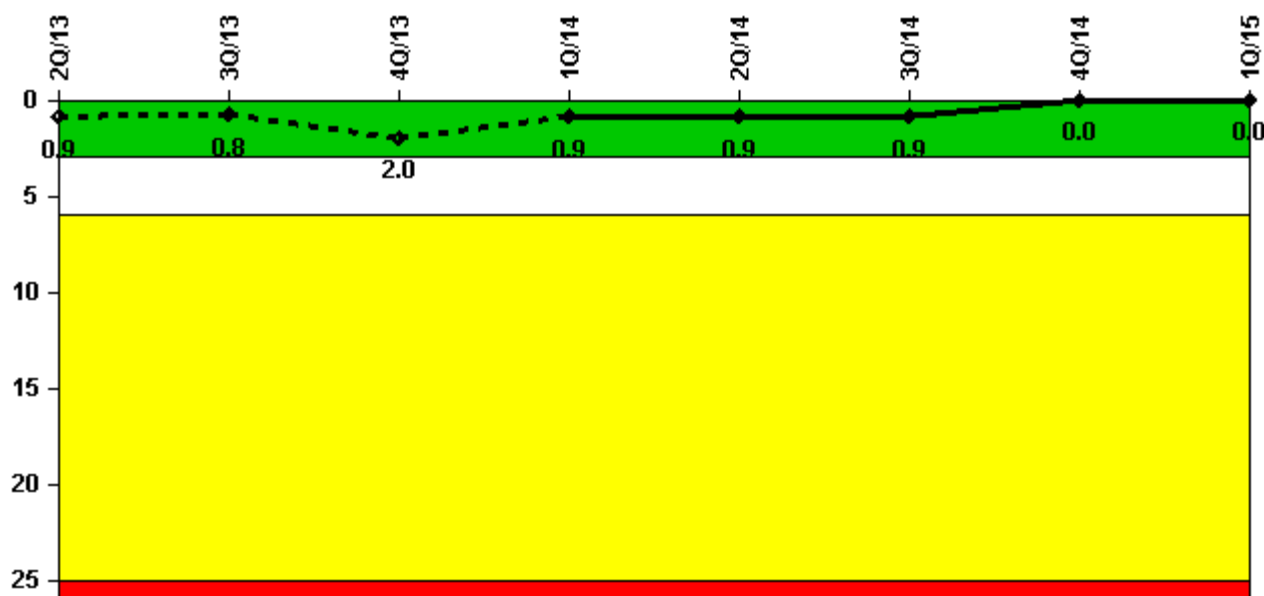


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
Unplanned scrams	0	0	1.0	0	0	0	0	0
Critical hours	2184.0	2184.0	1103.9	2159.0	2184.0	2208.0	2209.0	1943.0
Indicator value	0.9	0.8	2.0	0.9	0.9	0.9	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

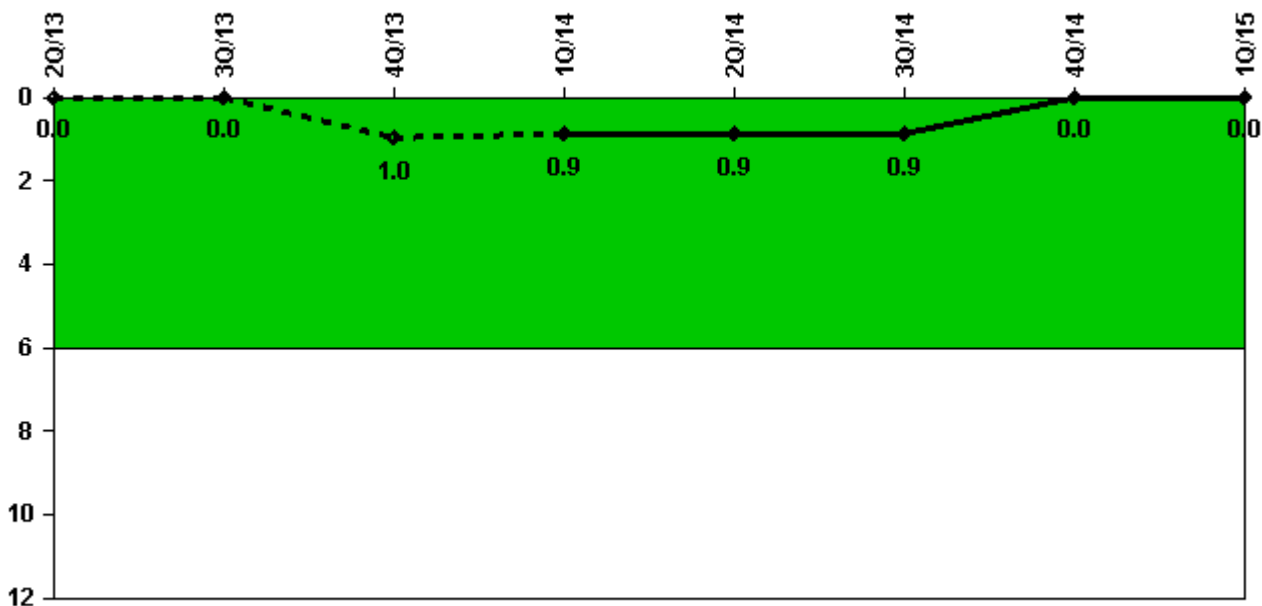

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
Unplanned power changes	0	0	1.0	0	0	0	0	0
Critical hours	2184.0	2184.0	1103.9	2159.0	2184.0	2208.0	2209.0	1943.0
Indicator value	0	0	1.0	0.9	0.9	0.9	0	0

Licensee Comments:

1Q/14: Subsequent analysis of the February 2014 1A EDG failure determined that there was no MSPI failure associated with the event. The failure record was corrected to reflect no MSPI failure.

Unplanned Scrams with Complications

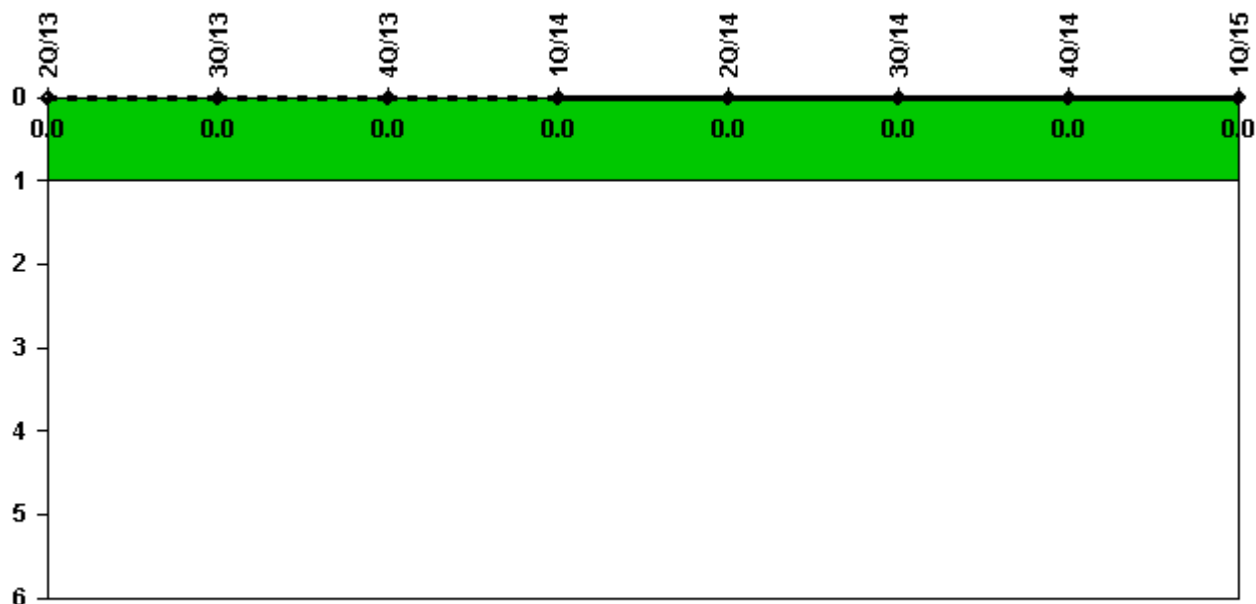


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

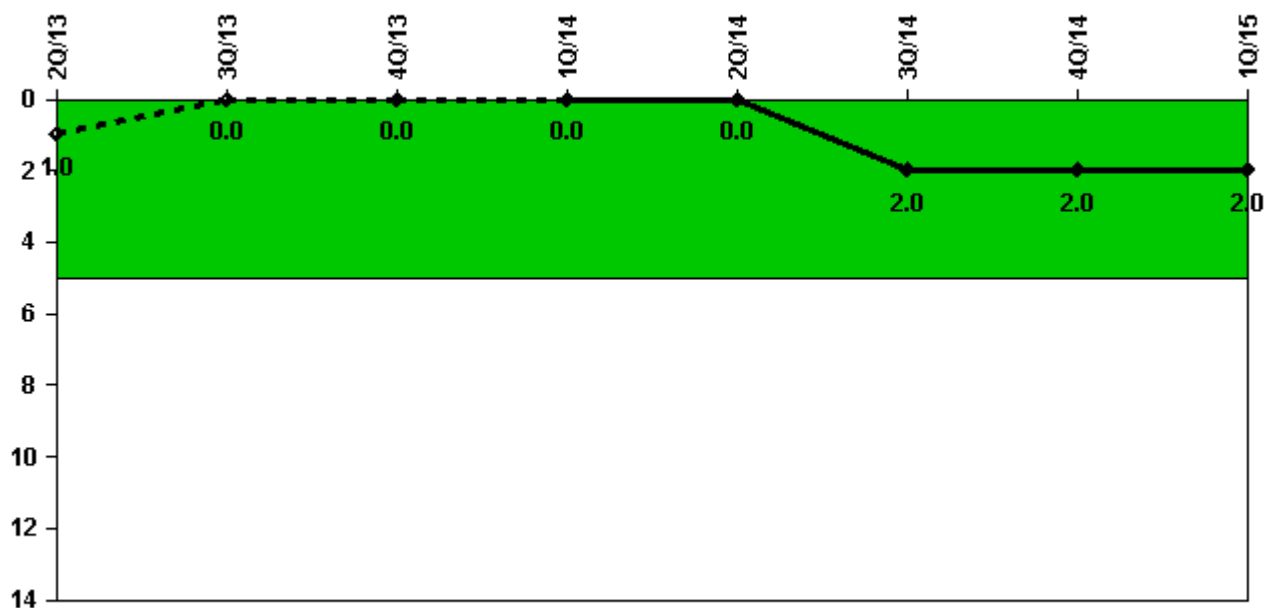

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
Safety System Functional Failures	0	0	0	0	0	2	0	0
Indicator value	1	0	0	0	0	2	2	2

Licensee Comments:

3Q/14: Unit 1 LER 50-335/2014-001-02, Unit 1 and 2 LER 50-335,389/2012-010-02

Mitigating Systems Performance Index, Emergency AC Power System

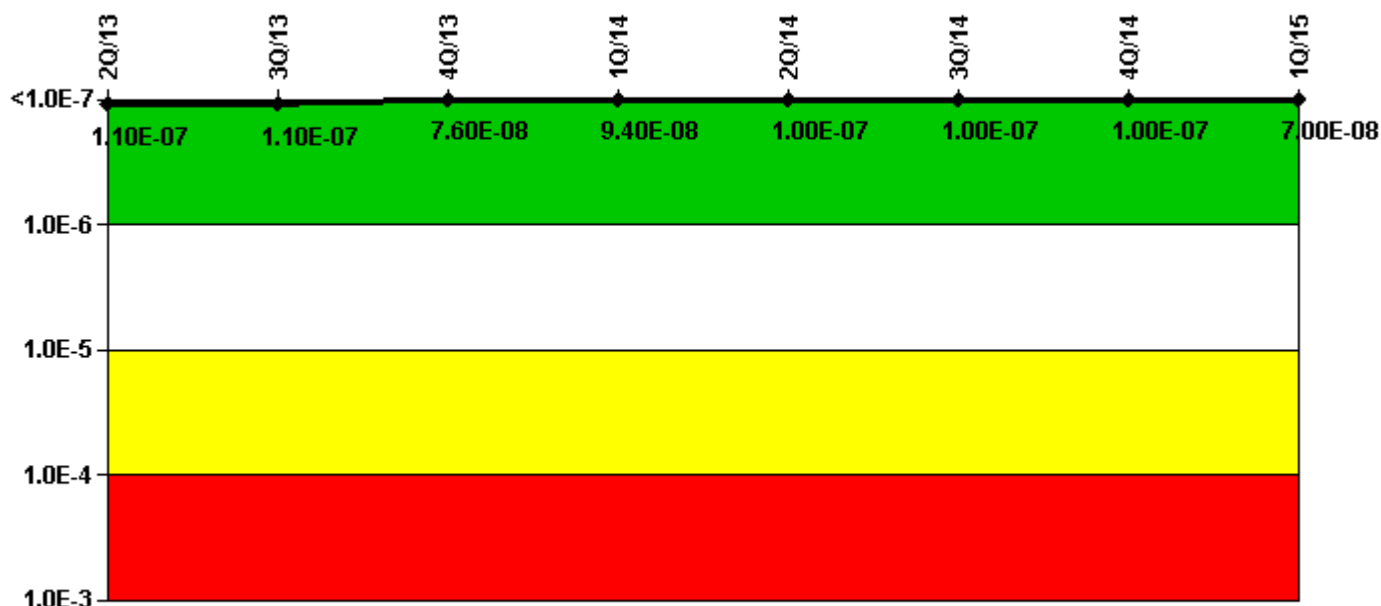

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Emergency AC Power System	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
UAI (Δ CDF)	6.20E-08	5.61E-08	2.50E-08	4.20E-08	5.06E-08	5.02E-08	4.76E-08	5.27E-08
URI (Δ CDF)	5.06E-08	5.10E-08	5.11E-08	5.15E-08	5.20E-08	5.24E-08	5.29E-08	1.70E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.10E-07	1.10E-07	7.60E-08	9.40E-08	1.00E-07	1.00E-07	1.00E-07	7.00E-08

Licensee Comments:

1Q/14: Subsequent analysis of the February 2014 1A EDG failure determined that there was no MSPI failure associated with the event. The failure record was corrected to reflect no MSPI failure.

4Q/13: Additional 1A EDG demand start added during 4Q/2014 submittal causing recalculation for all subsequent quarters.

Mitigating Systems Performance Index, High Pressure Injection System

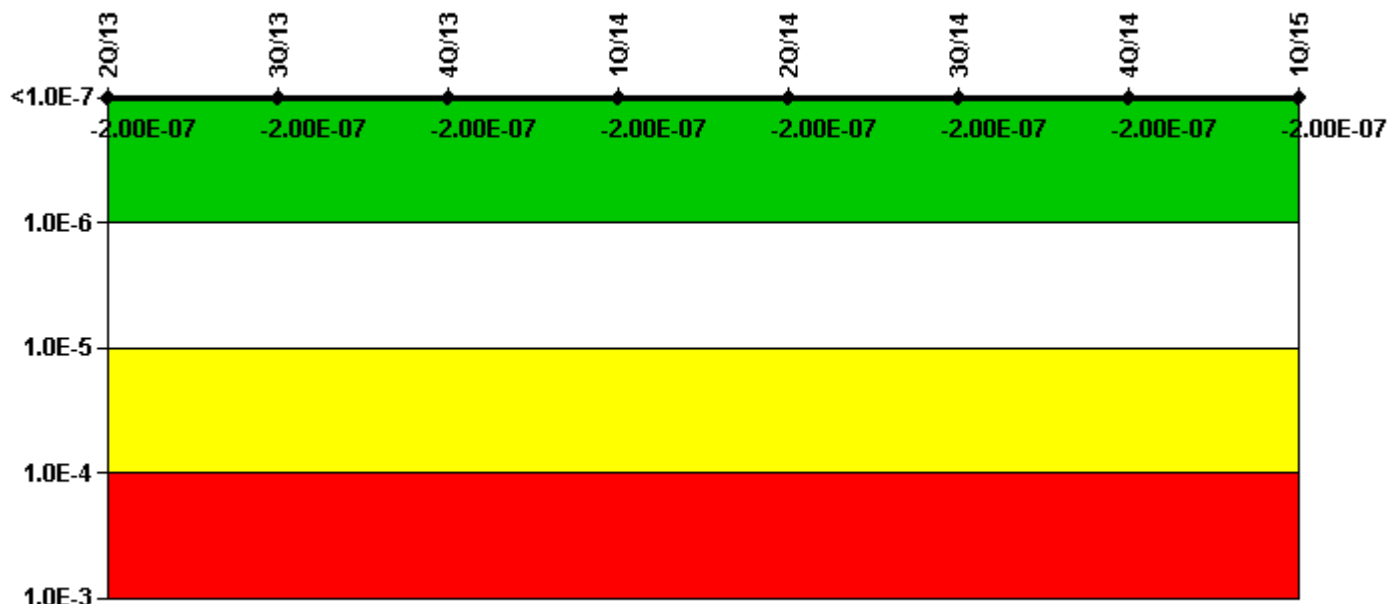


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
UAI (Δ CDF)	-3.36E-08	-3.36E-08	-3.36E-08	-3.36E-08	-3.36E-08	-3.36E-08	-3.36E-08	-3.36E-08
URI (Δ CDF)	-1.63E-07	-1.63E-07	-1.63E-07	-1.63E-07	-1.63E-07	-1.63E-07	-1.63E-07	-1.63E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

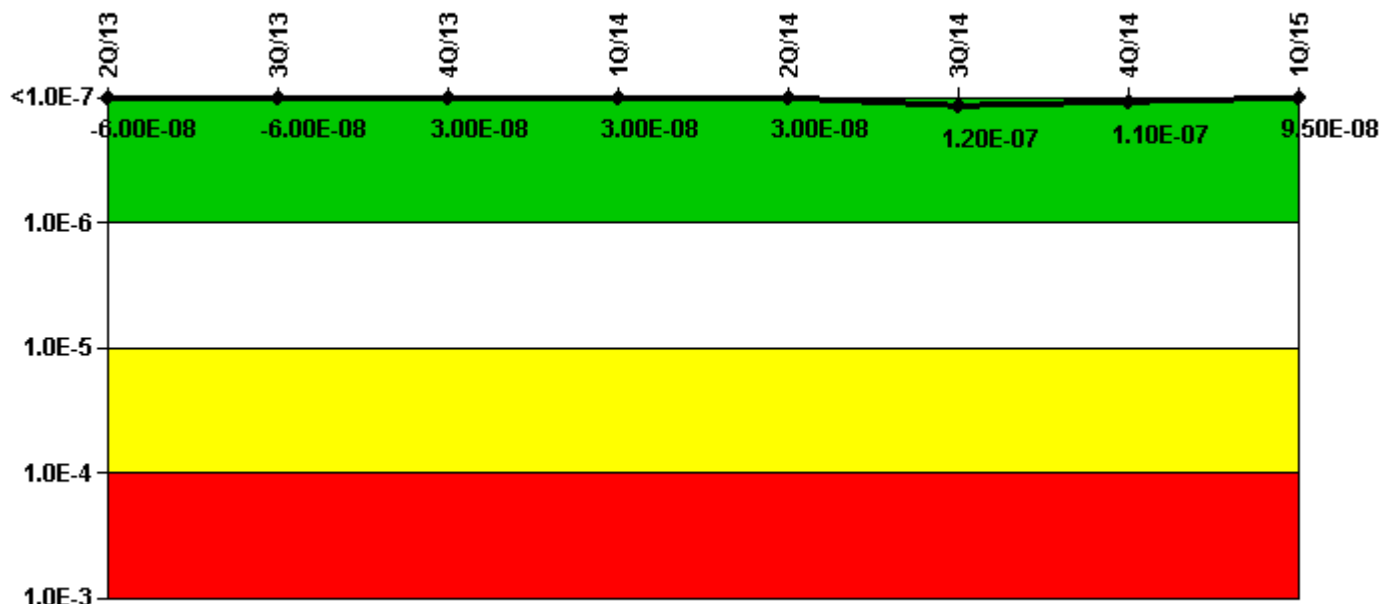


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
UAI (Δ CDF)	-1.31E-08	-1.30E-08	-9.39E-09	-9.39E-09	-9.39E-09	-9.42E-09	-1.29E-08	-1.31E-08
URI (Δ CDF)	-4.67E-08	-4.67E-08	3.92E-08	3.92E-08	3.92E-08	1.25E-07	1.25E-07	1.09E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.00E-08	-6.00E-08	3.00E-08	3.00E-08	3.00E-08	1.20E-07	1.10E-07	9.50E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

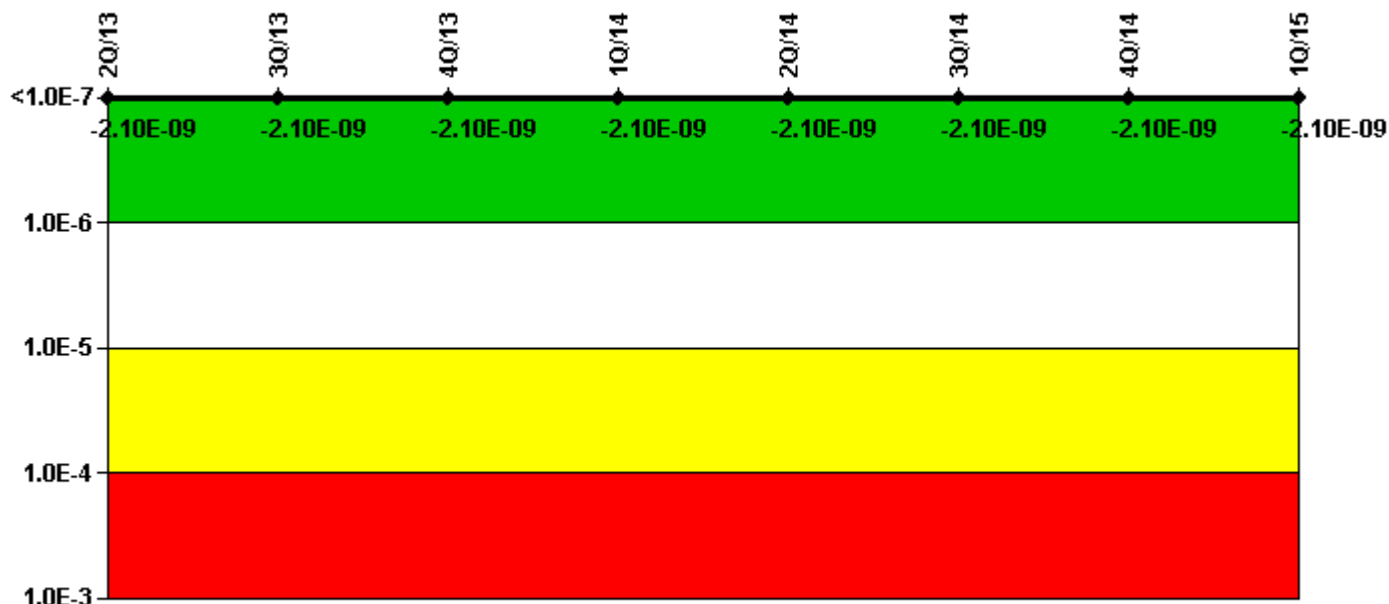


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
UAI (Δ CDF)	-1.41E-10	-1.41E-10	-1.41E-10	-1.41E-10	-1.41E-10	-1.41E-10	-1.41E-10	-1.41E-10
URI (Δ CDF)	-1.96E-09	-1.96E-09	-1.96E-09	-1.96E-09	-1.96E-09	-1.96E-09	-1.96E-09	-1.96E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.10E-09	-2.10E-09	-2.10E-09	-2.10E-09	-2.10E-09	-2.10E-09	-2.10E-09	-2.10E-09

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

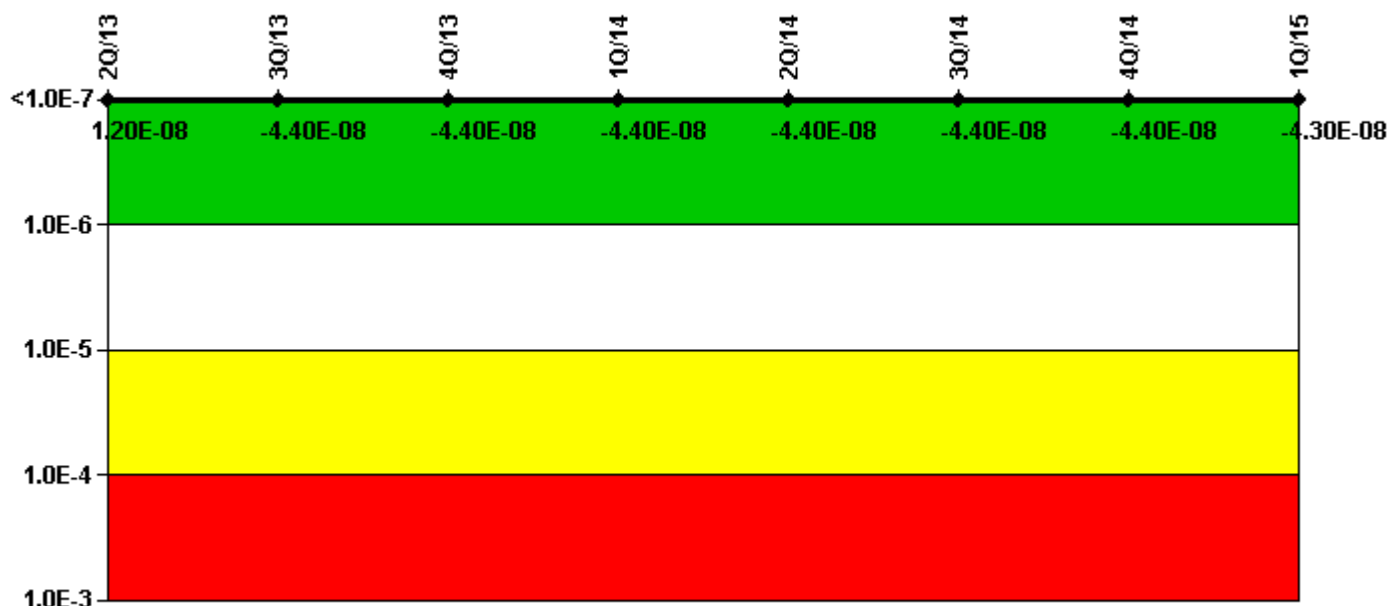


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
UAI (Δ CDF)	2.40E-08	-3.22E-08	-3.22E-08	-3.22E-08	-3.22E-08	-3.22E-08	-3.17E-08	-3.11E-08
URI (Δ CDF)	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08	-1.20E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.20E-08	-4.40E-08	-4.40E-08	-4.40E-08	-4.40E-08	-4.40E-08	-4.40E-08	-4.30E-08

Licensee Comments: none

Reactor Coolant System Activity

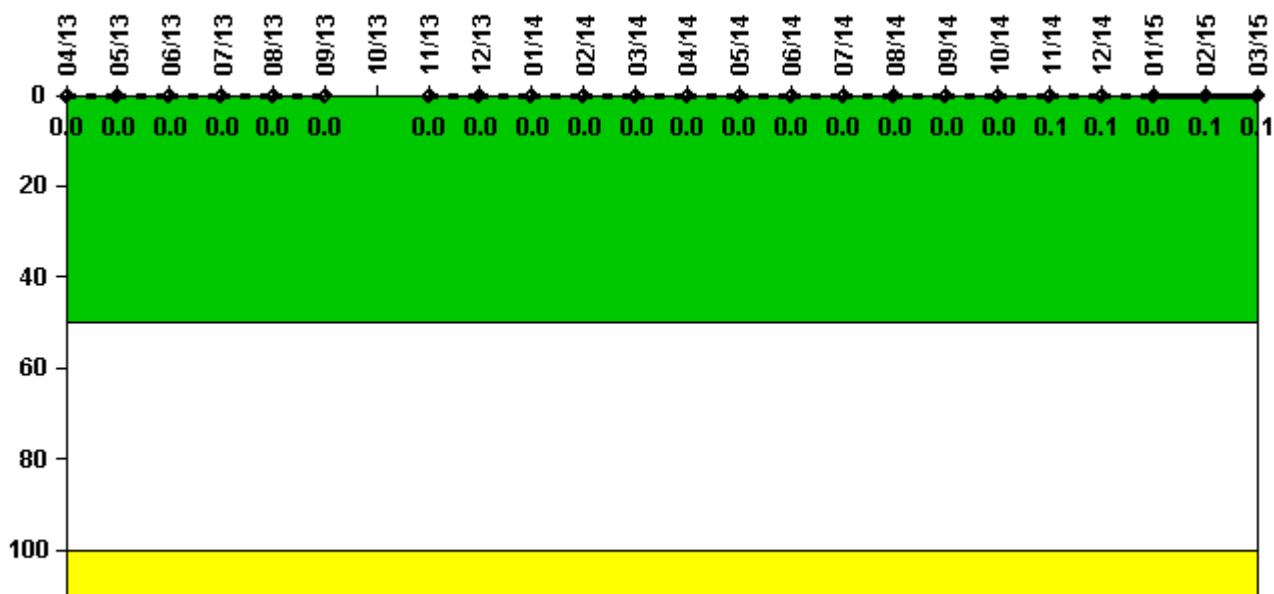

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14
Maximum activity	0.000329	0.000354	0.000325	0.000340	0.000391	0.000409	N/A	0.000222	0.000221	0.000241	0.000280	0.000327
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	N/A	0	0	0	0	0

Reactor Coolant System Activity	4/14	5/14	6/14	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15
Maximum activity	0.000335	0.000307	0.000306	0.000385	0.000331	0.000351	0.000451	0.000504	0.000522	0.000415	0.000500	0.001210
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0.1	0.1	0	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

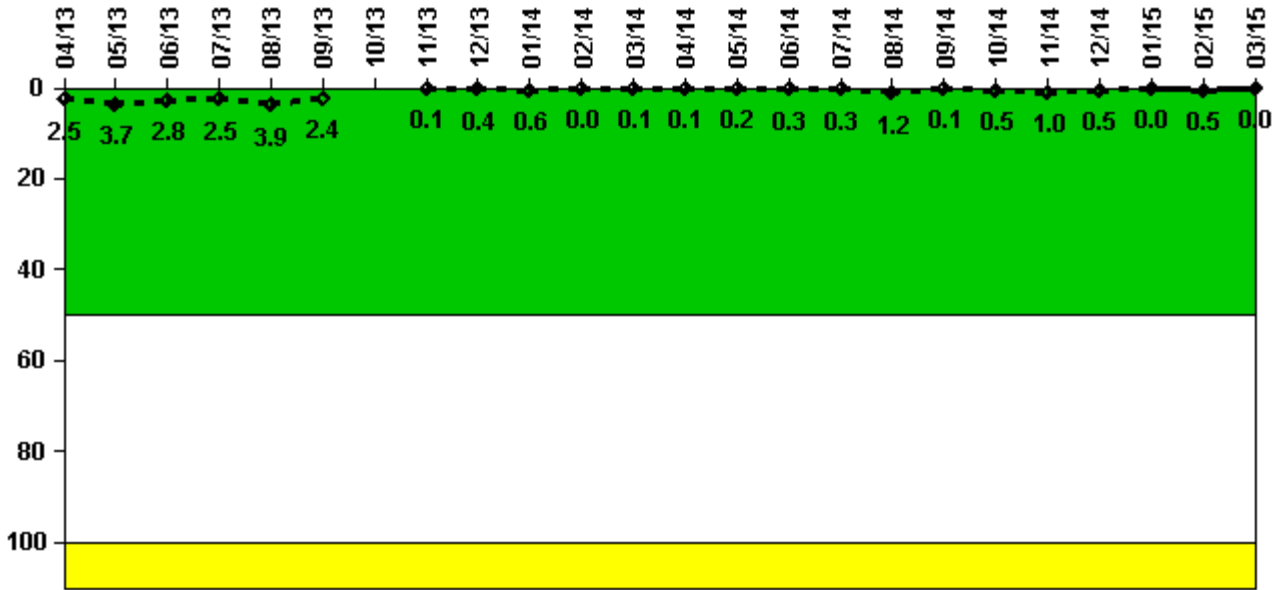


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/13	5/13	6/13	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14
Maximum leakage	0.249	0.374	0.280	0.249	0.389	0.240	N/A	0.010	0.042	0.063	0.003	0.010
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.5	3.7	2.8	2.5	3.9	2.4	N/A	0.1	0.4	0.6	0	0.1
Reactor Coolant System Leakage	4/14	5/14	6/14	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15
Maximum leakage	0.011	0.015	0.029	0.030	0.117	0.014	0.045	0.095	0.053	0.001	0.052	0
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.1	0.2	0.3	0.3	1.2	0.1	0.5	1.0	0.5	0	0.5	0

Licensee Comments: none

Drill/Exercise Performance

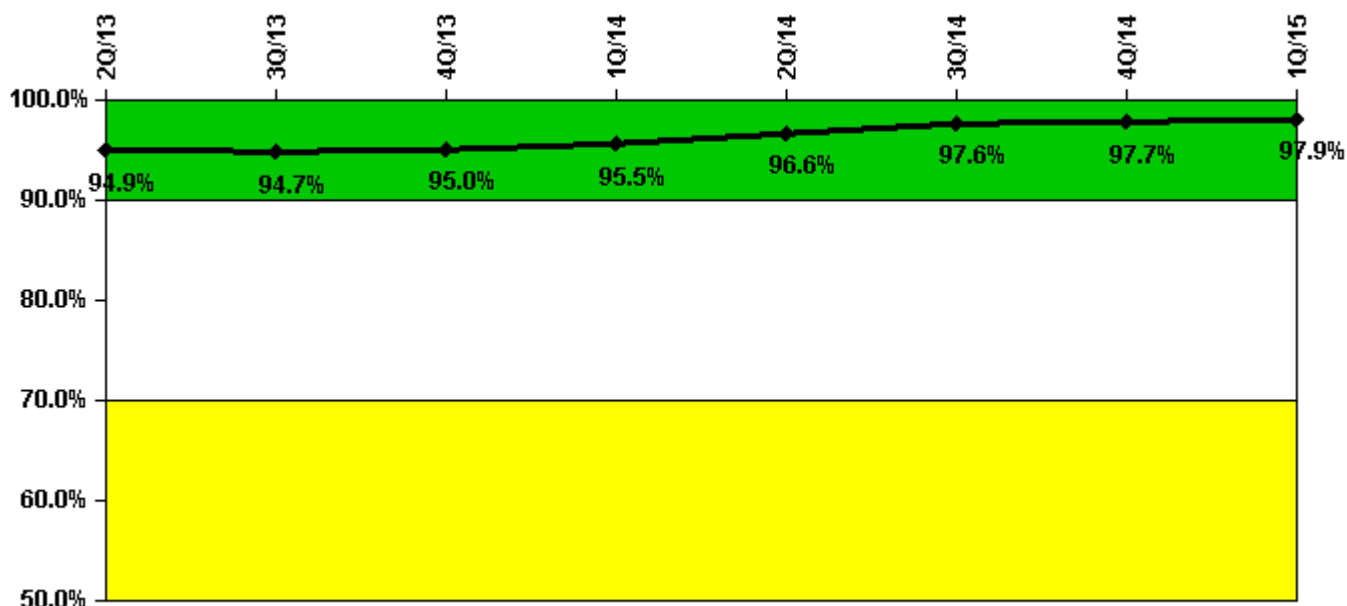

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
Successful opportunities	56.0	79.0	29.0	50.0	43.0	53.0	29.0	31.0
Total opportunities	58.0	81.0	30.0	50.0	43.0	54.0	29.0	33.0
Indicator value	94.9%	94.7%	95.0%	95.5%	96.6%	97.6%	97.7%	97.9%

Licensee Comments:

2Q/13: Change to June 13 total drill, exercise and event opportunities

ERO Drill Participation

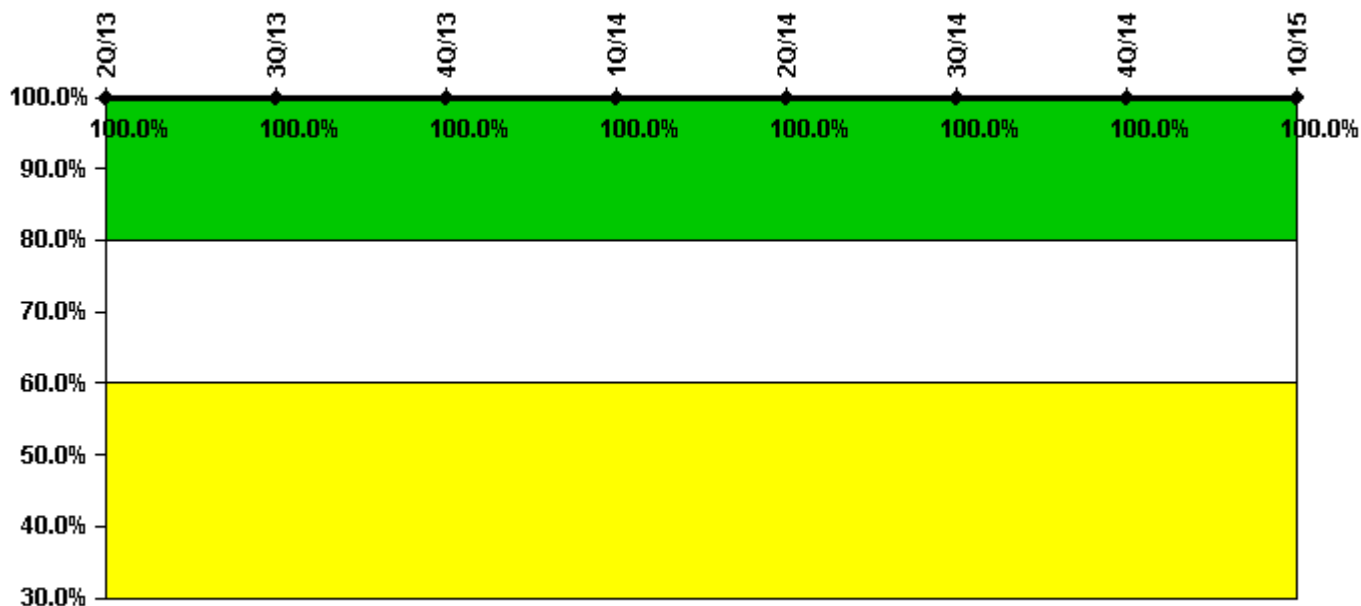


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
Participating Key personnel	102.0	109.0	113.0	114.0	107.0	111.0	110.0	94.0
Total Key personnel	102.0	109.0	113.0	114.0	107.0	111.0	110.0	94.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

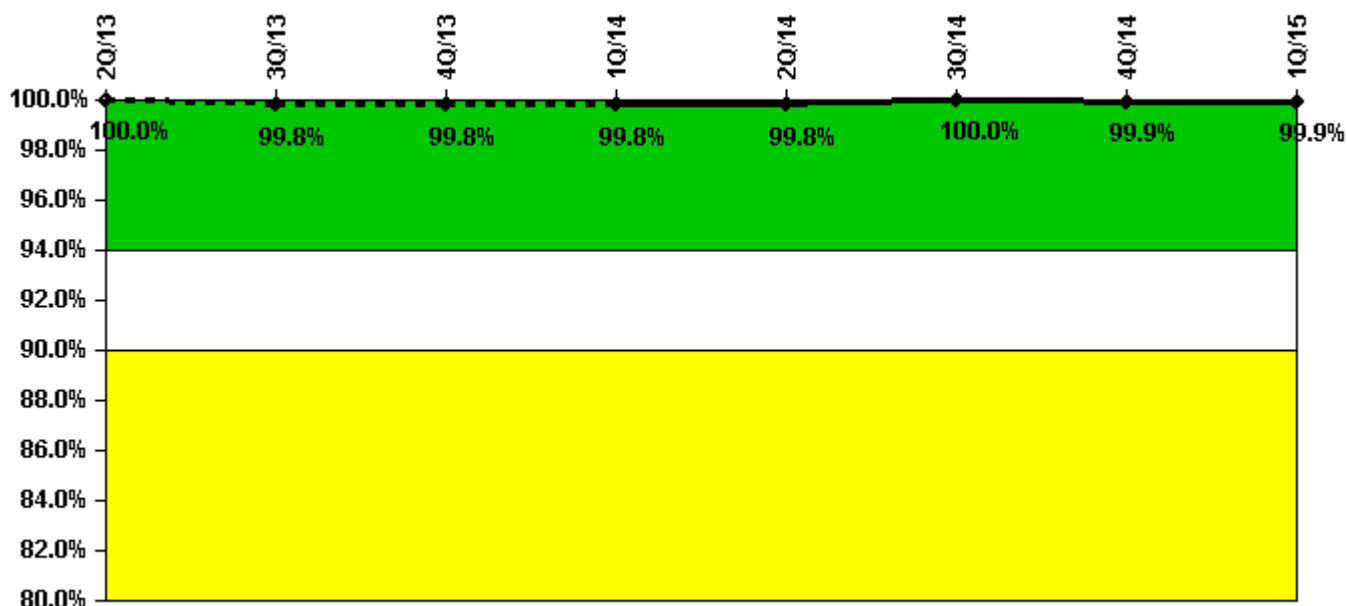


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
Successful siren-tests	720	626	715	719	630	630	718	630
Total sirens-tests	720	630	715	720	630	630	720	630
Indicator value	100.0%	99.8%	99.8%	99.8%	99.8%	100.0%	99.9%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness

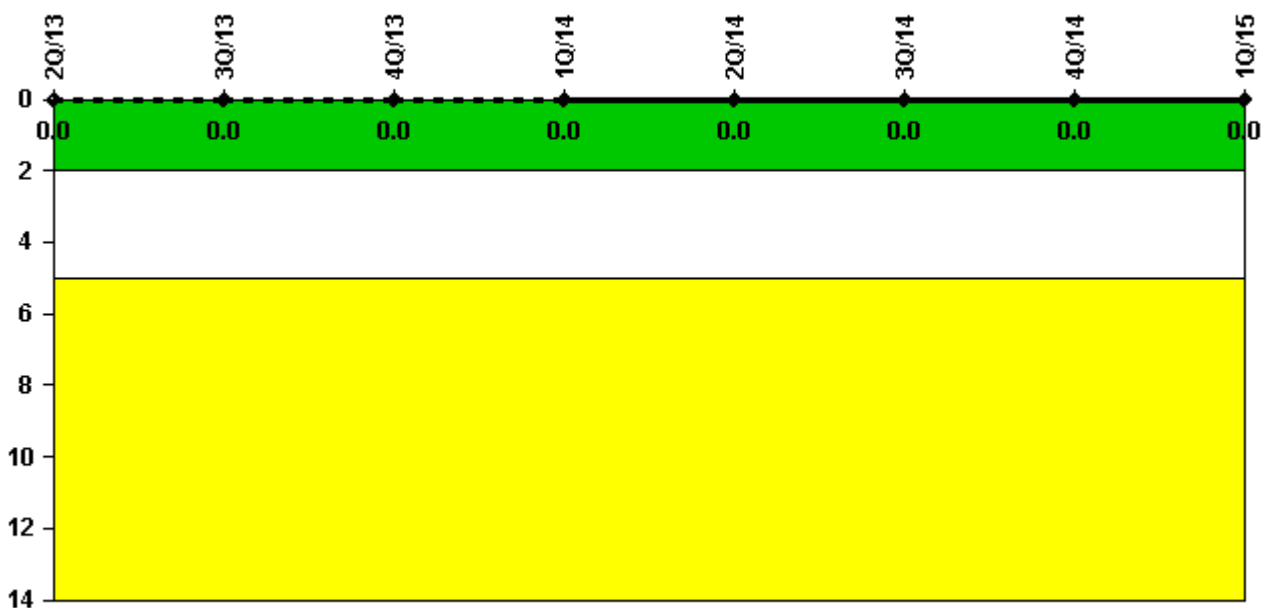

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/13	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 23, 2015