


Braidwood 1

2Q/2015 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

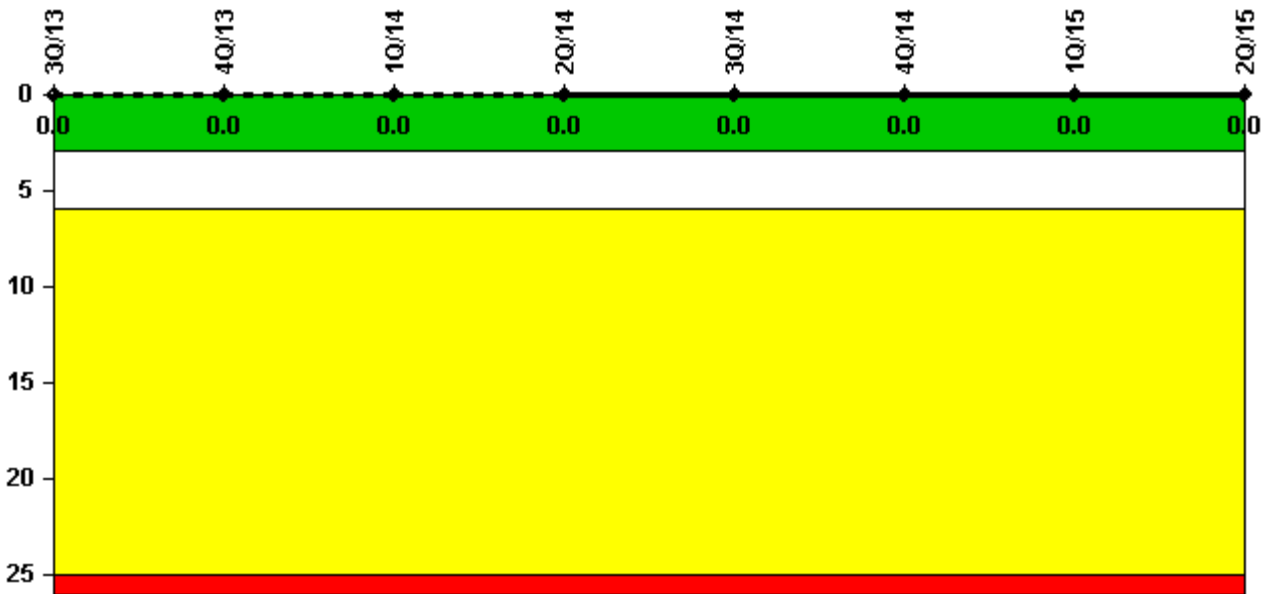


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	1697.9	2209.0	2159.0	2184.0	2208.0	2209.0	2111.0	1780.2
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

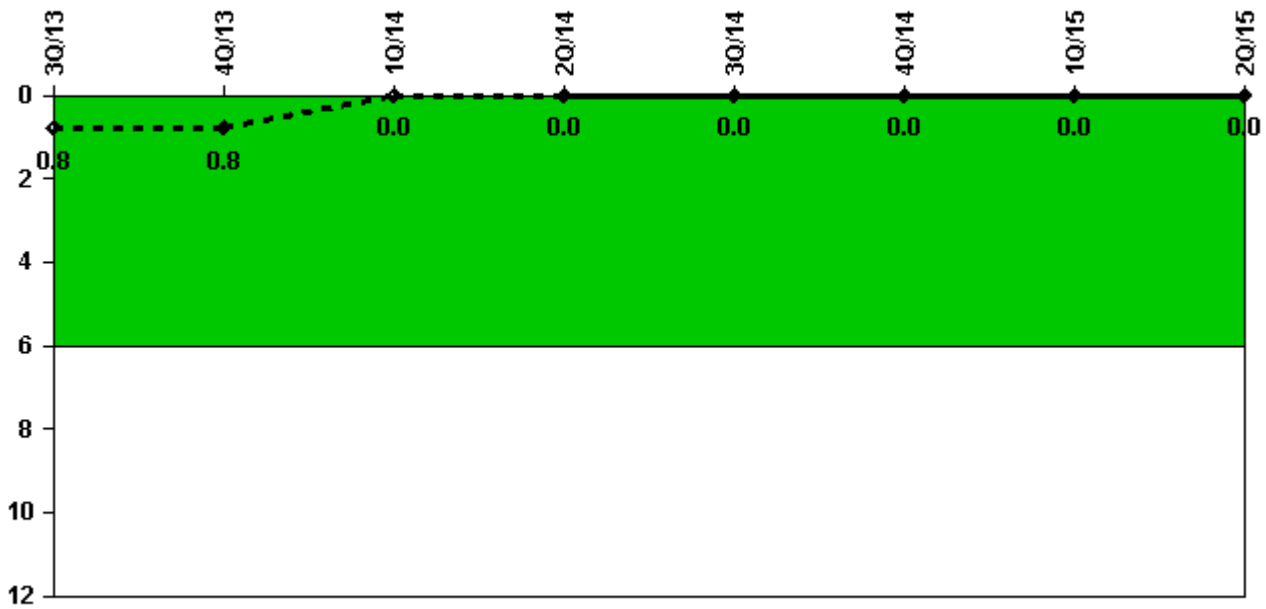


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	1697.9	2209.0	2159.0	2184.0	2208.0	2209.0	2111.0	1780.2
Indicator value	0.8	0.8	0	0	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

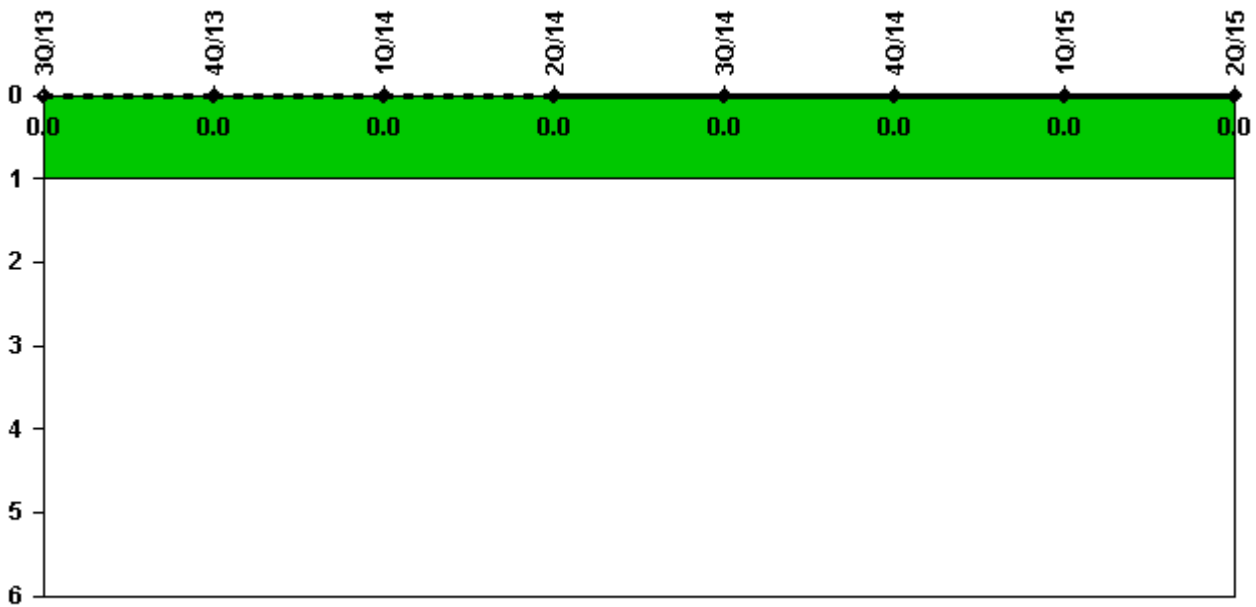


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

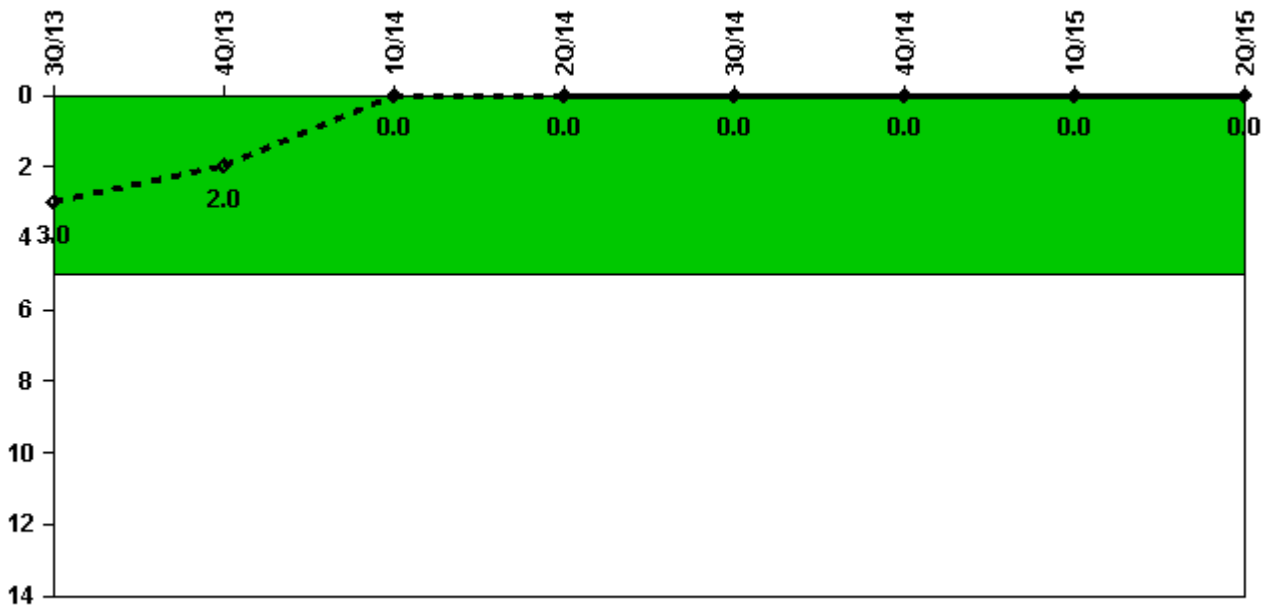

Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	3	2	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System




Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (Δ CDF)	5.90E-08	8.06E-08	6.86E-08	9.53E-08	5.44E-08	5.65E-08	5.75E-08	7.69E-08
URI (Δ CDF)	-3.24E-07	-3.14E-07	-3.08E-07	-2.92E-07	-2.73E-07	-2.65E-07	-2.54E-07	-2.54E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.70E-07	-2.30E-07	-2.40E-07	-2.00E-07	-2.20E-07	-2.10E-07	-2.00E-07	-1.80E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

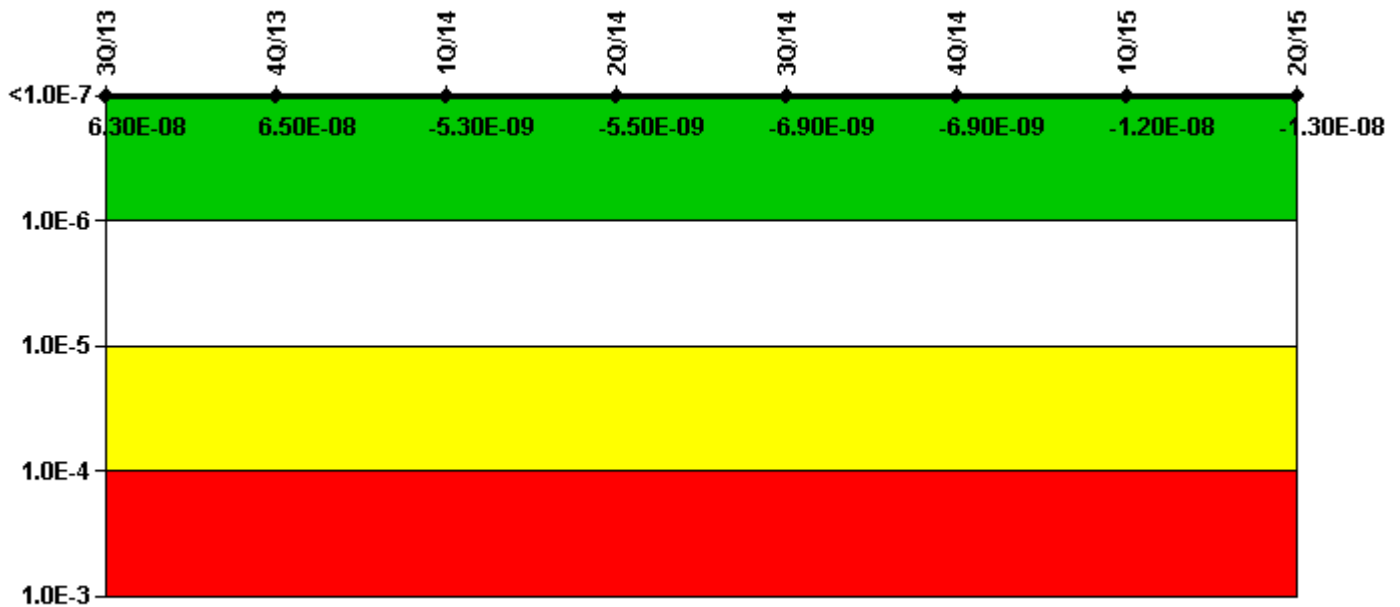


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (Δ CDF)	7.22E-08	7.36E-08	3.61E-09	3.48E-09	2.04E-09	2.04E-09	-3.35E-09	-4.20E-09
URI (Δ CDF)	-9.59E-09	-8.87E-09	-8.90E-09	-8.94E-09	-8.94E-09	-8.94E-09	-8.93E-09	-8.40E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	6.30E-08	6.50E-08	-5.30E-09	-5.50E-09	-6.90E-09	-6.90E-09	-1.20E-08	-1.30E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

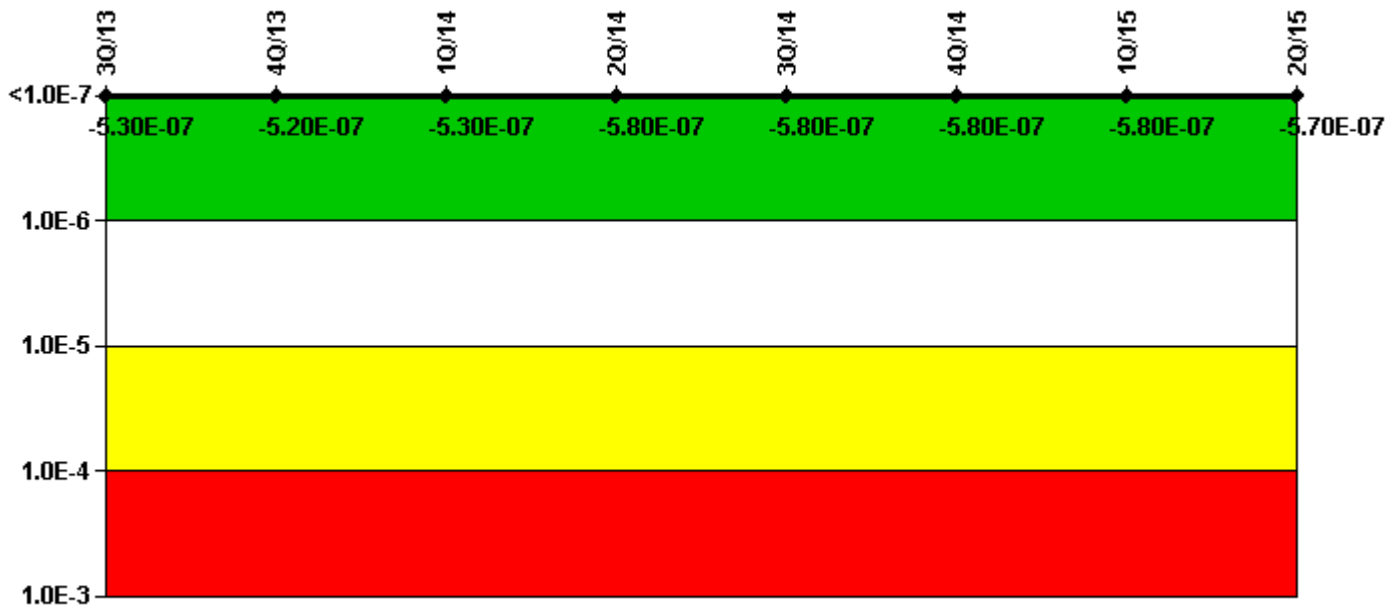


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (Δ CDF)	-6.30E-08	-6.48E-08	-7.35E-08	-1.19E-07	-1.19E-07	-1.19E-07	-1.19E-07	-1.19E-07
URI (Δ CDF)	-4.72E-07	-4.59E-07	-4.59E-07	-4.63E-07	-4.59E-07	-4.60E-07	-4.66E-07	-4.51E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.30E-07	-5.20E-07	-5.30E-07	-5.80E-07	-5.80E-07	-5.80E-07	-5.80E-07	-5.70E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

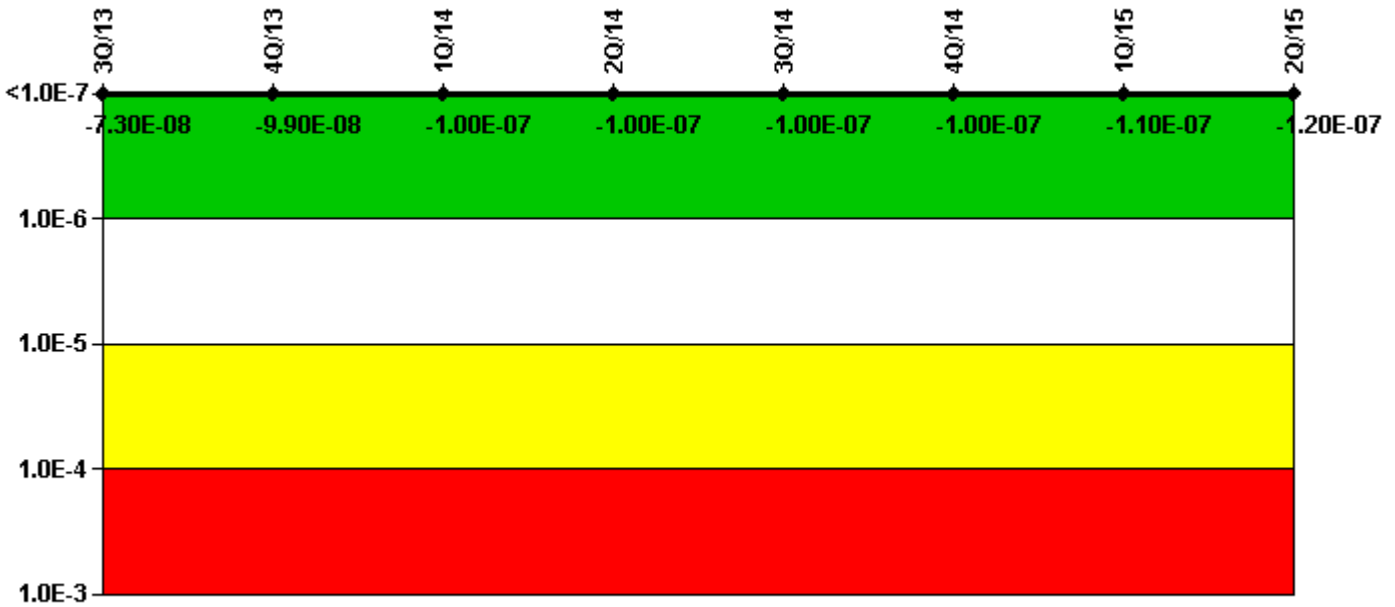


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (Δ CDF)	4.72E-08	-2.81E-09	-6.87E-09	-6.87E-09	-6.87E-09	-6.87E-09	-6.79E-09	-3.22E-08
URI (Δ CDF)	-1.20E-07	-9.59E-08	-9.63E-08	-9.55E-08	-9.53E-08	-9.53E-08	-9.85E-08	-8.75E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.30E-08	-9.90E-08	-1.00E-07	-1.00E-07	-1.00E-07	-1.00E-07	-1.10E-07	-1.20E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

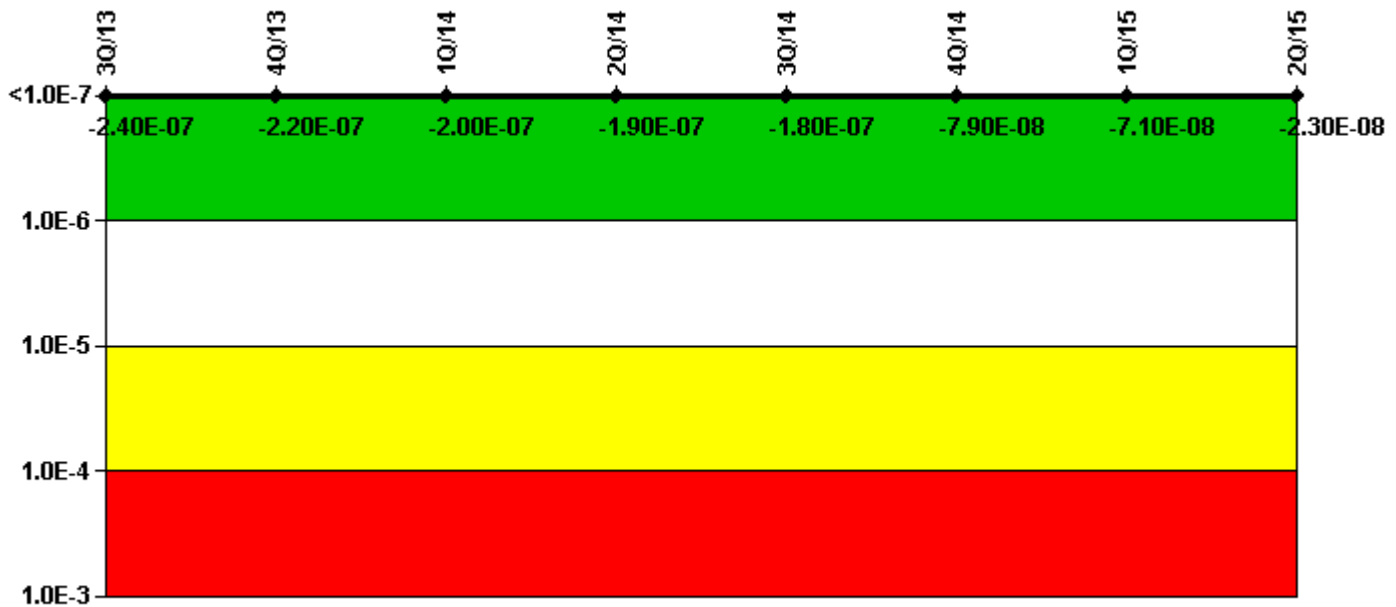

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (Δ CDF)	-7.85E-08	-7.19E-08	-5.45E-08	-5.45E-08	-5.45E-08	-5.29E-08	-4.99E-08	-4.68E-09
URI (Δ CDF)	-1.57E-07	-1.48E-07	-1.42E-07	-1.32E-07	-1.25E-07	-2.65E-08	-2.13E-08	-1.82E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.40E-07	-2.20E-07	-2.00E-07	-1.90E-07	-1.80E-07	-7.90E-08	-7.10E-08	-2.30E-08

Licensee Comments:

4Q/14: 4/16/15 - A November 2014 1SX01PB failure was originally reported as a demand failure. This has been corrected and is being reported as a Run Failure.

Reactor Coolant System Activity

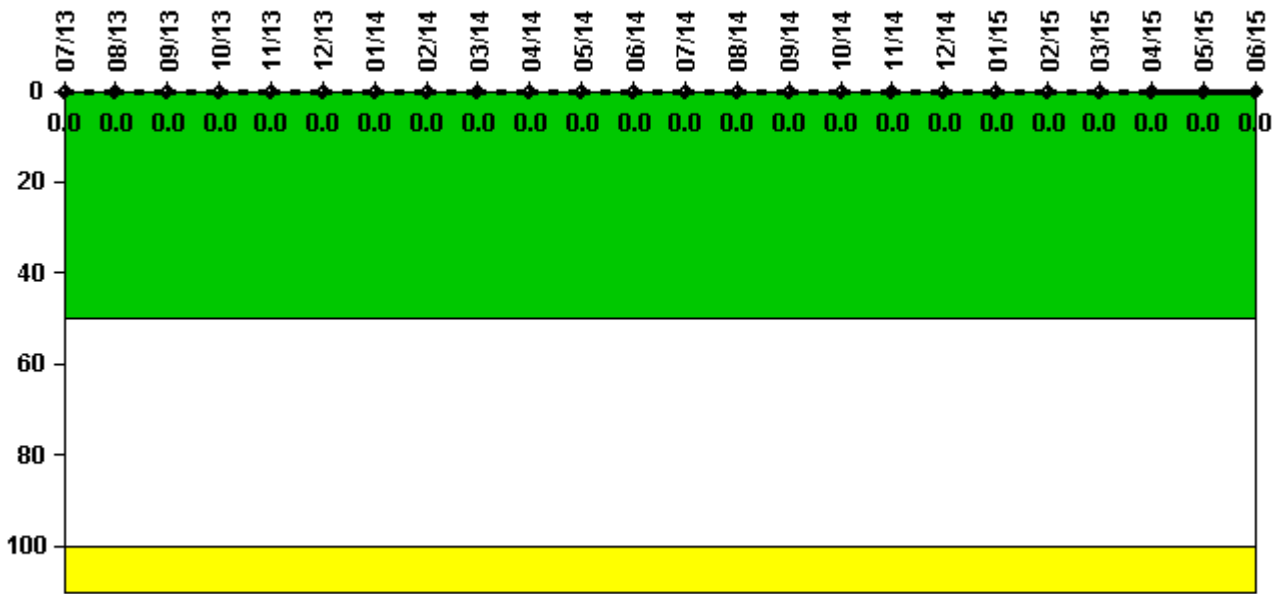


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum activity	0.000317	0.000316	0.000334	0.000107	0.000121	0.000124	0.000127	0.000147	0.000156	0.000167	0.000192	0.000184
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15
Maximum activity	0.000193	0.000212	0.000222	0.000243	0.000235	0.000259	0.000264	0.000275	0.000297	0.000095	0.000107	0.000129
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

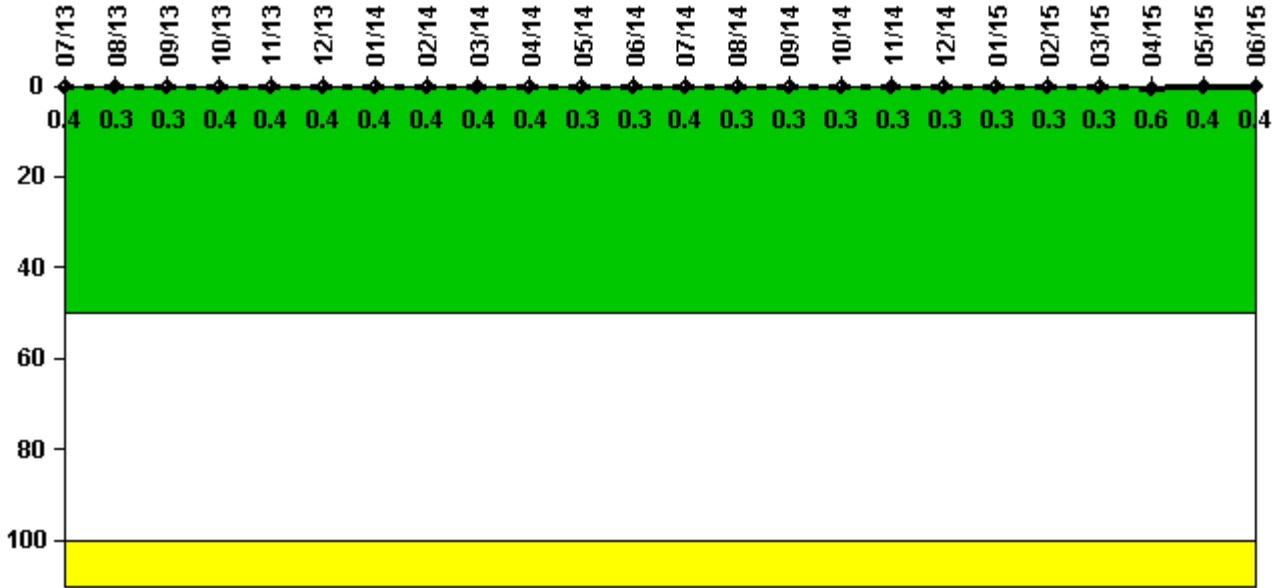


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum leakage	0.035	0.033	0.026	0.043	0.040	0.039	0.037	0.039	0.041	0.038	0.031	0.030
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.4	0.3	0.3	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.3	0.3
Reactor Coolant System Leakage	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15
Maximum leakage	0.038	0.031	0.031	0.032	0.033	0.033	0.031	0.030	0.032	0.055	0.039	0.035
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.4	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.6	0.4	0.4

Licensee Comments: none

Drill/Exercise Performance

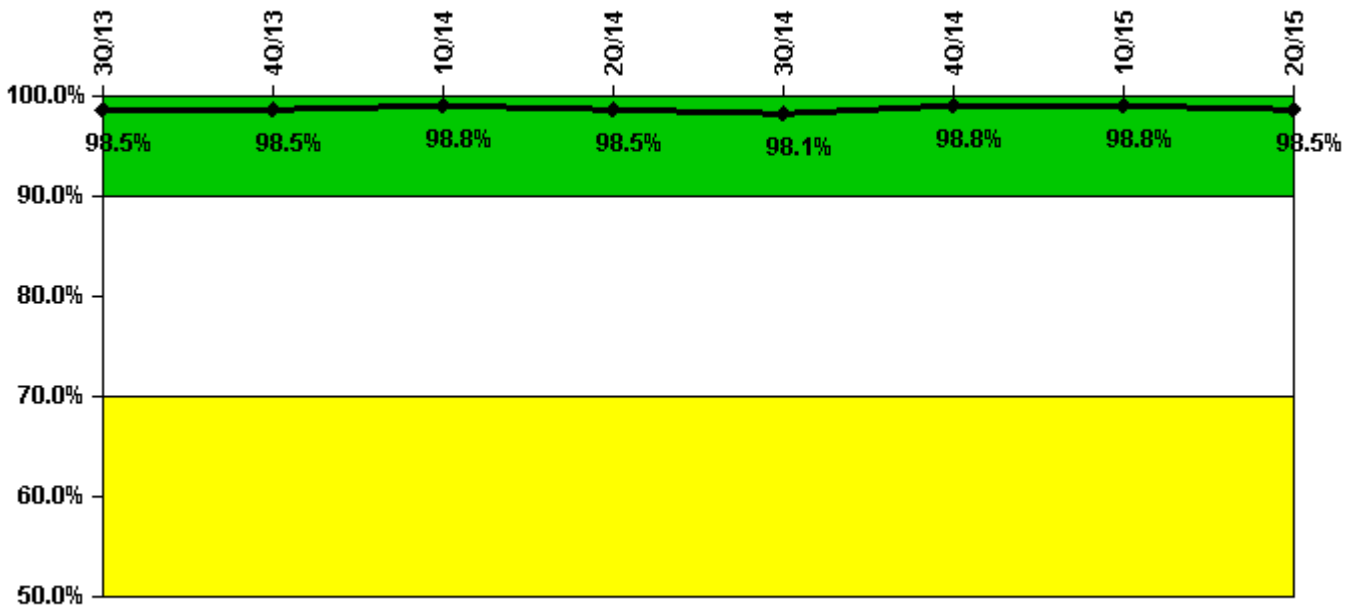

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Successful opportunities	56.0	80.0	21.0	66.0	51.0	74.0	26.0	86.0
Total opportunities	56.0	80.0	21.0	68.0	54.0	74.0	26.0	88.0
Indicator value	98.5%	98.5%	98.8%	98.5%	98.1%	98.8%	98.8%	98.5%

Licensee Comments:

3Q/13: 2/23/15 - During a review of drill reports, the (Technical Support Center) was evaluated for an Unusual Event (UE) declaration when in reality the TSC would not make a UE call. This is not a violation of NEI 99.02 as it does not prohibit a evaluation of a UE by the TSC. Decision made to remove 1 classification and 1 notification from the 8/13 statistics.

ERO Drill Participation

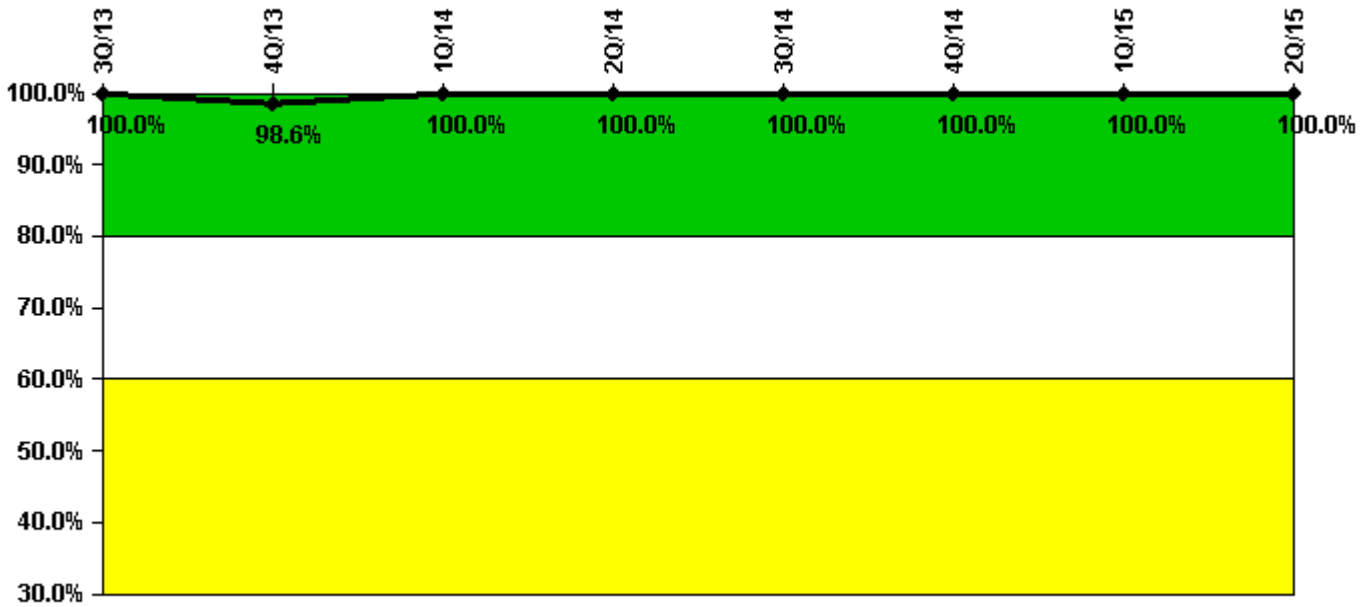


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Participating Key personnel	71.0	70.0	65.0	65.0	66.0	68.0	66.0	69.0
Total Key personnel	71.0	71.0	65.0	65.0	66.0	68.0	66.0	69.0
Indicator value	100.0%	98.6%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

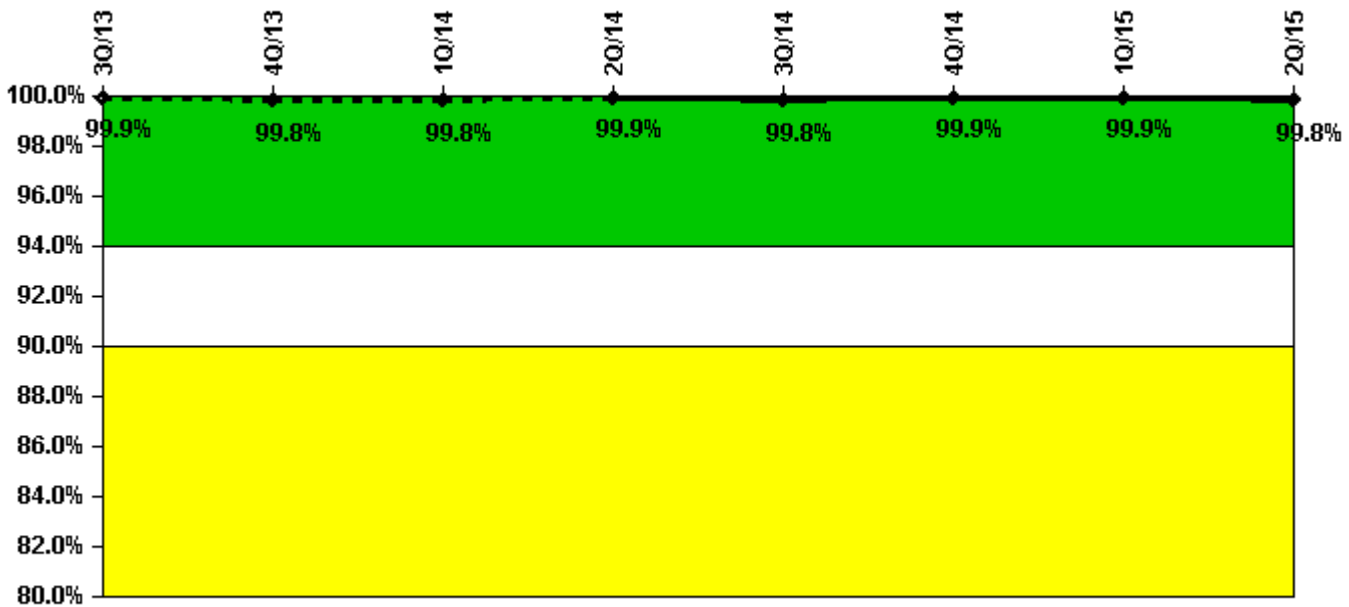


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Successful siren-tests	3068	3060	3024	3070	3058	3070	3024	3059
Total sirens-tests	3072	3072	3024	3072	3072	3072	3024	3072
Indicator value	99.9%	99.8%	99.8%	99.9%	99.8%	99.9%	99.9%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

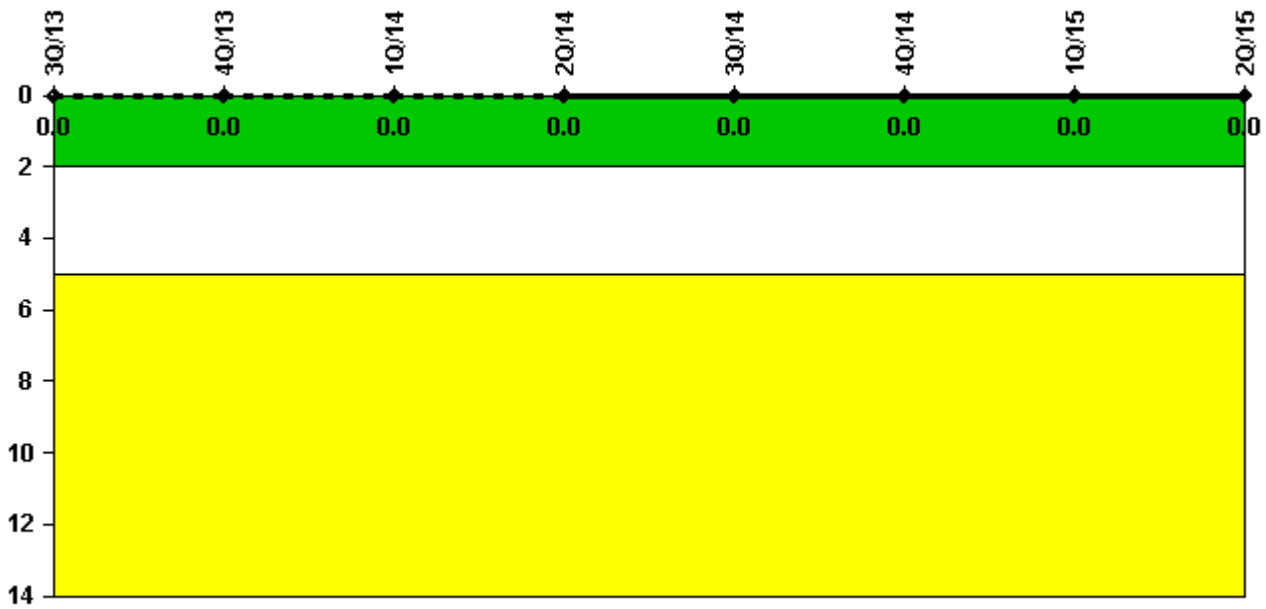


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

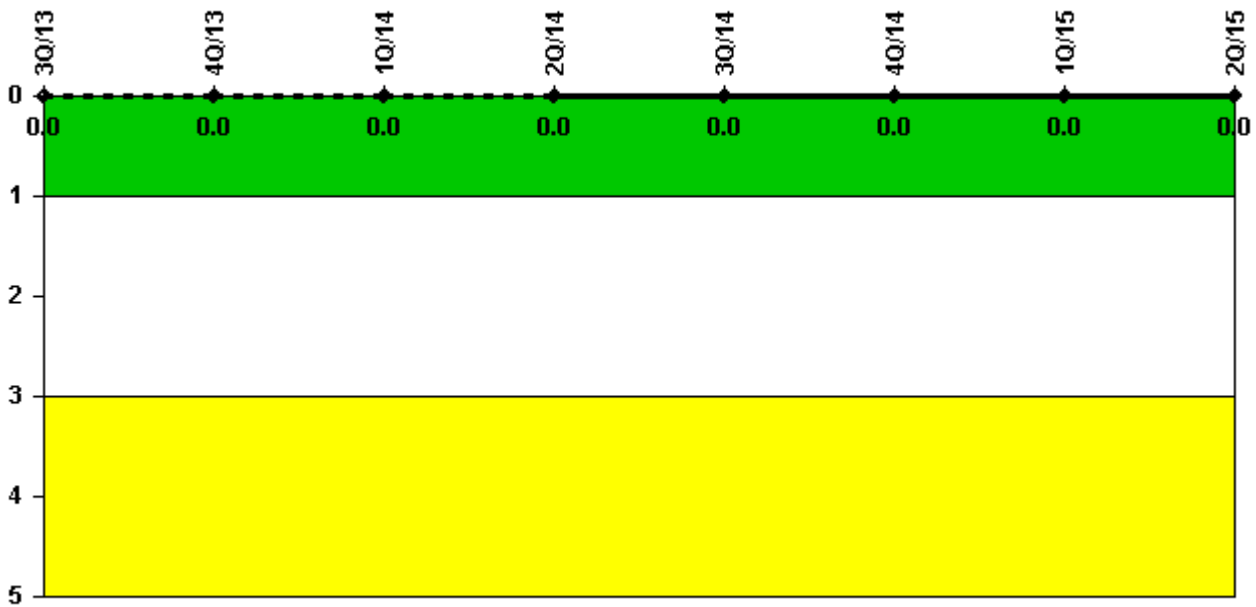

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: July 24, 2015