


Hope Creek 1

2Q/2015 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

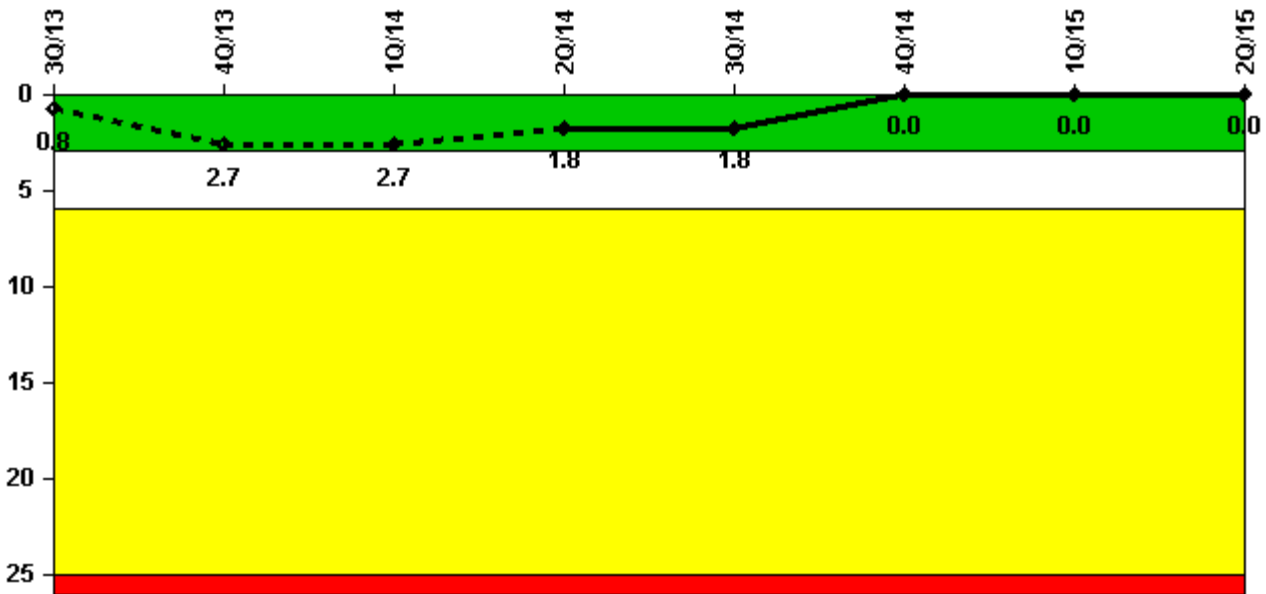


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Unplanned scrams	0	2.0	0	0	0	0	0	0
Critical hours	2208.0	1382.8	2159.0	2184.0	2102.8	2209.0	2159.0	1500.7
Indicator value	0.8	2.7	2.7	1.8	1.8	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

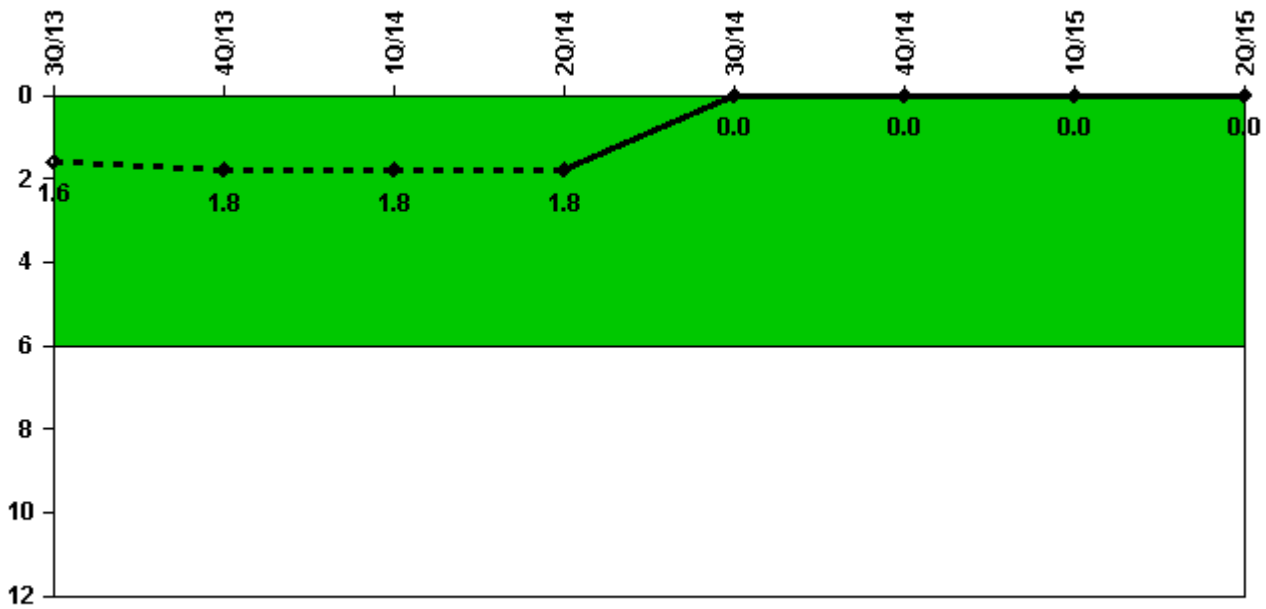


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Unplanned power changes	2.0	0	0	0	0	0	0	0
Critical hours	2208.0	1382.8	2159.0	2184.0	2102.8	2209.0	2159.0	1500.7
Indicator value	1.6	1.8	1.8	1.8	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

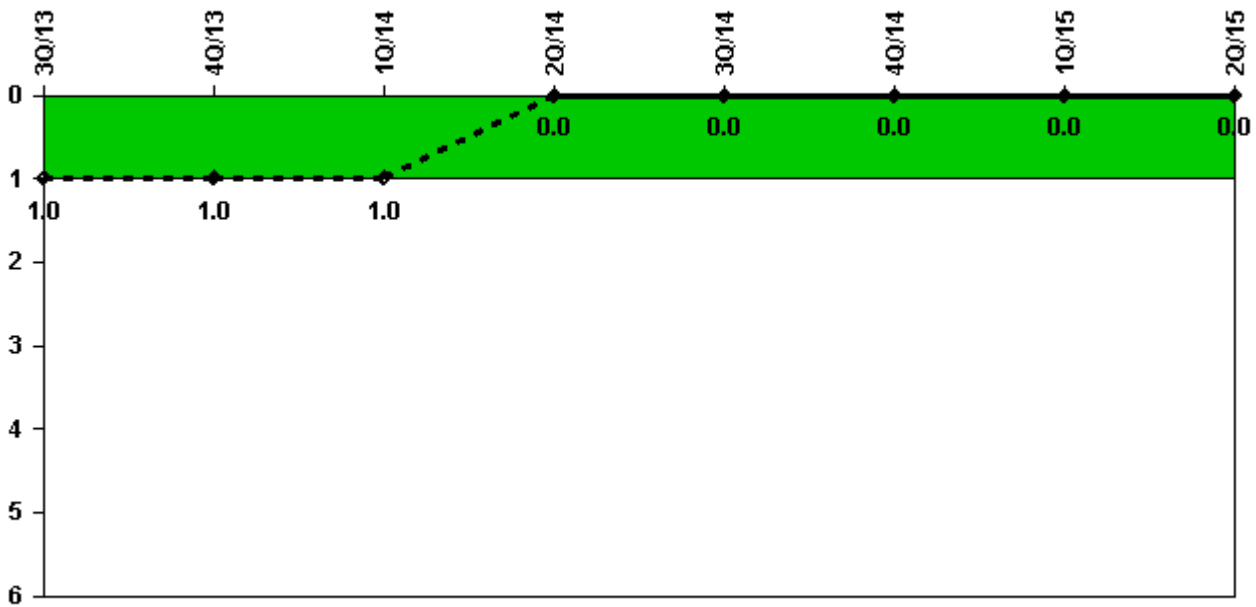


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	1.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

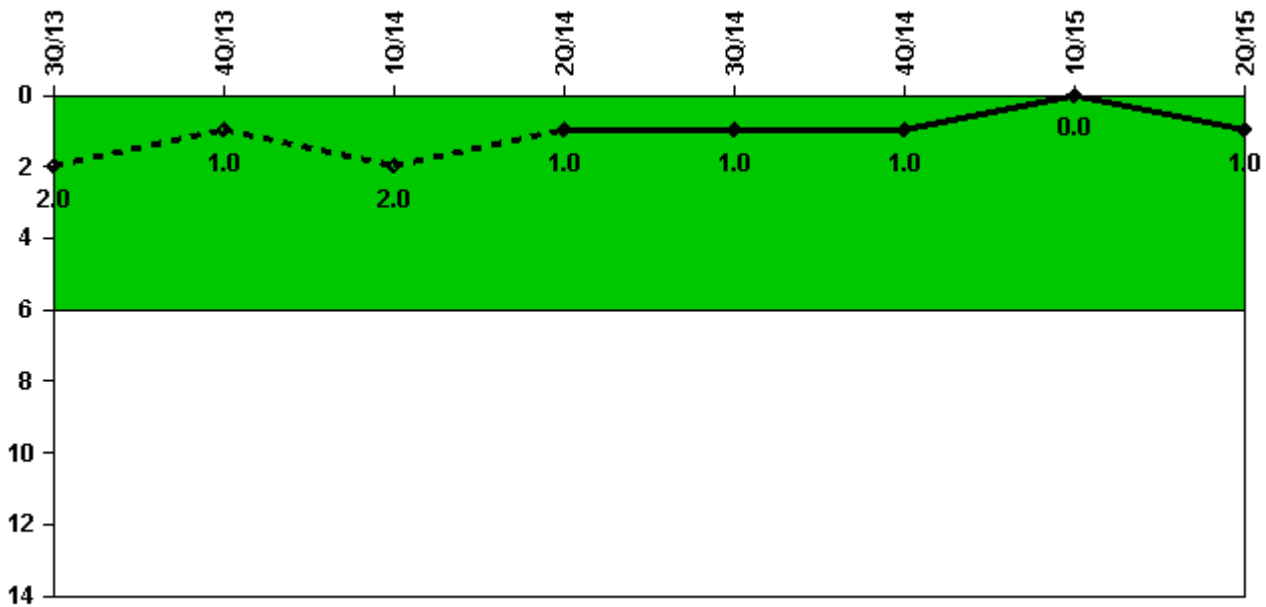

Thresholds: White > 6.0

Notes


Safety System Functional Failures (BWR)	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Safety System Functional Failures	0	0	1	0	0	0	0	1
Indicator value	2	1	2	1	1	1	0	1

Licensee Comments:

2Q/15: LER 2015-001-00 "Conditions Prohibited by Technical Specifications Due to Core Spray Inoperabilities" submitted on 5/29/15 reported a SSFF.

1Q/14: LER 2013-010-00 Loss of both Control Room Chillers submitted February 18, 2014.

Mitigating Systems Performance Index, Emergency AC Power System

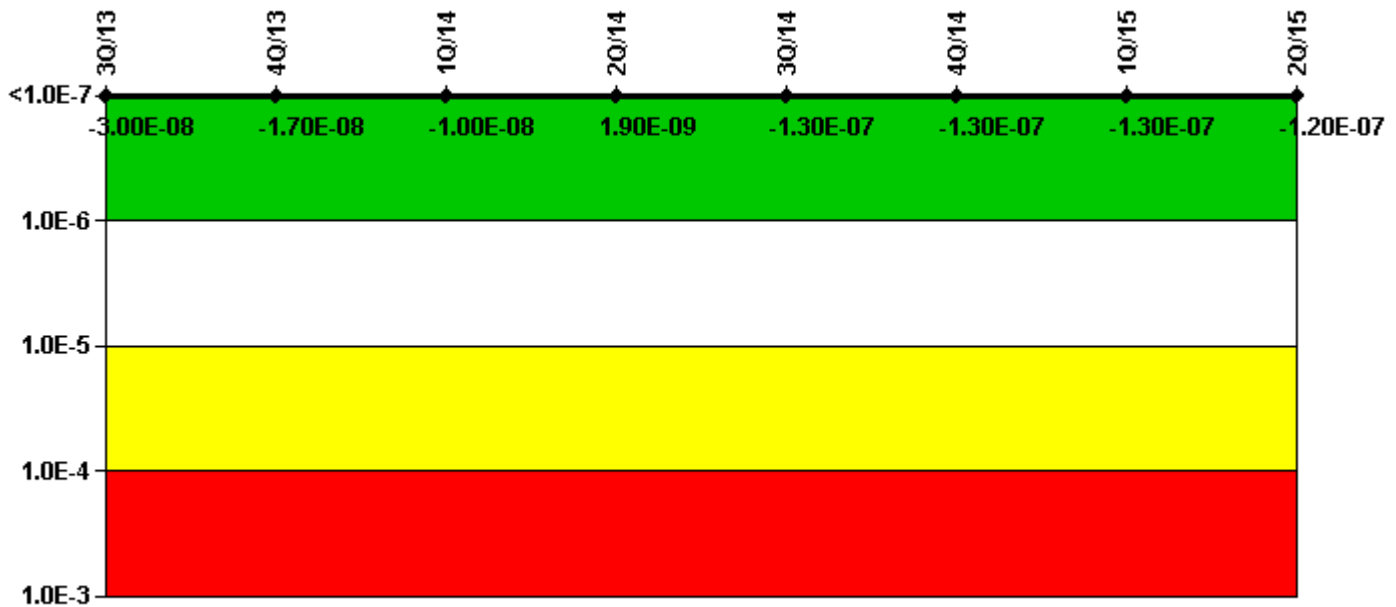


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (Δ CDF)	-4.41E-09	3.42E-09	5.81E-09	1.46E-08	7.75E-09	3.80E-09	6.36E-09	1.59E-08
URI (Δ CDF)	-2.61E-08	-2.03E-08	-1.59E-08	-1.27E-08	-1.37E-07	-1.35E-07	-1.37E-07	-1.37E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.00E-08	-1.70E-08	-1.00E-08	1.90E-09	-1.30E-07	-1.30E-07	-1.30E-07	-1.20E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

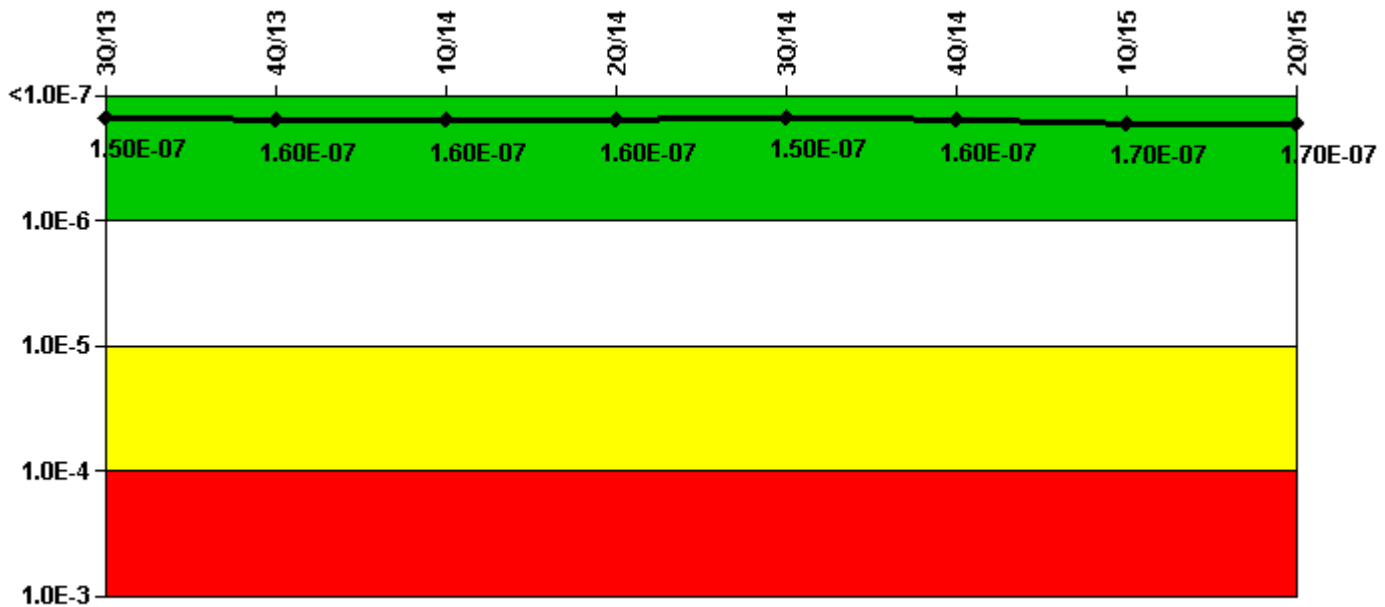

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (ΔCDF)	-3.03E-08	-3.03E-08	-3.03E-08	-3.03E-08	-3.03E-08	-3.03E-08	-3.03E-08	-3.02E-08
URI (ΔCDF)	1.80E-07	1.91E-07	1.92E-07	1.86E-07	1.85E-07	1.85E-07	2.03E-07	2.03E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.50E-07	1.60E-07	1.60E-07	1.60E-07	1.50E-07	1.60E-07	1.70E-07	1.70E-07

Licensee Comments:

4Q/13: April event under ICES report 305385 is now being counted as a failure to start until FAQ is resolved. No color change occurred for this PI; it remains GREEN.

3Q/13: April event under ICES report 305385 is now being counted as a failure to start until FAQ is resolved. No color change occurred for this PI; it remains GREEN

3Q/13: A second quarter 'Failure to Start' is being evaluated. A FAQ is being Submitted

Mitigating Systems Performance Index, Heat Removal System




Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (Δ CDF)	-1.16E-08	-1.16E-08	-1.16E-08	-1.16E-08	-1.16E-08	-1.16E-08	-8.22E-09	-8.05E-09
URI (Δ CDF)	-3.32E-08	-3.23E-08	-3.45E-08	-3.44E-08	-3.44E-08	-3.43E-08	-3.44E-08	6.01E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.50E-08	-4.40E-08	-4.60E-08	-4.60E-08	-4.60E-08	-4.60E-08	-4.30E-08	5.20E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

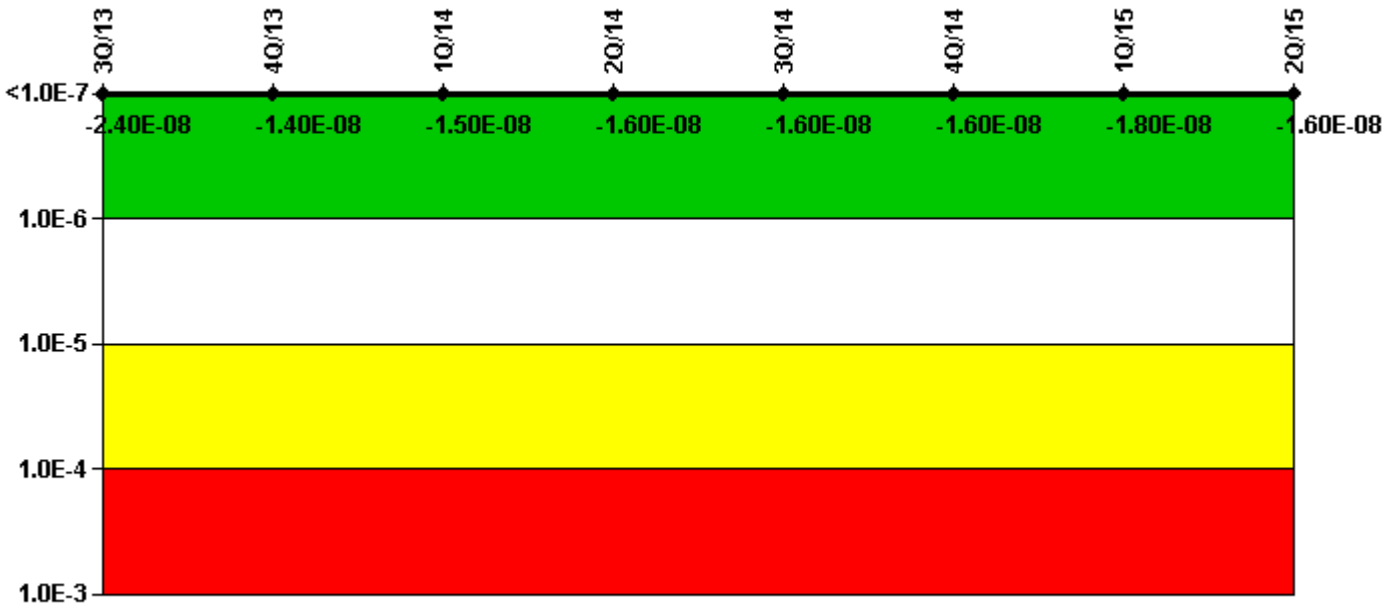


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (Δ CDF)	-3.45E-09	-3.43E-09	-3.43E-09	-3.43E-09	-1.45E-09	-1.10E-09	-3.43E-09	-5.36E-10
URI (Δ CDF)	-2.06E-08	-1.09E-08	-1.11E-08	-1.24E-08	-1.46E-08	-1.46E-08	-1.47E-08	-1.50E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.40E-08	-1.40E-08	-1.50E-08	-1.60E-08	-1.60E-08	-1.60E-08	-1.80E-08	-1.60E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

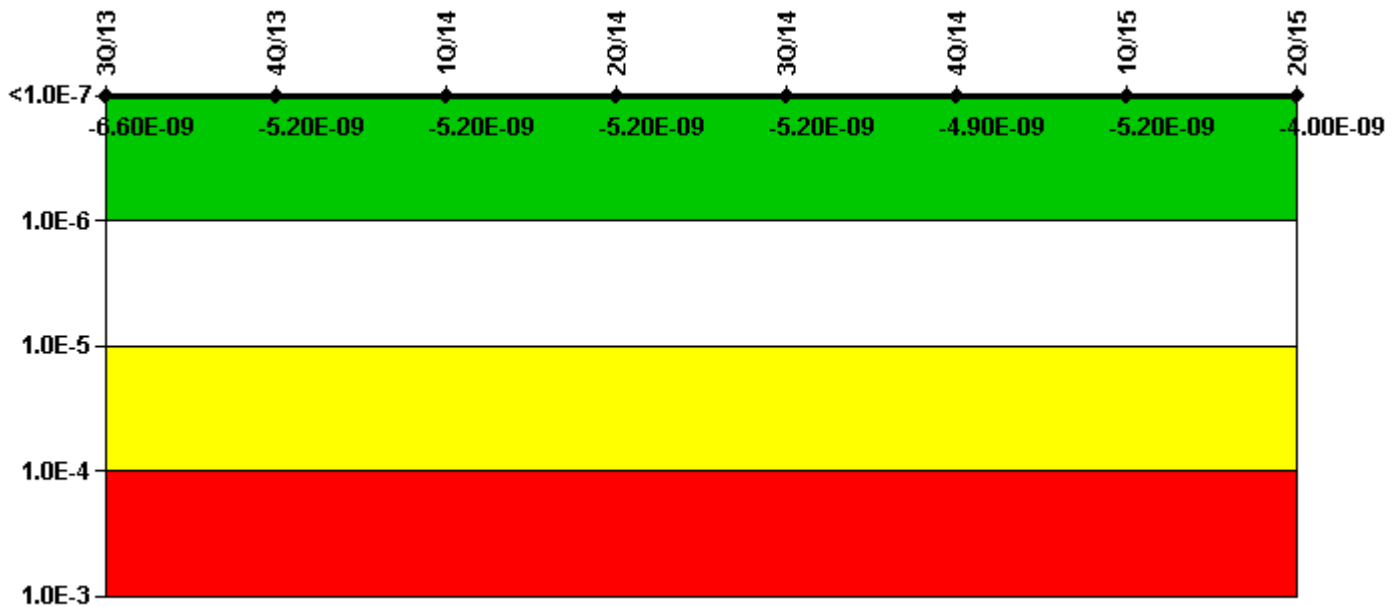


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (Δ CDF)	-3.73E-09	-3.71E-09	-3.75E-09	-3.80E-09	-3.81E-09	-3.52E-09	-3.84E-09	-2.58E-09
URI (Δ CDF)	-2.91E-09	-1.48E-09	-1.48E-09	-1.42E-09	-1.41E-09	-1.40E-09	-1.39E-09	-1.41E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.60E-09	-5.20E-09	-5.20E-09	-5.20E-09	-5.20E-09	-4.90E-09	-5.20E-09	-4.00E-09

Licensee Comments: none

Reactor Coolant System Activity

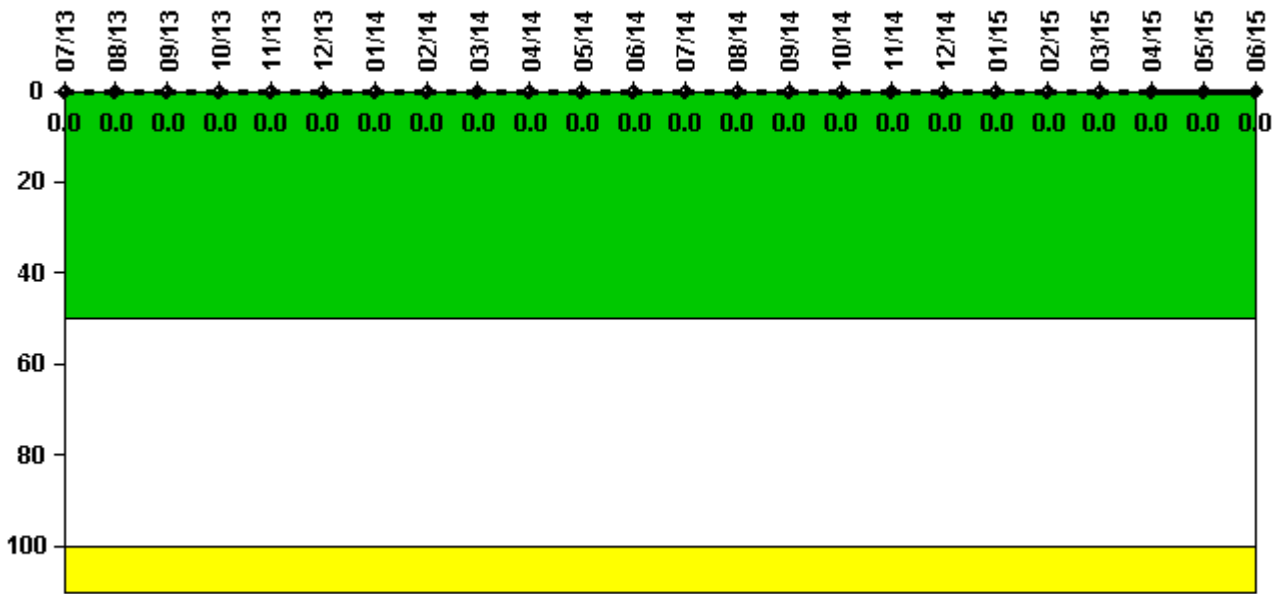


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum activity	0.000034	0.000031	0.000039	0.000041	0.000039	0.000042	0.000061	0.000043	0.000044	0.000037	0.000039	0.000035
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15
Maximum activity	0.000038	0.000036	0.000038	0.000037	0.000038	0.000043	0.000062	0.000039	0.000052	0.000040	0.000025	0.000025
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

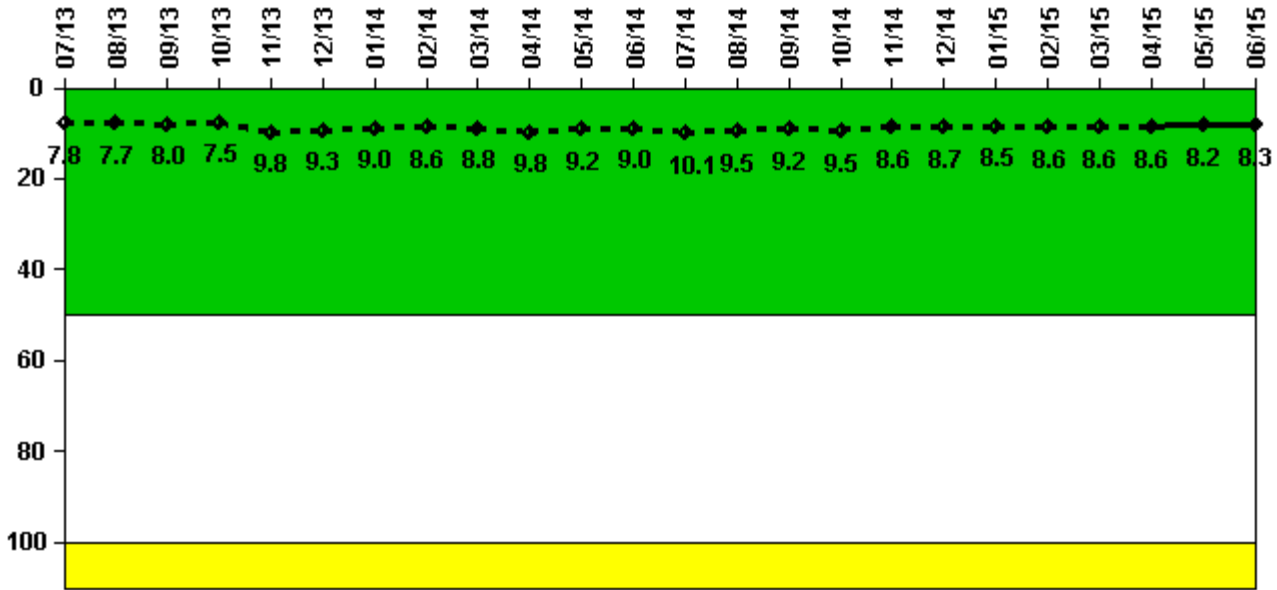


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum leakage	1.960	1.920	1.990	1.870	2.460	2.330	2.250	2.160	2.200	2.450	2.300	2.250
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.8	7.7	8.0	7.5	9.8	9.3	9.0	8.6	8.8	9.8	9.2	9.0
Reactor Coolant System Leakage	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15
Maximum leakage	2.530	2.370	2.290	2.370	2.150	2.170	2.120	2.160	2.140	2.140	2.040	2.080
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	10.1	9.5	9.2	9.5	8.6	8.7	8.5	8.6	8.6	8.6	8.2	8.3

Licensee Comments: none

Drill/Exercise Performance

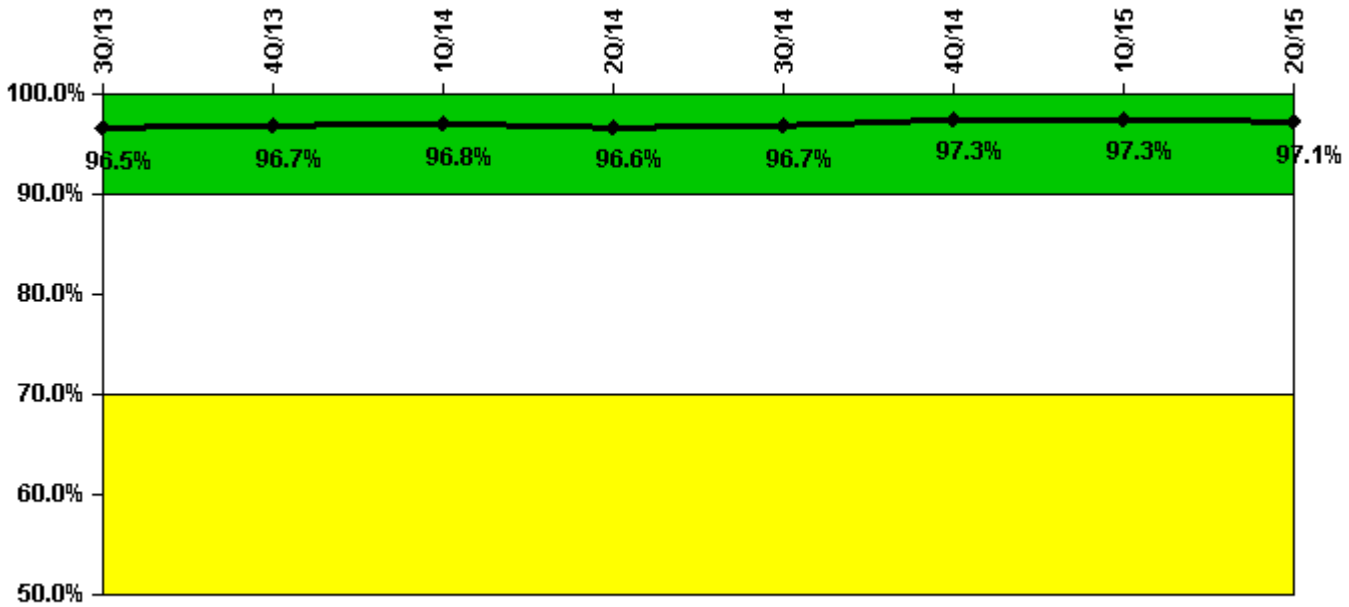

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Successful opportunities	48.0	29.0	41.0	34.0	58.0	27.0	34.0	29.0
Total opportunities	50.0	30.0	42.0	35.0	59.0	27.0	36.0	30.0
Indicator value	96.5%	96.7%	96.8%	96.6%	96.7%	97.3%	97.3%	97.1%

Licensee Comments:

3Q/13: As a result of a Focused Area Self Assessment the PI Data for this quarter corrected/reduced by 5 notification opportunities in Salem simulator due to not having sufficient supporting documentation for credit. Result of correction did not significantly impact overall performance percentage. No change in color. Notification 20643482 initiated in Corrective Action Program.

ERO Drill Participation

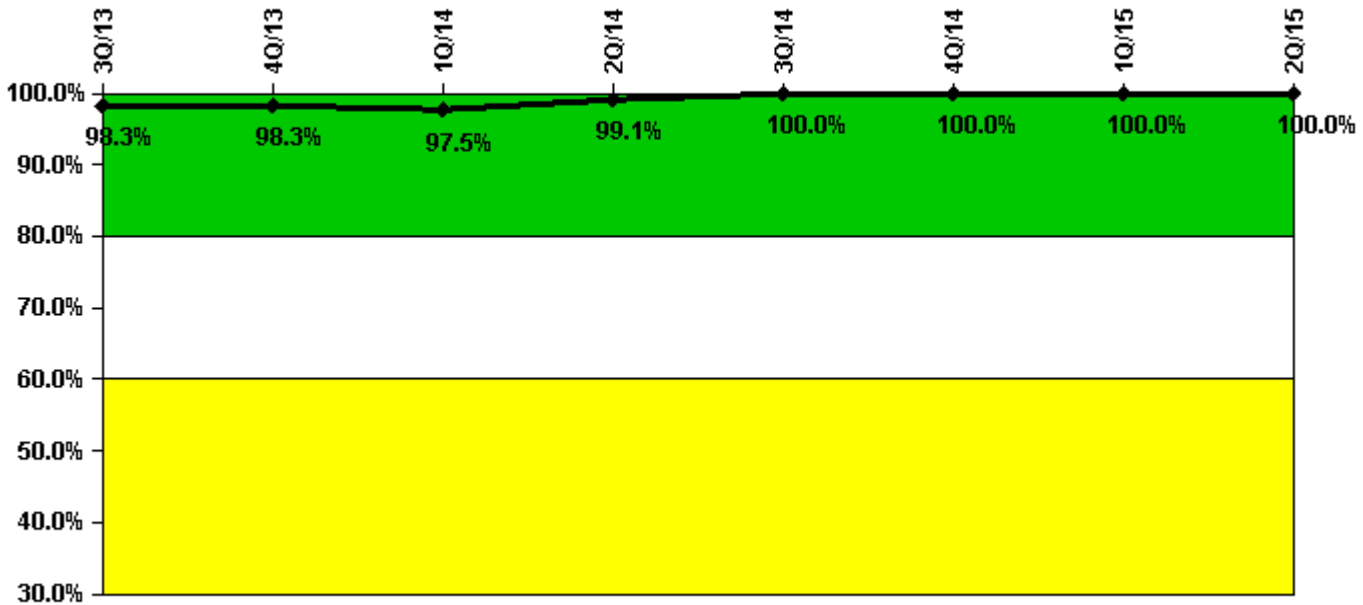

Thresholds: White < 80.0% Yellow < 60.0%

Notes


ERO Drill Participation	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Participating Key personnel	117.0	116.0	117.0	111.0	116.0	120.0	116.0	119.0
Total Key personnel	119.0	118.0	120.0	112.0	116.0	120.0	116.0	119.0
Indicator value	98.3%	98.3%	97.5%	99.1%	100.0%	100.0%	100.0%	100.0%

Licensee Comments:

4Q/13: As a result of a Focused Area Self Assessment the number of Participating Key Personnel was corrected/reduced by 2. After review it was determined that two individuals did not participate in a Performance Enhancing Experience. Result of correction did not significantly impact overall performance percentage. No change in color. Notification 20643482 initiated in Corrective Action Program.

3Q/13: As a result of a Focused Area Self Assessment the number of Participating Key Personnel was corrected/reduced by 2. After review it was determined that two individuals did not participate in a Performance Enhancing Experience. Result of correction did not significantly impact overall performance percentage. No change in color. Notification 20643482 initiated in Corrective Action Program.

Alert & Notification System

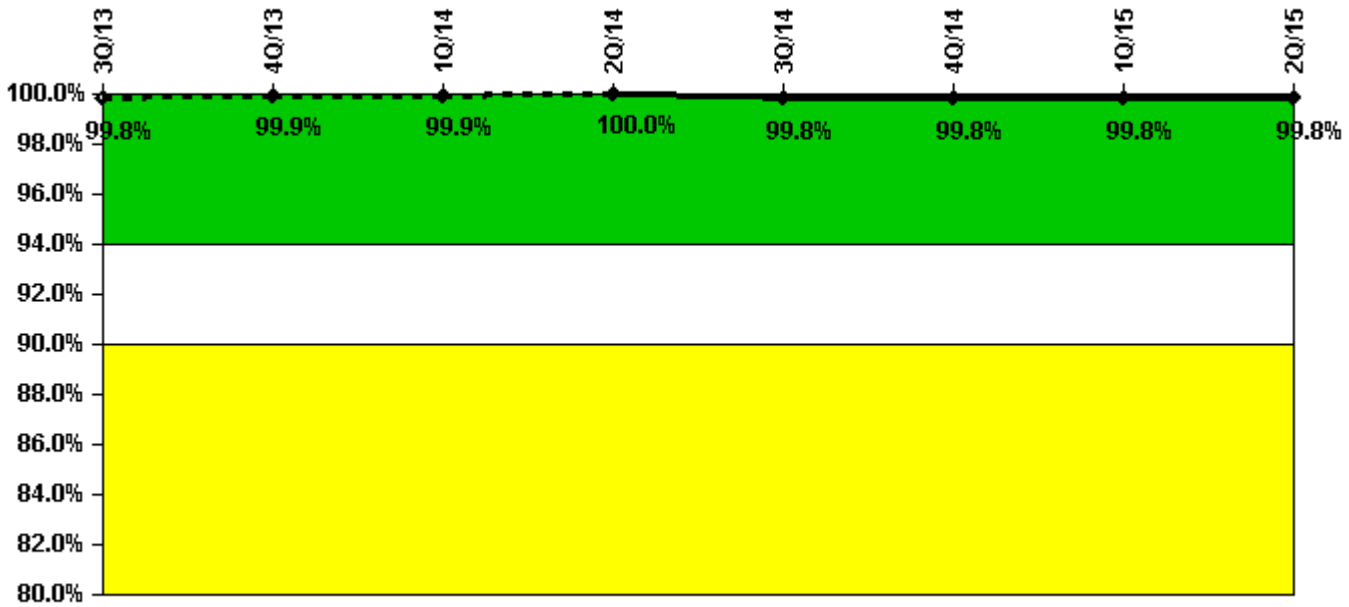


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Successful siren-tests	497	497	497	497	494	497	497	497
Total sirens-tests	497	497	497	497	497	497	497	497
Indicator value	99.8%	99.9%	99.9%	100.0%	99.8%	99.8%	99.8%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

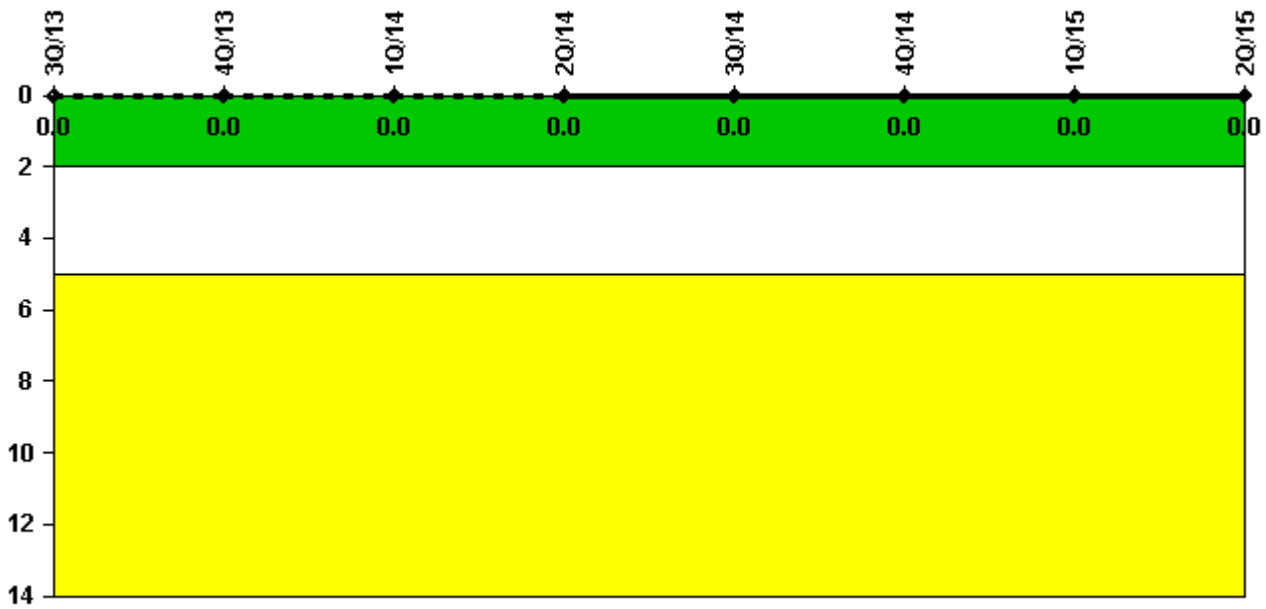


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

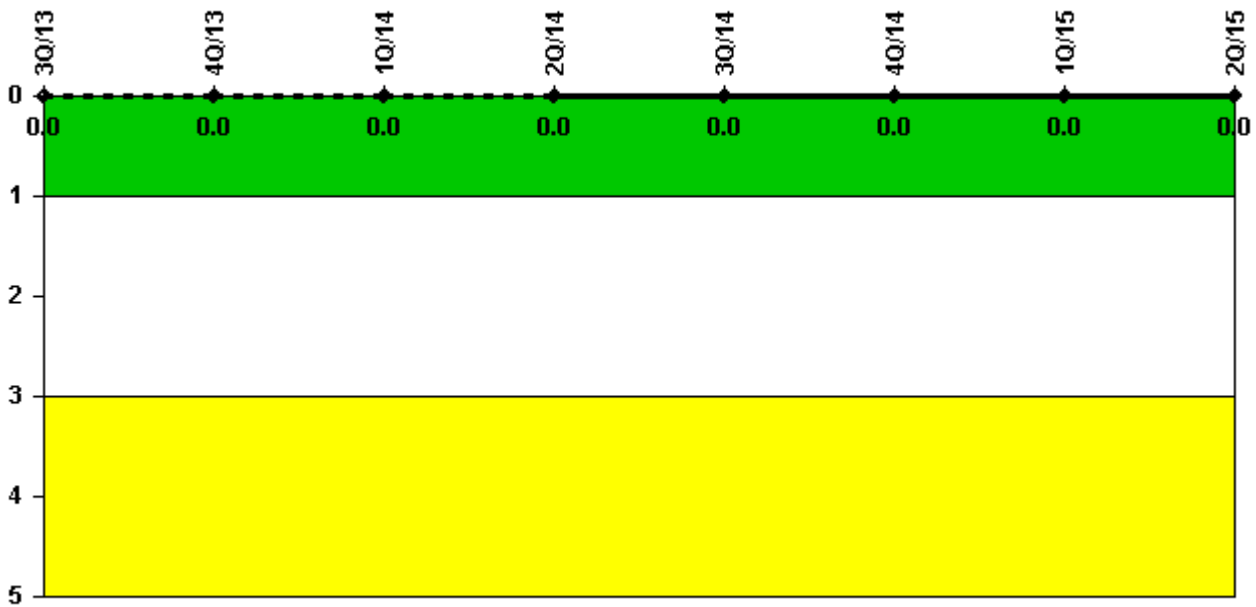

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: July 24, 2015