


## Indian Point 2

### 2Q/2015 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

#### Unplanned Scrams per 7000 Critical Hrs

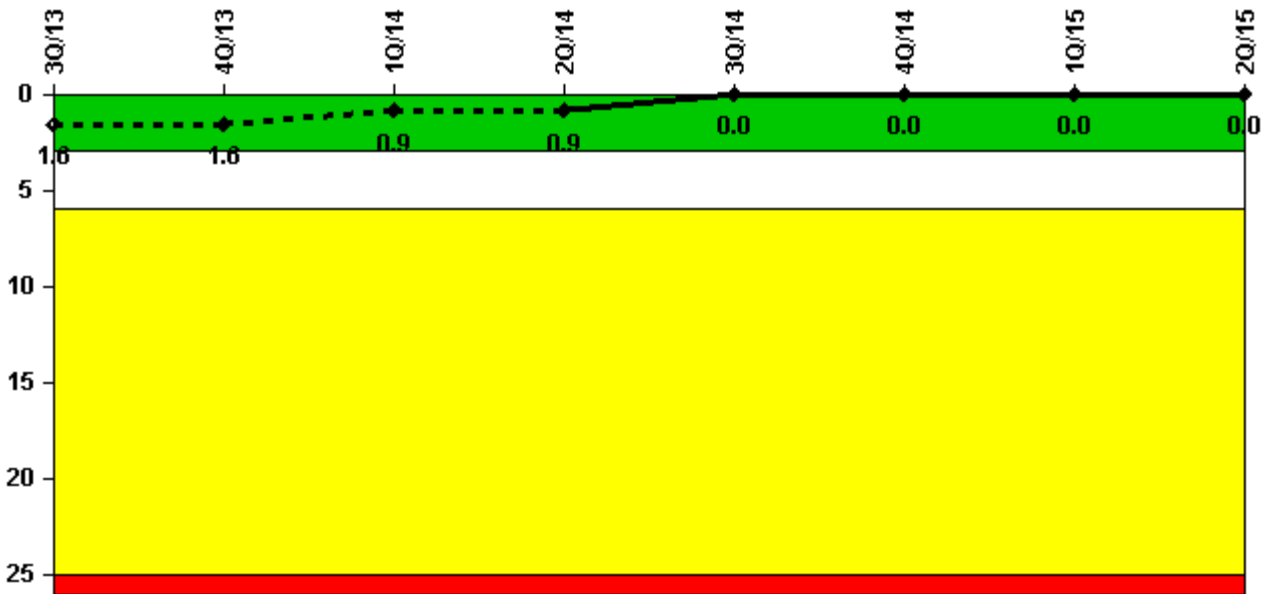


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

#### Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Unplanned scrams	1.0	0	0	0	0	0	0	0
Critical hours	2189.3	2209.0	1619.8	2184.0	2208.0	2209.0	2159.0	2184.0
<b>Indicator value</b>	<b>1.6</b>	<b>1.6</b>	<b>0.9</b>	<b>0.9</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

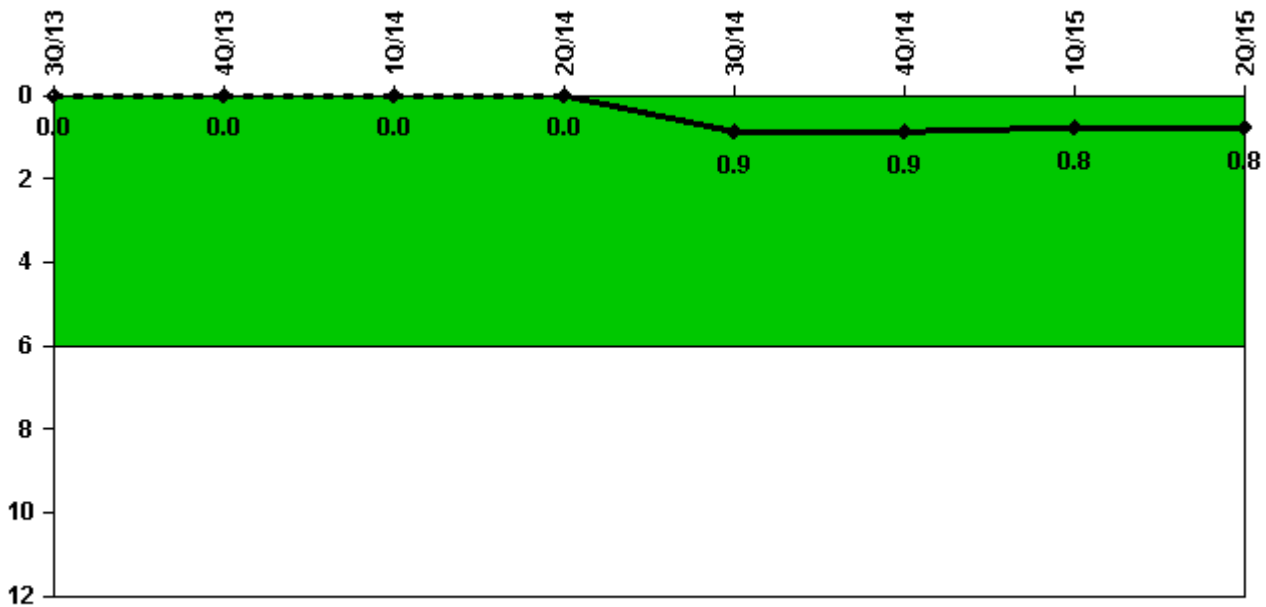

Thresholds: White > 6.0


#### Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Unplanned power changes	0	0	0	0	1.0	0	0	0
Critical hours	2189.3	2209.0	1619.8	2184.0	2208.0	2209.0	2159.0	2184.0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0.9</b>	<b>0.9</b>	<b>0.8</b>	<b>0.8</b>

Licensee Comments:

3Q/14: Unplanned power change on September 18, 2014, due to Technical Specification required power change as a result of misaligned control rod/shutdown bank B during testing. Power reduced to approximately 70%.

### Unplanned Scrams with Complications

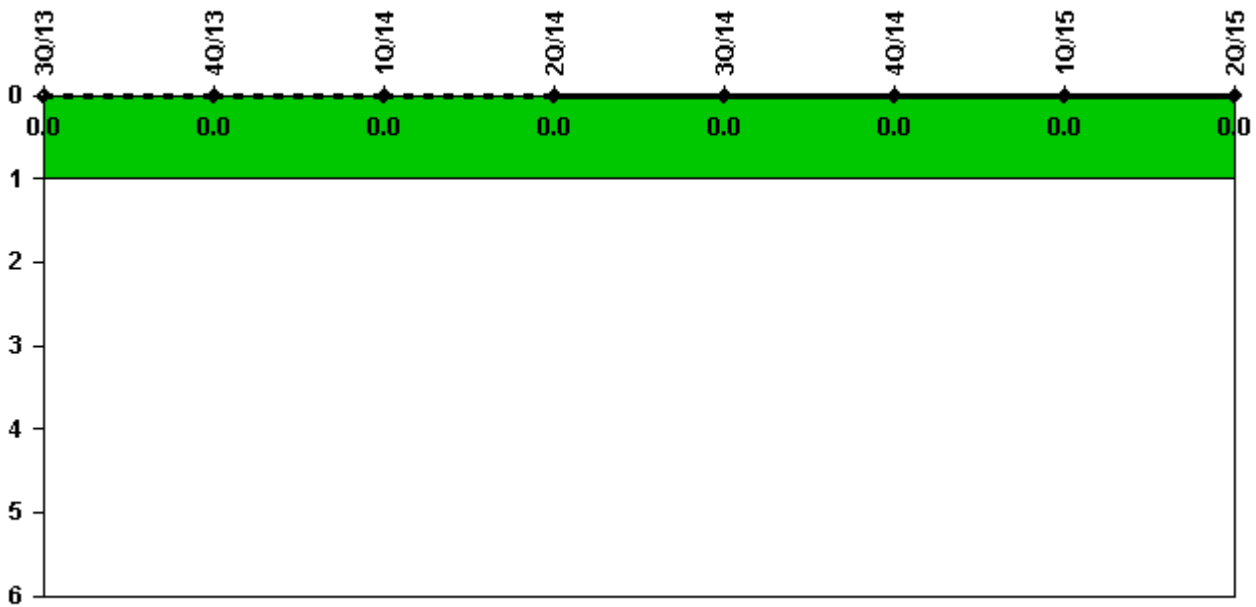


Thresholds: White > 1.0

#### Notes

Unplanned Scrams with Complications	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Scrams with complications	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>

Licensee Comments: none

### Safety System Functional Failures (PWR)

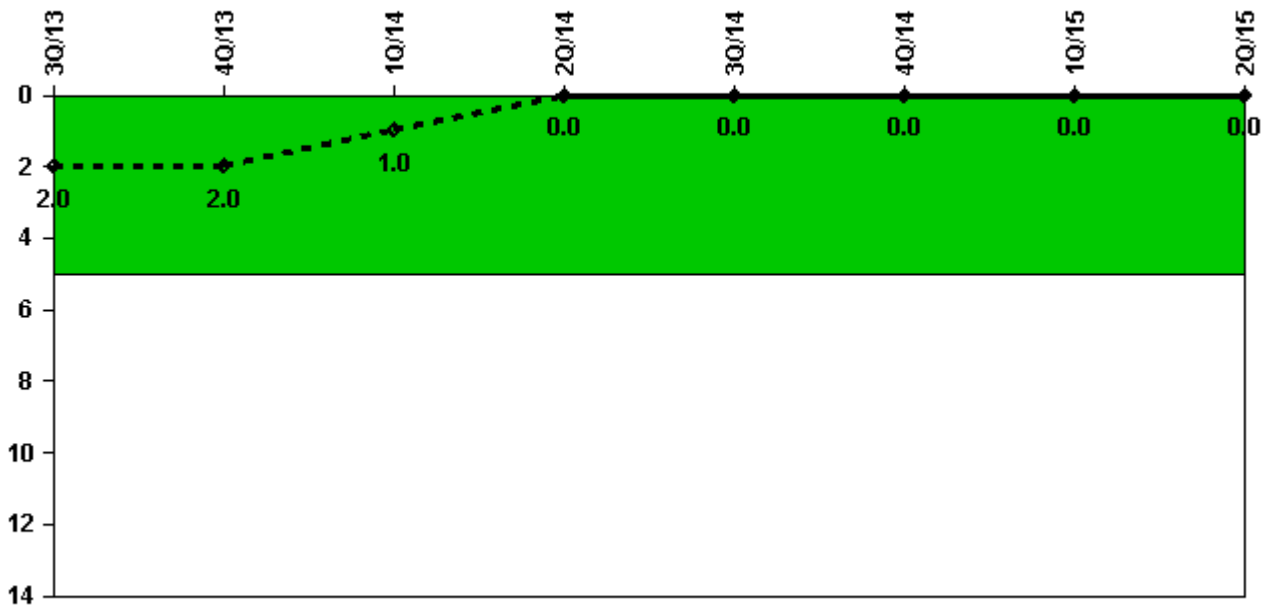


Thresholds: White > 5.0

#### Notes

Safety System Functional Failures (PWR)	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Safety System Functional Failures	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>2</b>	<b>2</b>	<b>1</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### Mitigating Systems Performance Index, Emergency AC Power System

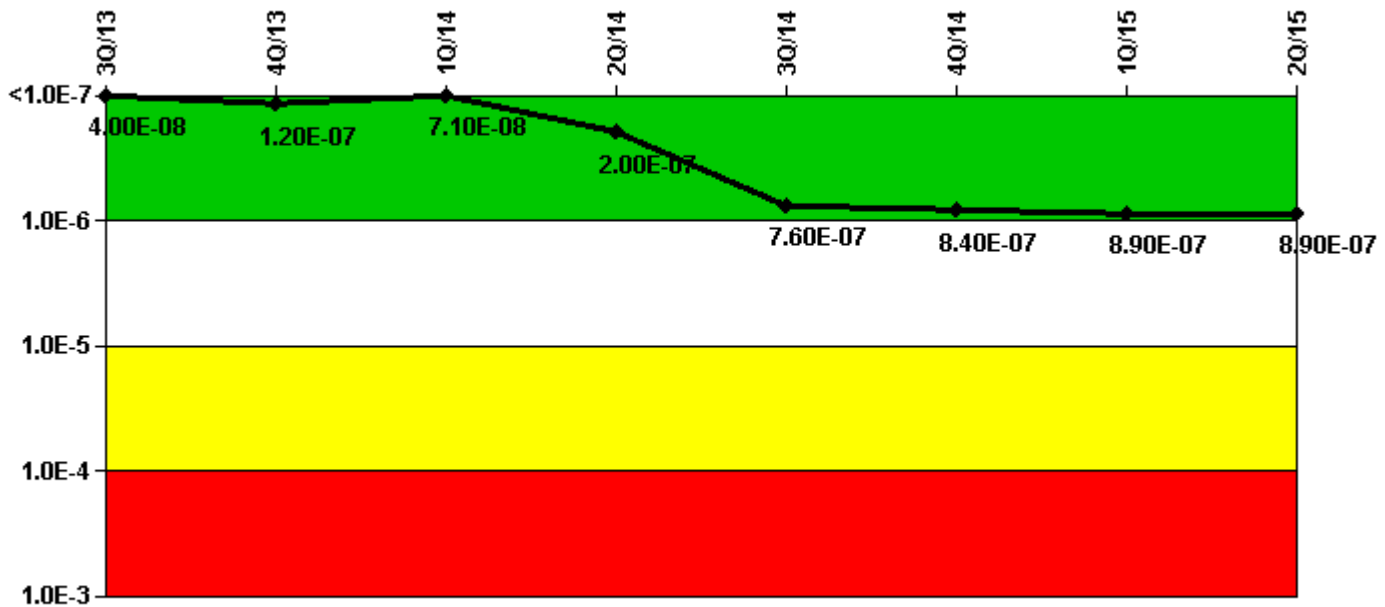

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	2.29E-07	2.80E-07	2.73E-07	3.56E-07	3.65E-07	4.23E-07	3.76E-07	3.77E-07
URI ( $\Delta$ CDF)	-1.89E-07	-1.59E-07	-2.03E-07	-1.59E-07	3.93E-07	4.15E-07	5.12E-07	5.14E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	4.00E-08	1.20E-07	7.10E-08	2.00E-07	7.60E-07	8.40E-07	8.90E-07	8.90E-07

Licensee Comments:

2Q/15: Risk Cap Invoked.

1Q/15: Risk Cap Invoked.

4Q/14: Risk Cap Invoked.

3Q/14: Risk Cap Invoked. On September 12, 2014, a lube oil leak was discovered on the vitaulic coupling of the 23 EDG during post maintenance testing. EDG secured. MSPI Run Failure.

### Mitigating Systems Performance Index, High Pressure Injection System




Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	5.22E-11	5.76E-11	6.60E-11	5.21E-11	5.05E-11	-3.50E-11	-3.95E-11	-2.54E-11
URI ( $\Delta$ CDF)	-2.71E-10	-2.78E-10	-2.92E-10	-3.05E-10	-3.19E-10	-3.27E-10	-3.18E-10	-3.11E-10
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.20E-10	-2.20E-10	-2.30E-10	-2.50E-10	-2.70E-10	-3.60E-10	-3.60E-10	-3.40E-10

Licensee Comments: none

### Mitigating Systems Performance Index, Heat Removal System

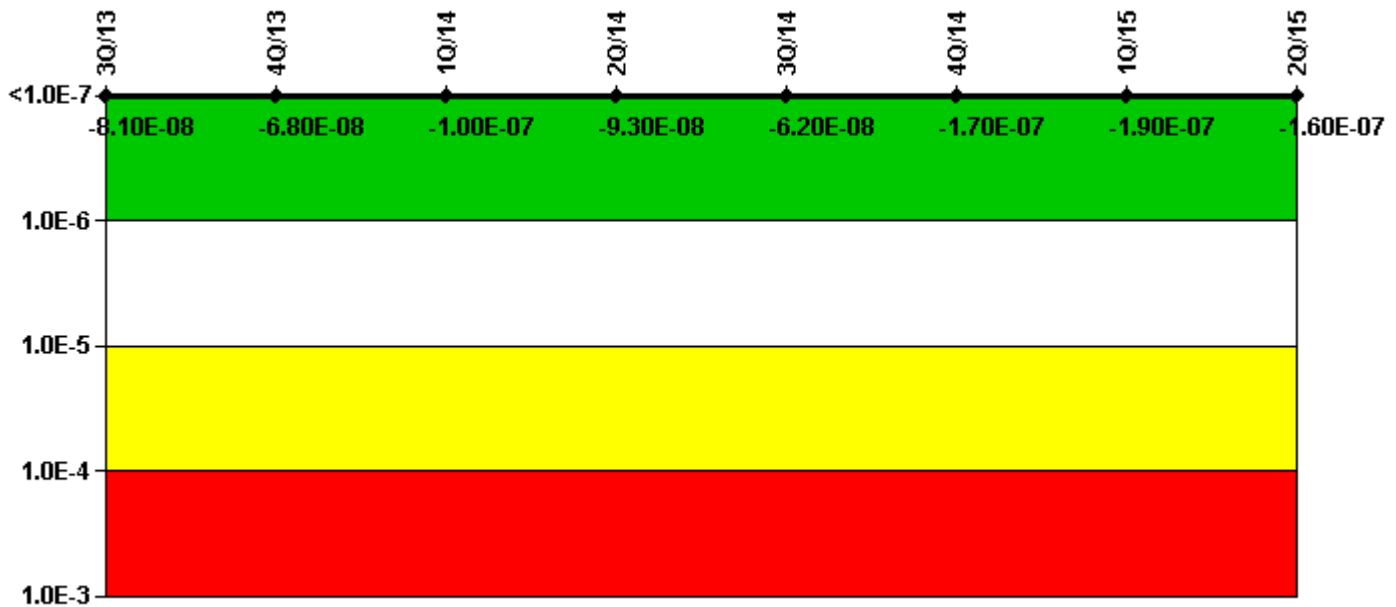


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	-2.99E-08	-2.98E-08	-2.85E-08	-2.72E-08	3.81E-09	2.10E-08	5.35E-10	1.06E-08
URI ( $\Delta$ CDF)	-5.07E-08	-3.86E-08	-7.36E-08	-6.60E-08	-6.59E-08	-1.93E-07	-1.86E-07	-1.71E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.10E-08	-6.80E-08	-1.00E-07	-9.30E-08	-6.20E-08	-1.70E-07	-1.90E-07	-1.60E-07

Licensee Comments: none

### Mitigating Systems Performance Index, Residual Heat Removal System

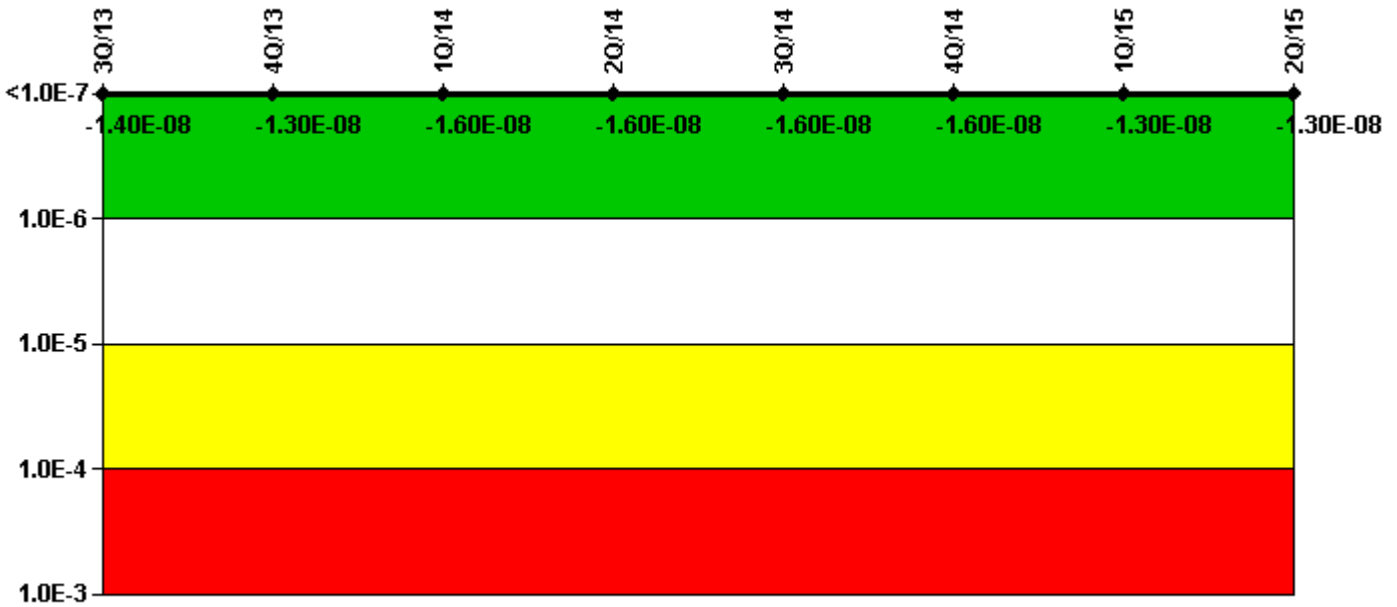

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	-4.17E-09	-4.03E-09	-3.91E-09	-3.97E-09	-3.97E-09	-4.19E-09	-4.35E-09	-4.36E-09
URI ( $\Delta$ CDF)	-9.89E-09	-9.12E-09	-1.17E-08	-1.17E-08	-1.17E-08	-1.17E-08	-8.35E-09	-8.26E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.40E-08	-1.30E-08	-1.60E-08	-1.60E-08	-1.60E-08	-1.60E-08	-1.30E-08	-1.30E-08

Licensee Comments: none



### Mitigating Systems Performance Index, Cooling Water Systems

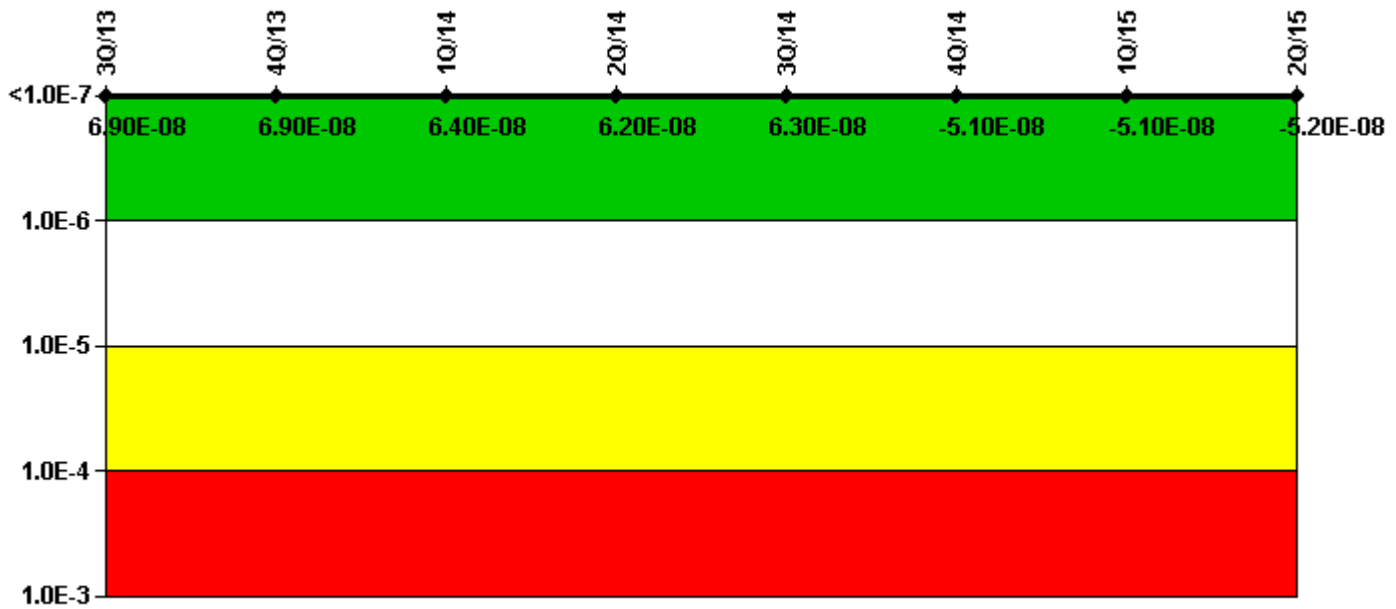


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	2.65E-09	-1.93E-09	-3.47E-09	-3.28E-09	-3.61E-09	-4.38E-09	-4.67E-09	-5.17E-09
URI ( $\Delta$ CDF)	6.67E-08	7.05E-08	6.71E-08	6.55E-08	6.66E-08	-4.68E-08	-4.64E-08	-4.64E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	6.90E-08	6.90E-08	6.40E-08	6.20E-08	6.30E-08	-5.10E-08	-5.10E-08	-5.20E-08

Licensee Comments: none

### Reactor Coolant System Activity

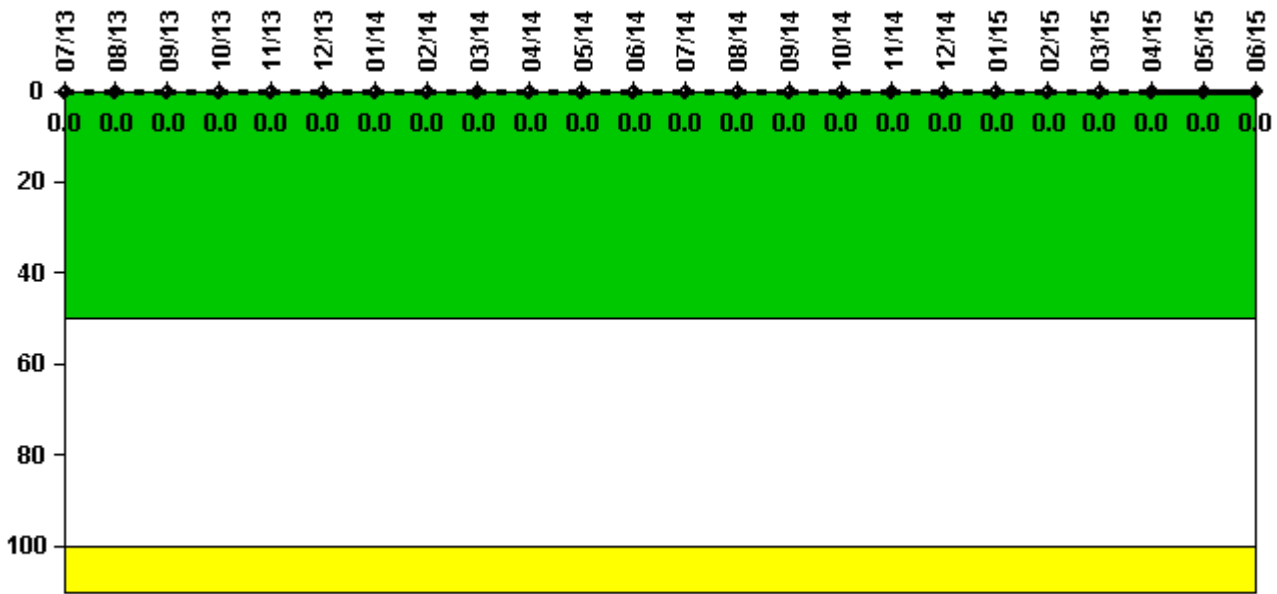


Thresholds: White > 50.0 Yellow > 100.0

#### Notes

Reactor Coolant System Activity	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum activity	0.000258	0.000239	0.000204	0.000257	0.000273	0.000276	0.000278	0.000334	0.000125	0.000159	0.000133	0.000165
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15
Maximum activity	0.000153	0.000141	0.000148	0.000158	0.000170	0.000175	0.000175	0.000170	0.000195	0.000182	0.000179	0.000190
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

### Reactor Coolant System Leakage

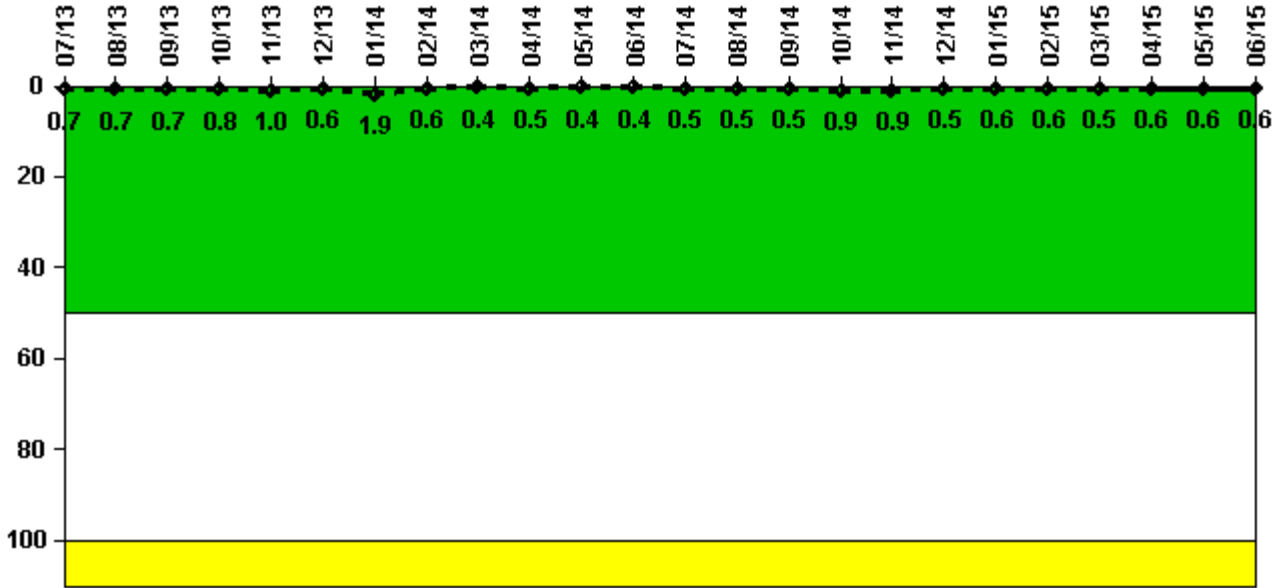

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Leakage	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum leakage	0.071	0.070	0.070	0.080	0.100	0.060	0.190	0.060	0.040	0.050	0.040	0.040
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	<b>0.7</b>	<b>0.7</b>	<b>0.7</b>	<b>0.8</b>	<b>1.0</b>	<b>0.6</b>	<b>1.9</b>	<b>0.6</b>	<b>0.4</b>	<b>0.5</b>	<b>0.4</b>	<b>0.4</b>

Reactor Coolant System Leakage	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15
Maximum leakage	0.050	0.050	0.050	0.090	0.090	0.053	0.060	0.060	0.050	0.060	0.060	0.060
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	<b>0.5</b>	<b>0.5</b>	<b>0.5</b>	<b>0.9</b>	<b>0.9</b>	<b>0.5</b>	<b>0.6</b>	<b>0.6</b>	<b>0.5</b>	<b>0.6</b>	<b>0.6</b>	<b>0.6</b>

Licensee Comments: none

### Drill/Exercise Performance

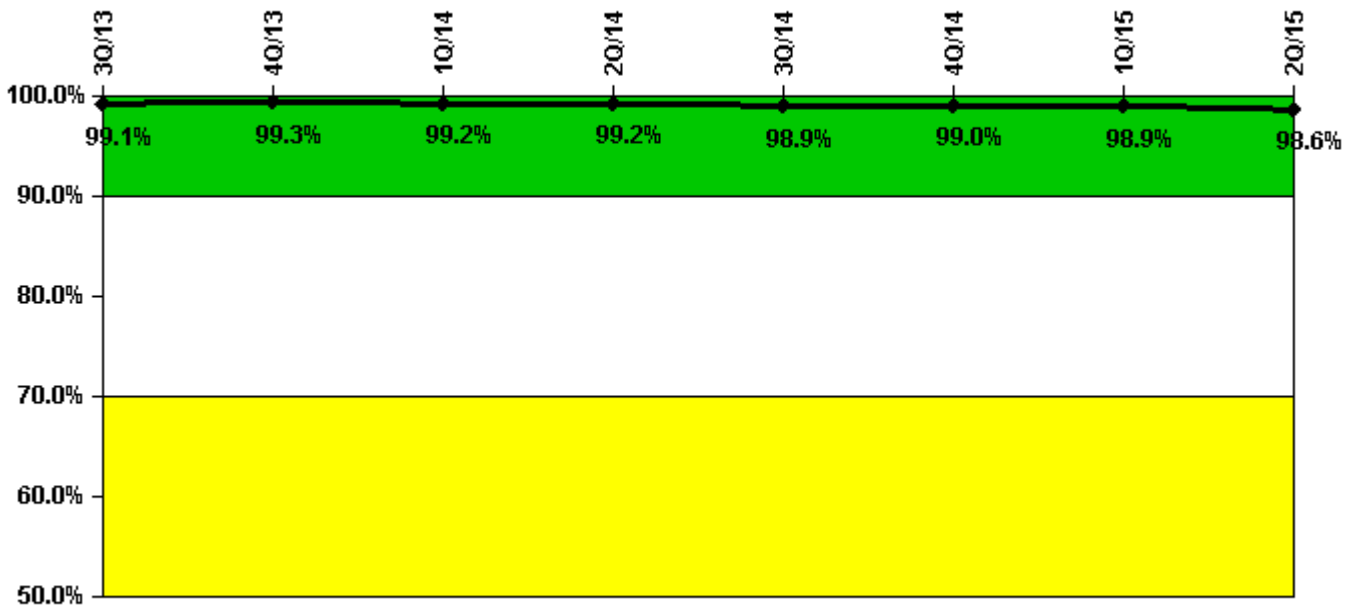


Thresholds: White < 90.0% Yellow < 70.0%

#### Notes

Drill/Exercise Performance	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Successful opportunities	291.0	127.0	50.0	110.0	200.0	109.0	20.0	71.0
Total opportunities	297.0	127.0	51.0	112.0	203.0	109.0	21.0	72.0
Indicator value	99.1%	99.3%	99.2%	99.2%	98.9%	99.0%	98.9%	98.6%

Licensee Comments: none

### ERO Drill Participation

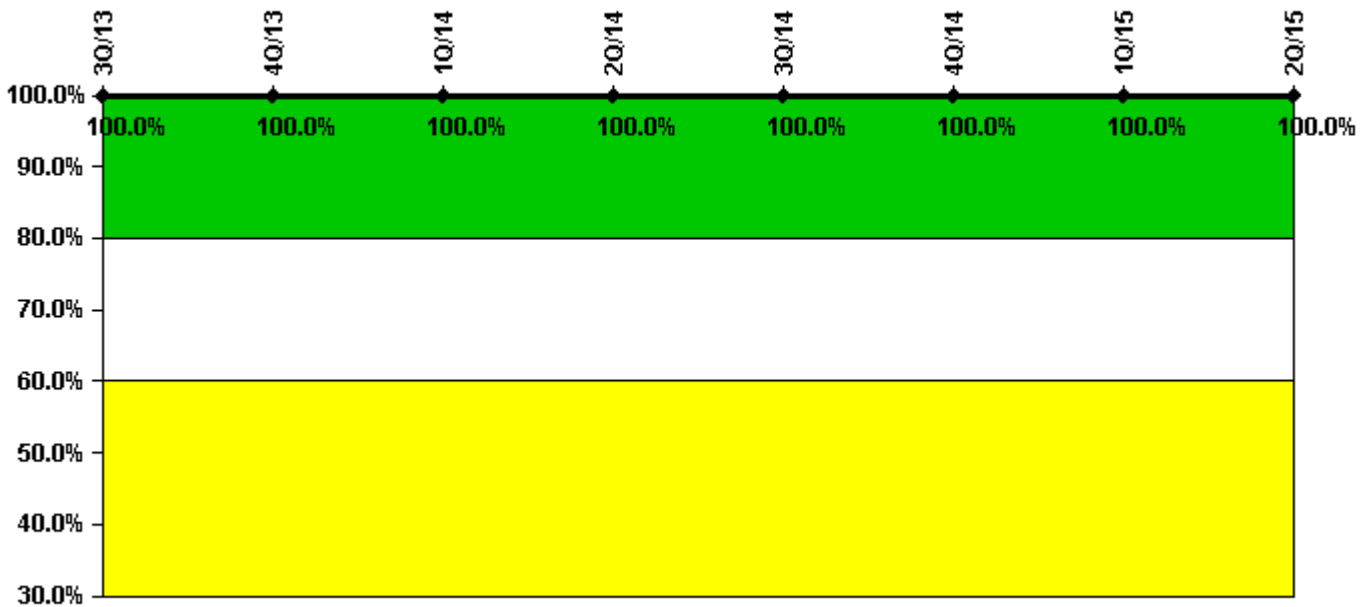


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Participating Key personnel	109.0	111.0	104.0	104.0	100.0	106.0	104.0	104.0
Total Key personnel	109.0	111.0	104.0	104.0	100.0	106.0	104.0	104.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

### Alert & Notification System

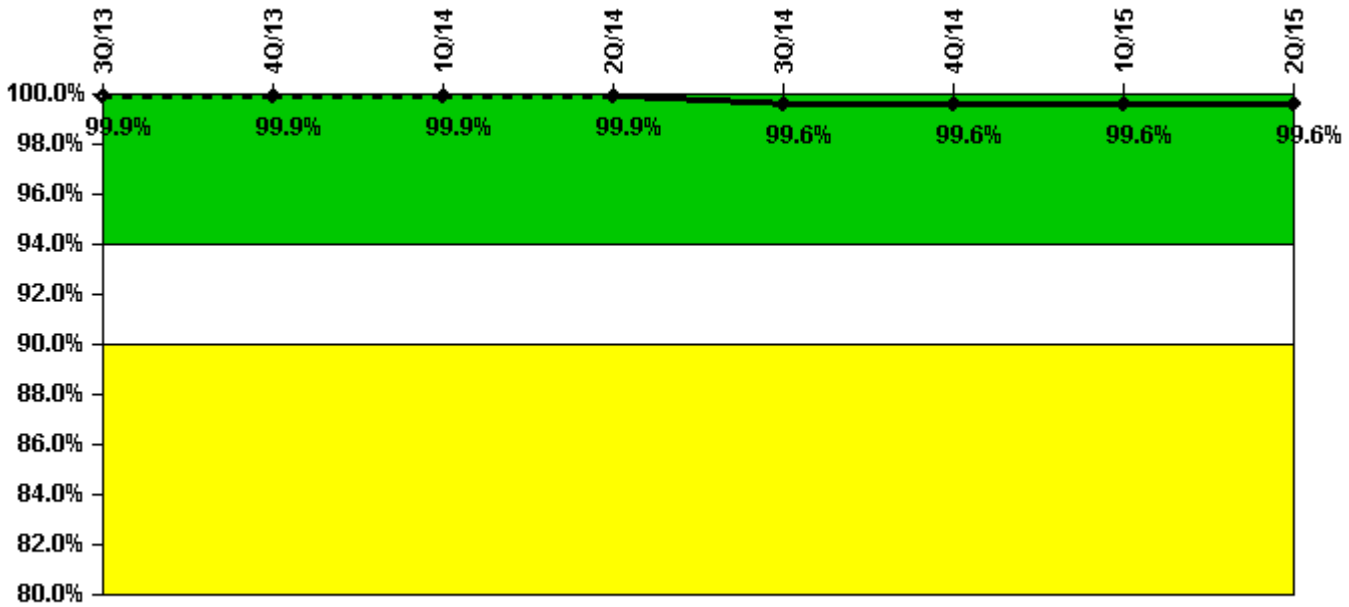


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Successful siren-tests	936	1226	1148	1079	1110	1104	1135	917
Total sirens-tests	938	1227	1148	1081	1126	1104	1135	917
Indicator value	99.9%	99.9%	99.9%	99.9%	99.6%	99.6%	99.6%	99.6%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

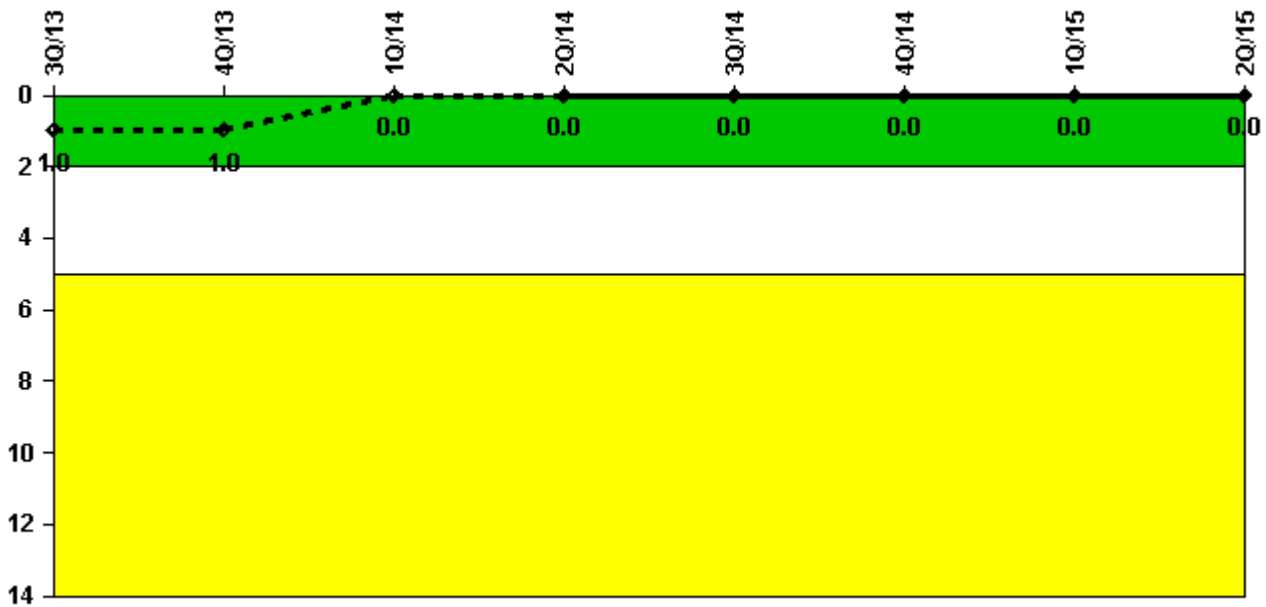


Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>1</b>	<b>1</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### RETS/ODCM Radiological Effluent

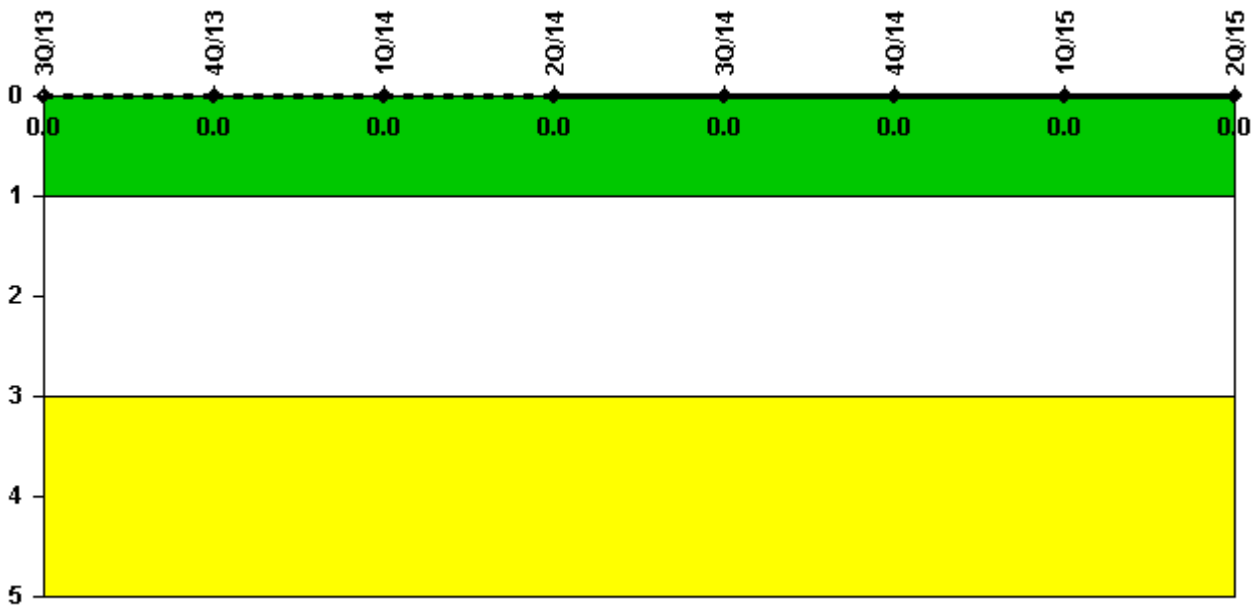

Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.



 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

*Last Modified: July 24, 2015*