


## Indian Point 3

### 2Q/2015 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

#### Unplanned Scrams per 7000 Critical Hrs

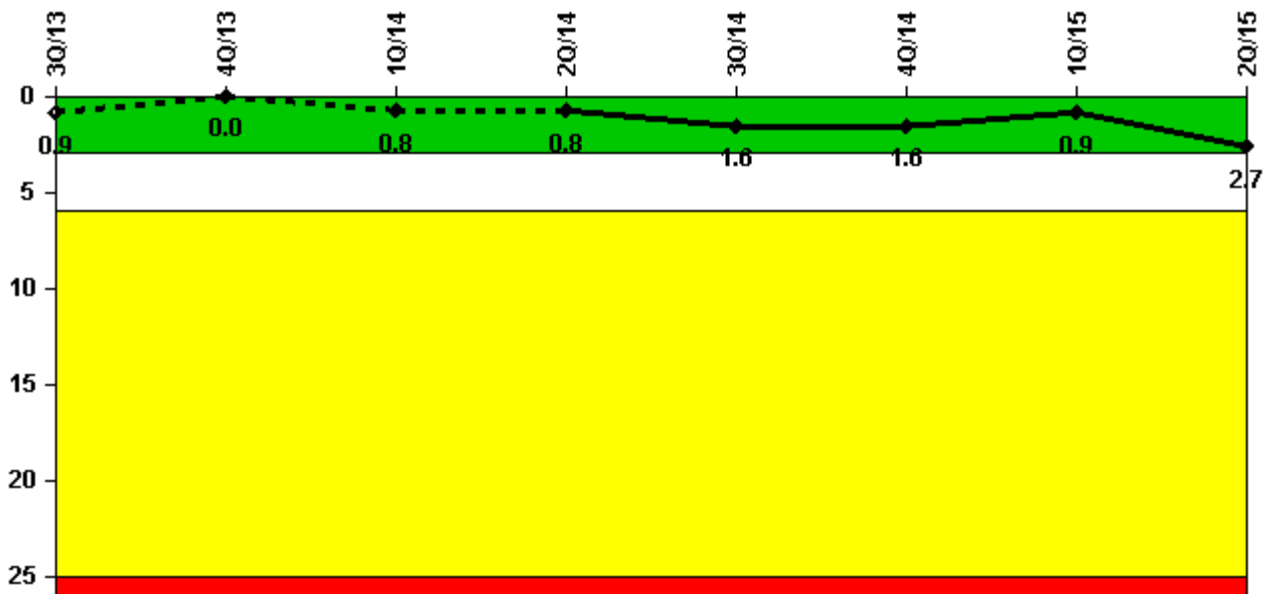

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

#### Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Unplanned scrams	0	0	1.0	0	1.0	0	0	2.0
Critical hours	2138.6	2209.0	2129.5	2184.0	2161.6	2209.0	1626.7	1788.8
<b>Indicator value</b>	<b>0.9</b>	<b>0</b>	<b>0.8</b>	<b>0.8</b>	<b>1.6</b>	<b>1.6</b>	<b>0.9</b>	<b>2.7</b>

Licensee Comments:


2Q/15: On May 9, 2015 an automatic reactor trip occurred due to a turbine-generator trip as a result of the failure of the 31 main transformer. Direct cause was an internal fault of the A phase high voltage winding in the upper portion of the transformer. LER-2015-004 reported the event. On June 15, 2015, an automatic reactor trip occurred as a result of a turbine-generator trip. Prior to the trip, Con Edison District Operator requested that 345 kV breaker number 1 in the Buchannan Switchyard south ring bus be opened to aid in Con Edison isolation of 345 kV feeder W97 in support of removing a mylar balloon caught in the high voltage wires at Millwood. 345

kV breaker 5 faulted after opening breaker 1 causing breaker 3 to open which initiated a direct generator trip.

3Q/14: On August 13, 2014, an automatic reactor trip occurred during scheduled testing of the reactor protection system pressurizer pressure loop P-455 channel calibration as a result of meeting the trip logic of 2/4 trip logic for over temperature delta temperature. LER-2014-004 reported event.

1Q/14: LER-2014-001 reported an automatic reactor trip January 6, 2014, on steam flow/feedwater flow mismatch with low steam generator level due to feedwater reg valve flow controller failure. PI remains in the Green Band.

### Unplanned Power Changes per 7000 Critical Hrs

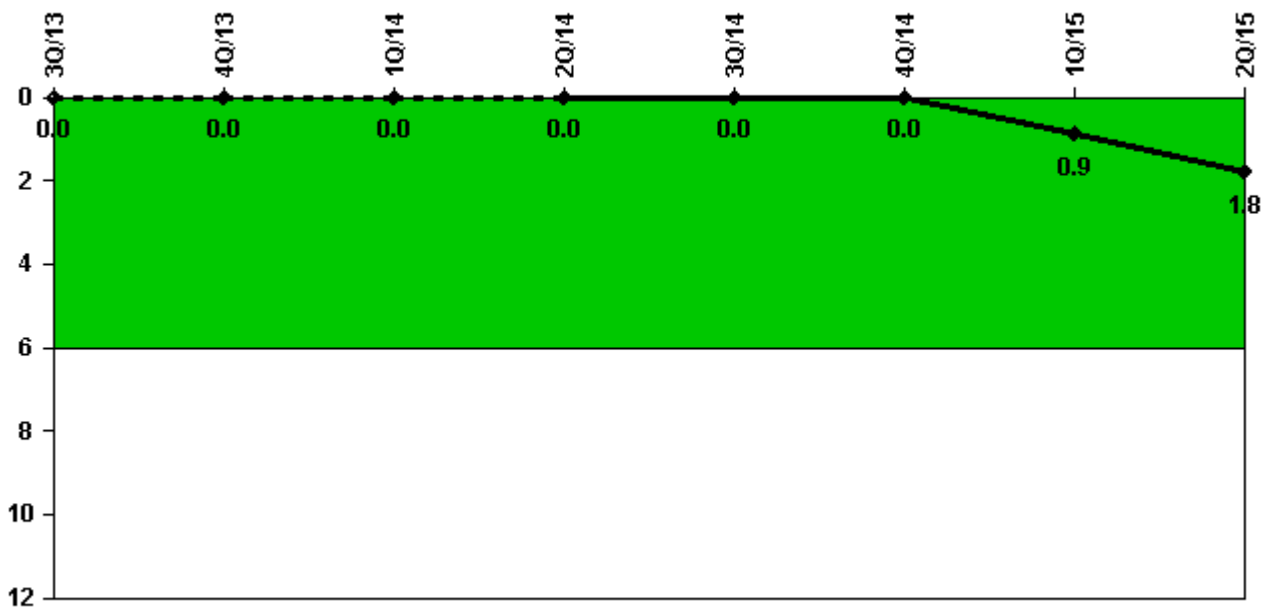

Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Unplanned power changes	0	0	0	0	0	0	1.0	1.0
Critical hours	2138.6	2209.0	2129.5	2184.0	2161.6	2209.0	1626.7	1788.8
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0.9</b>	<b>1.8</b>


Licensee Comments:

2Q/15: On May 7, 2015, the unit initiated a coast down to a planned trip to repair a weld crack on valve BFD-64-10. Valve BFD-64-10 is a low side isolation valve for feedwater flow transmitter FT-438B.

1Q/15: On January 8, 2015, at 04000 hours, entered TS 3.5.4 (RWST) due to both RWST level sensing lines frozen resulting in inoperable low-low level alarms in the control room. At 0700 hours began unit shutdown per

TS for two inoperable RWST level alarms. At 1000 hours, repaired level alarms and halted unit shutdown at 43.3% reactor power.

### Unplanned Scrams with Complications

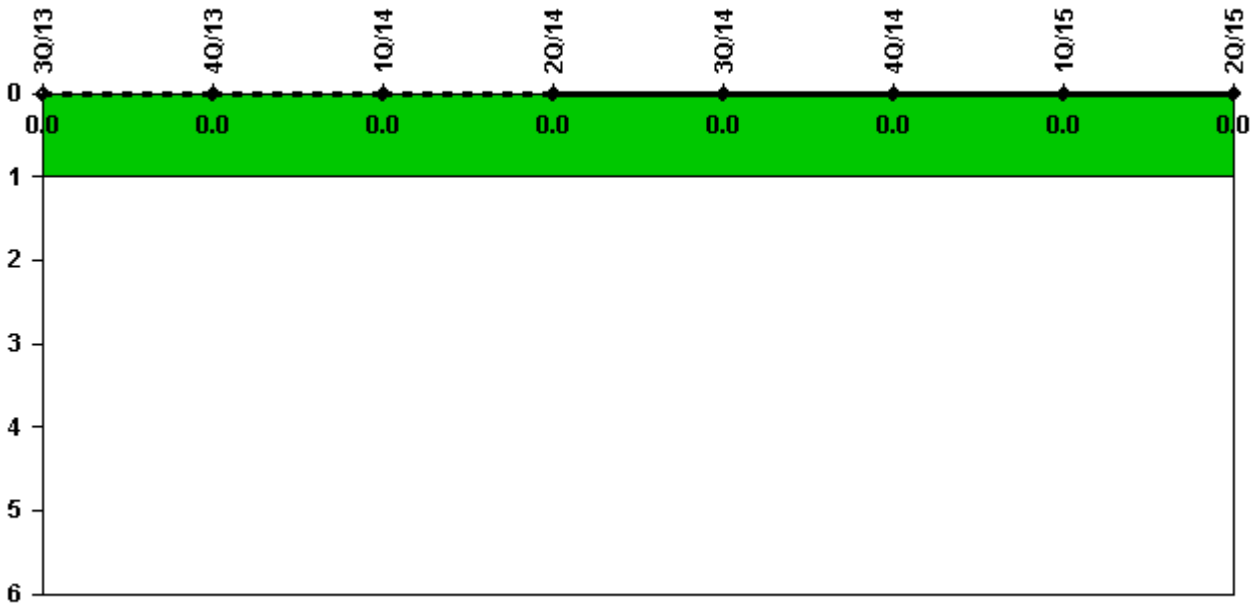


Thresholds: White > 1.0

### Notes

Unplanned Scrams with Complications	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Scrams with complications	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>

Licensee Comments: none

### Safety System Functional Failures (PWR)

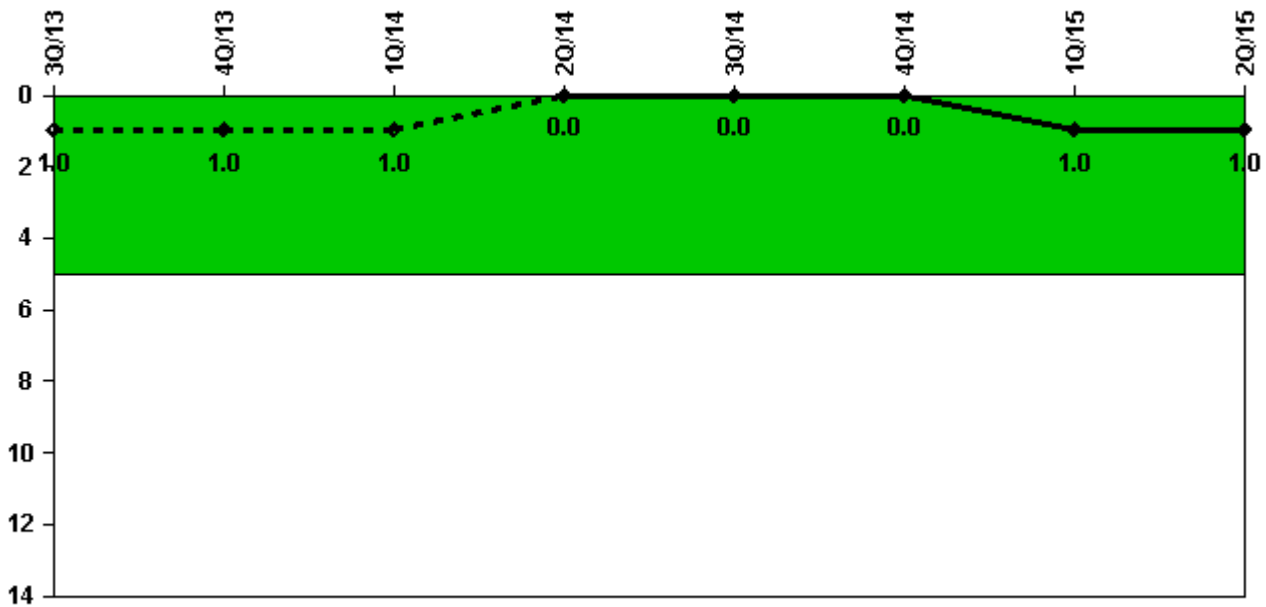

Thresholds: White > 5.0


#### Notes

Safety System Functional Failures (PWR)	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Safety System Functional Failures	0	0	0	0	0	0	1	0
<b>Indicator value</b>	<b>1</b>	<b>1</b>	<b>1</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>1</b>	<b>1</b>

Licensee Comments:

1Q/15: LER-2015-001 submitted on March 3, 2015 for a SSFF and common cause inoperability of independent trains or channels due to discovery on January 8, 2015 of both RWST level instruments sensing lines frozen. Safety function is to alert operators to switch over from the RWST to containment sump during a LOCA.

### Mitigating Systems Performance Index, Emergency AC Power System

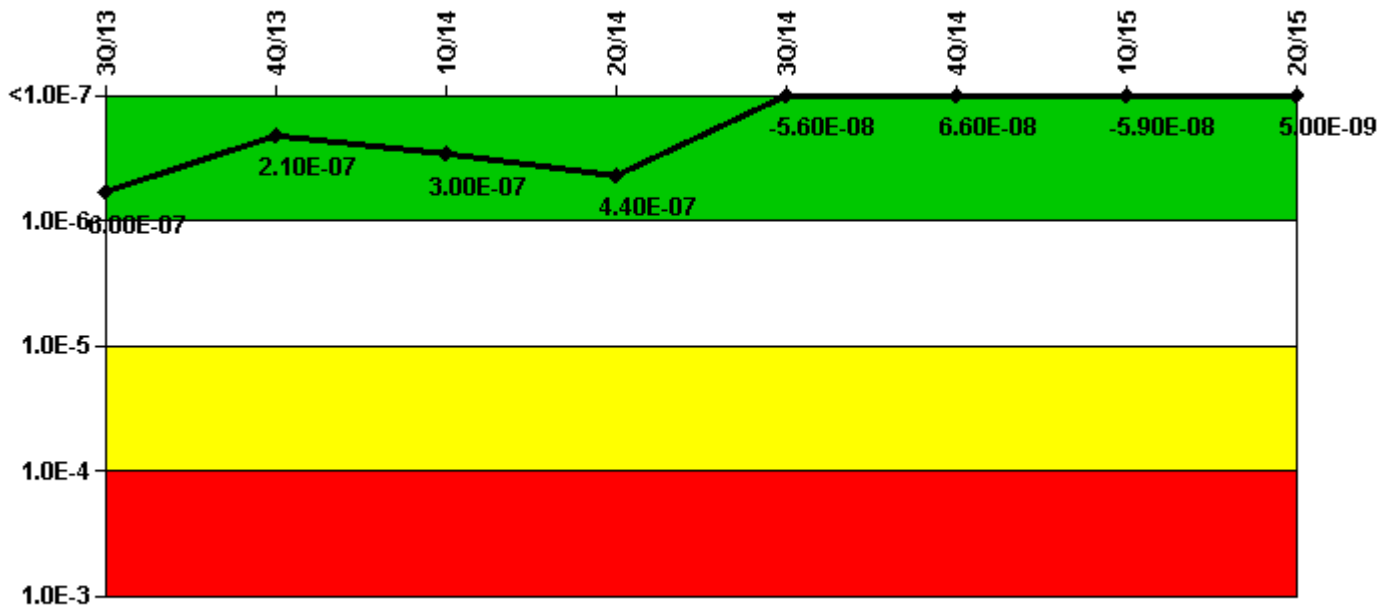

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (ΔCDF)	3.44E-07	3.59E-07	3.45E-07	3.96E-07	3.12E-07	4.07E-07	3.91E-07	4.53E-07
URI (ΔCDF)	2.51E-07	-1.53E-07	-4.10E-08	4.65E-08	-3.68E-07	-3.41E-07	-4.51E-07	-4.48E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
<b>Indicator value</b>	<b>6.00E-07</b>	<b>2.10E-07</b>	<b>3.00E-07</b>	<b>4.40E-07</b>	<b>-5.60E-08</b>	<b>6.60E-08</b>	<b>-5.90E-08</b>	<b>5.00E-09</b>

Licensee Comments:

3Q/14: Auto roll-off after 36 months of the failure of the 33 EDG in September 2011.

### Mitigating Systems Performance Index, High Pressure Injection System

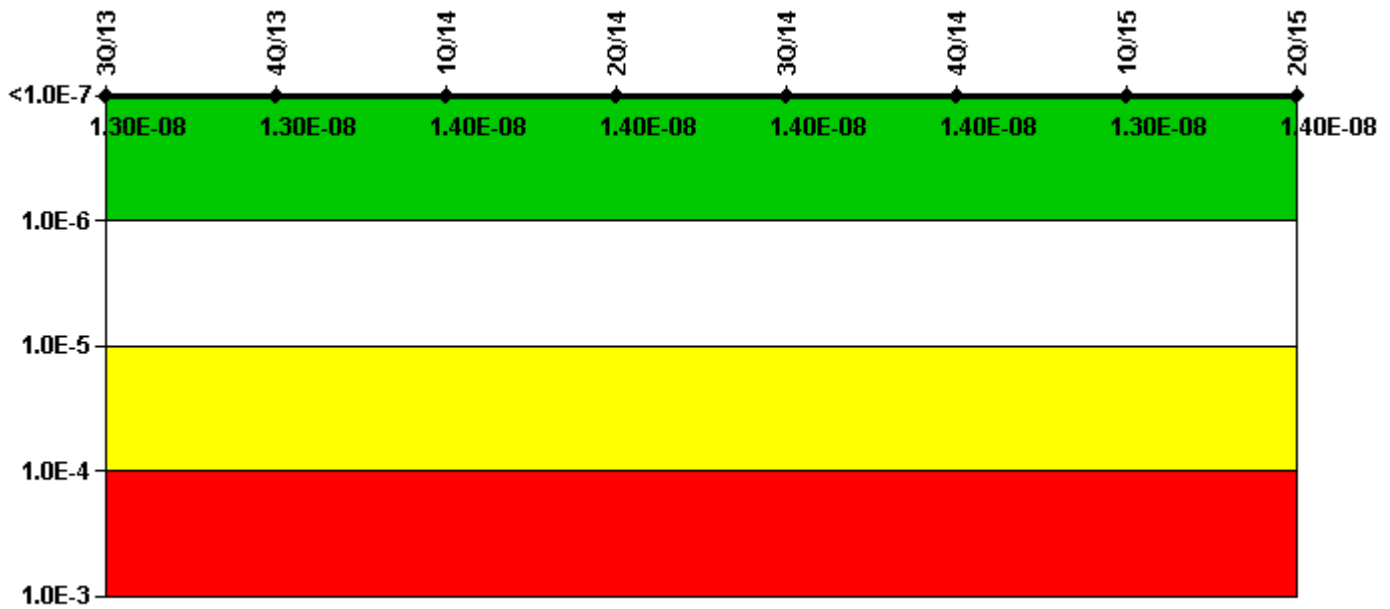


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	2.78E-10	2.45E-10	2.31E-10	2.13E-10	2.18E-10	2.19E-10	2.41E-10	8.60E-10
URI ( $\Delta$ CDF)	1.29E-08	1.30E-08	1.35E-08	1.39E-08	1.40E-08	1.41E-08	1.29E-08	1.30E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.30E-08	1.30E-08	1.40E-08	1.40E-08	1.40E-08	1.40E-08	1.30E-08	1.40E-08

Licensee Comments: none

### Mitigating Systems Performance Index, Heat Removal System

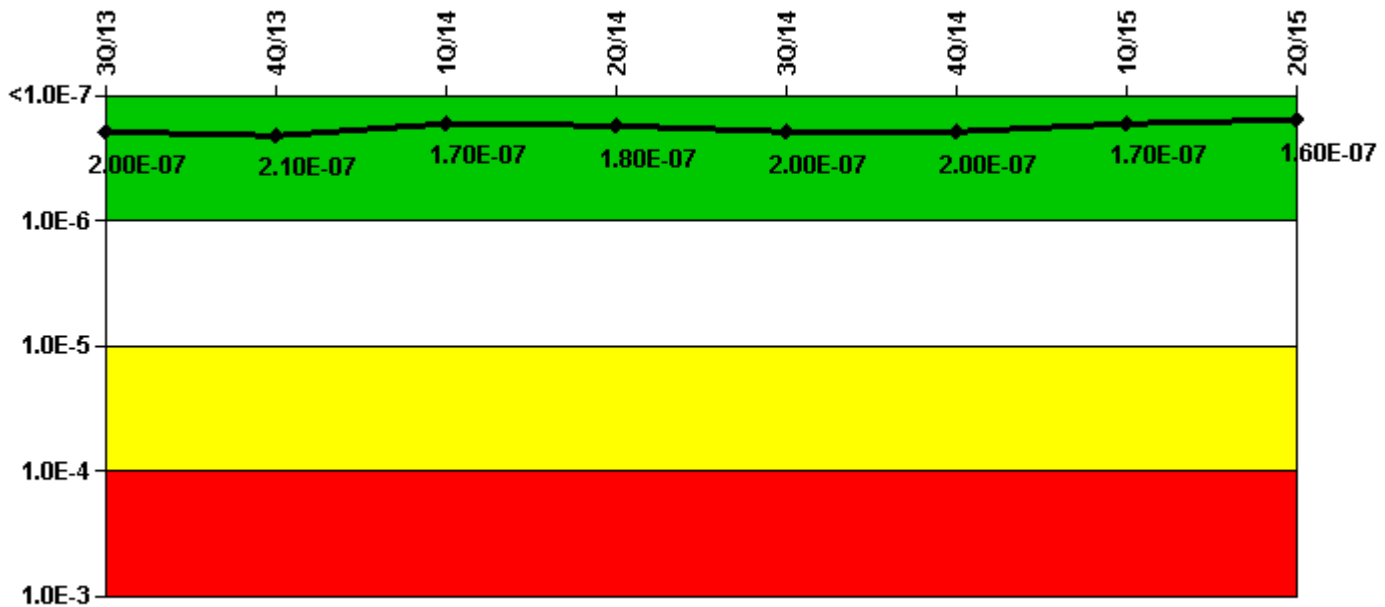

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI (ΔCDF)	1.95E-08	2.76E-08	-1.87E-08	-2.14E-08	-1.52E-08	-1.12E-08	-7.14E-09	-2.73E-09
URI (ΔCDF)	1.80E-07	1.79E-07	1.86E-07	1.99E-07	2.11E-07	2.11E-07	1.79E-07	1.63E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.00E-07	2.10E-07	1.70E-07	1.80E-07	2.00E-07	2.00E-07	1.70E-07	1.60E-07

Licensee Comments:

2Q/15: Risk Cap Invoked.

1Q/15: Risk Cap Invoked.

4Q/14: Risk Cap Invoked.

3Q/14: Risk Cap Invoked.


2Q/14: Risk Cap Invoked.

1Q/14: Risk Cap Invoked.

4Q/13: Risk Cap Invoked.

3Q/13: Risk Cap Invoked.

### Mitigating Systems Performance Index, Residual Heat Removal System

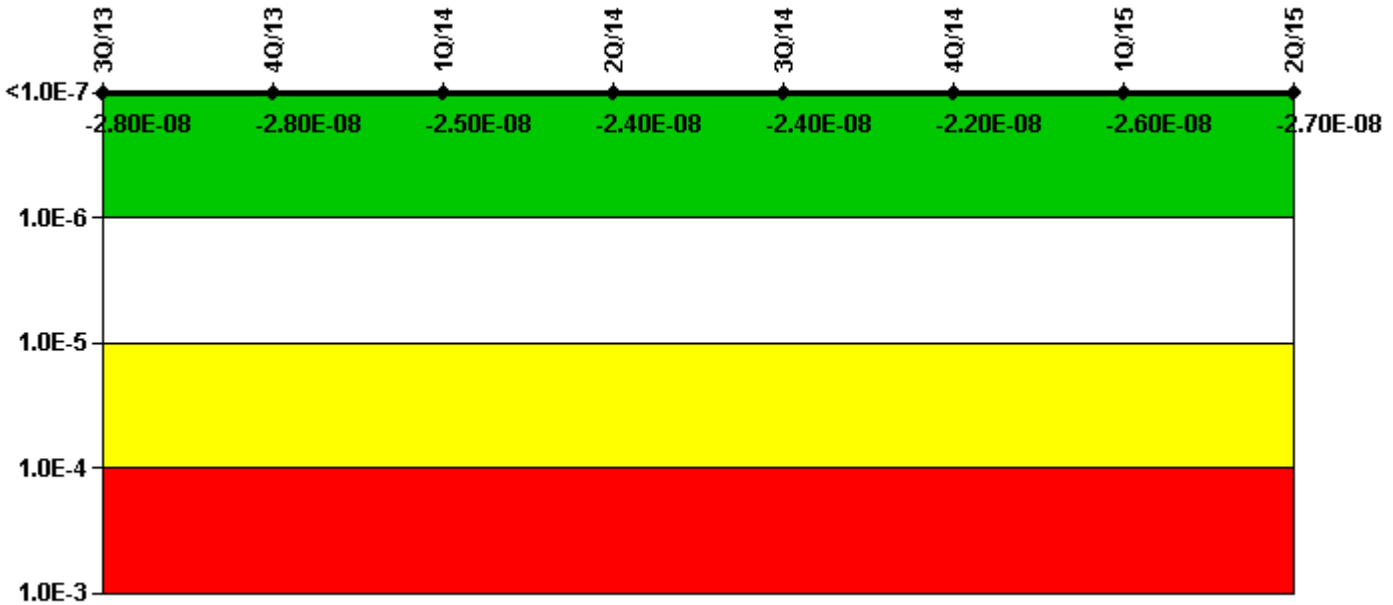

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	-1.36E-08	-1.36E-08	-1.39E-08	-1.45E-08	-1.45E-08	-1.23E-08	-1.20E-08	-1.18E-08
URI ( $\Delta$ CDF)	-1.45E-08	-1.45E-08	-1.08E-08	-9.84E-09	-9.84E-09	-9.84E-09	-1.38E-08	-1.49E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.80E-08	-2.80E-08	-2.50E-08	-2.40E-08	-2.40E-08	-2.20E-08	-2.60E-08	-2.70E-08

Licensee Comments: none



### Mitigating Systems Performance Index, Cooling Water Systems

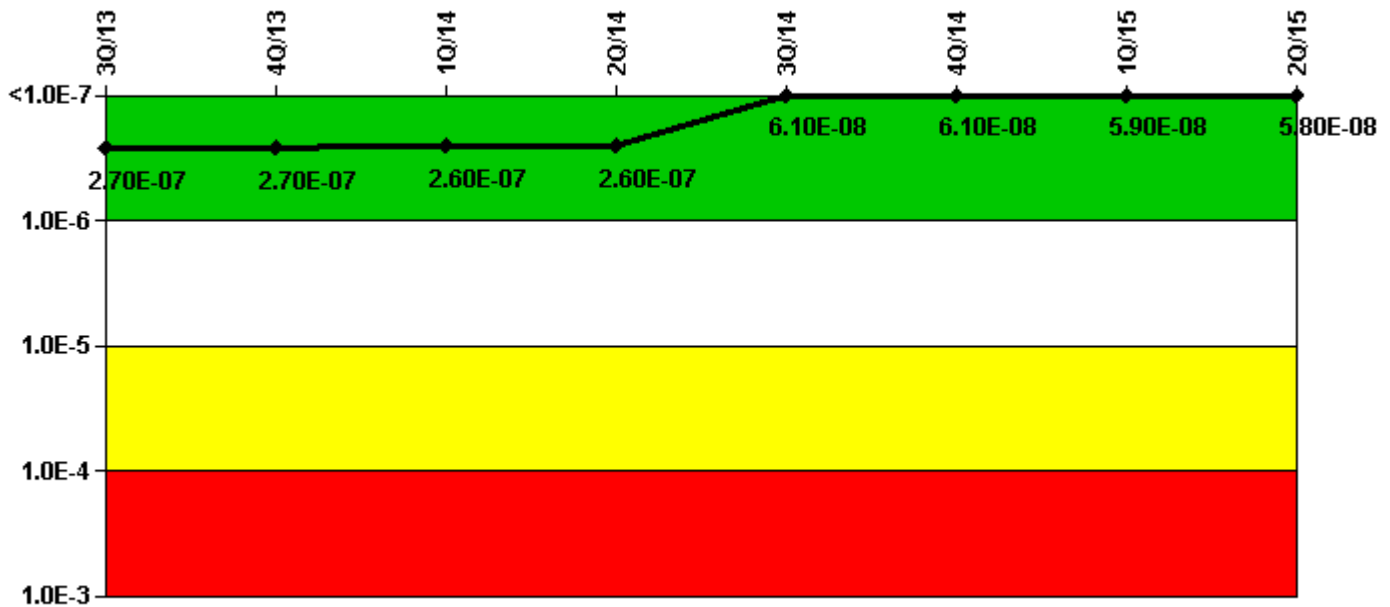

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	2.26E-07	2.27E-07	2.17E-07	2.17E-07	2.72E-08	2.70E-08	2.64E-08	2.41E-08
URI ( $\Delta$ CDF)	4.47E-08	4.38E-08	4.51E-08	4.74E-08	3.35E-08	3.36E-08	3.30E-08	3.41E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.70E-07	2.70E-07	2.60E-07	2.60E-07	6.10E-08	6.10E-08	5.90E-08	5.80E-08

Licensee Comments:

3Q/14: Auto roll-off of the 32 CCW pump failure on August 19, 2011.

### Reactor Coolant System Activity

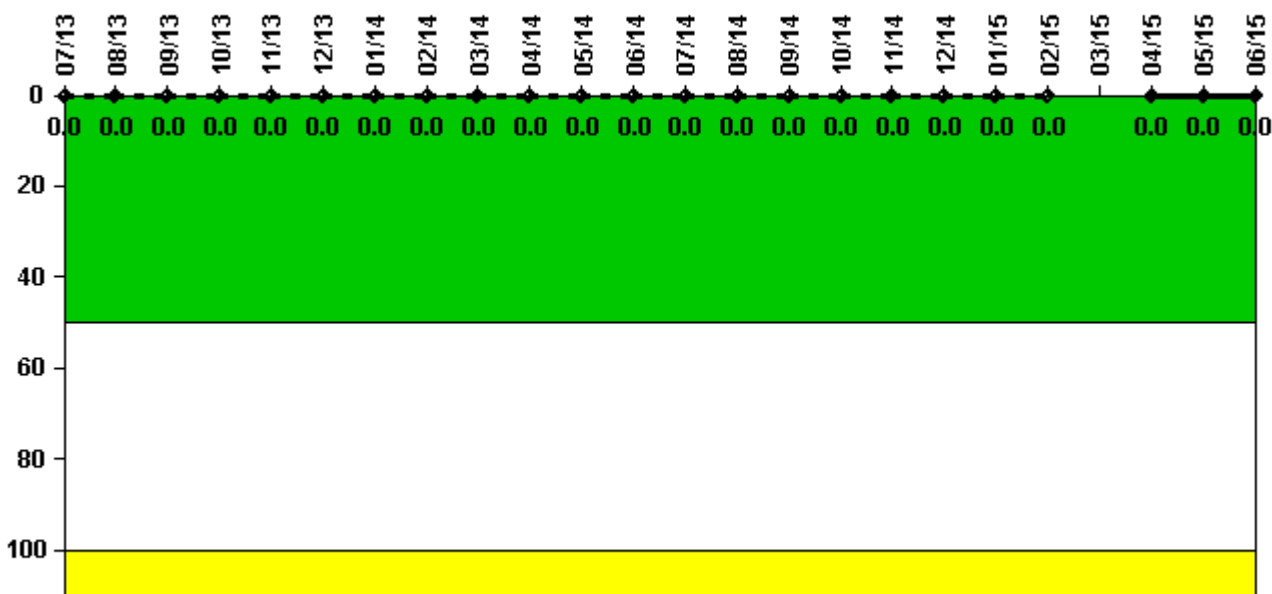

Thresholds: White > 50.0 Yellow > 100.0

#### Notes

Reactor Coolant System Activity	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum activity	0.000128	0.000115	0.000116	0.000123	0.000124	0.000130	0.000136	0.000138	0.000144	0.000139	0.000147	0.000147
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0


  

Reactor Coolant System Activity	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15
Maximum activity	0.000169	0.000162	0.000171	0.000183	0.000181	0.000183	0.000191	0.000203	N/A	0.000099	0.000090	0.000108
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	N/A	0	0	0

Licensee Comments:

3/15: (NA) No data for March 2015 due to unit in refueling outage (unstable RCS activity concentrations). Unit coastdown March 1, 2015 to initial criticality March 24, 2015, with startup for the remainder of the month.

### Reactor Coolant System Leakage

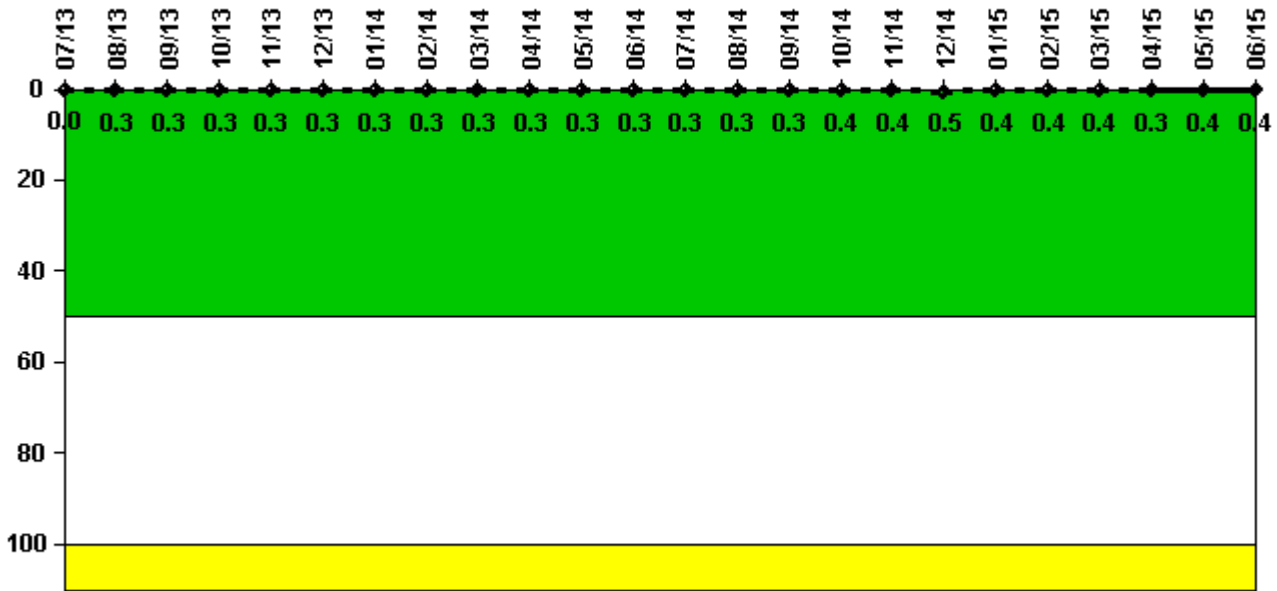


Thresholds: White > 50.0 Yellow > 100.0

#### Notes

Reactor Coolant System Leakage	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum leakage	0.004	0.030	0.030	0.030	0.030	0.030	0.030	0.030	0.030	0.030	0.030	0.030
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	<b>0</b>	<b>0.3</b>	<b>0.3</b>	<b>0.3</b>	<b>0.3</b>	<b>0.3</b>	<b>0.3</b>	<b>0.3</b>	<b>0.3</b>	<b>0.3</b>	<b>0.3</b>	<b>0.3</b>
Reactor Coolant System Leakage	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15
Maximum leakage	0.030	0.030	0.030	0.040	0.040	0.050	0.040	0.040	0.040	0.030	0.040	0.040
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	<b>0.3</b>	<b>0.3</b>	<b>0.3</b>	<b>0.4</b>	<b>0.4</b>	<b>0.5</b>	<b>0.4</b>	<b>0.4</b>	<b>0.4</b>	<b>0.3</b>	<b>0.4</b>	<b>0.4</b>

Licensee Comments: none

### Drill/Exercise Performance

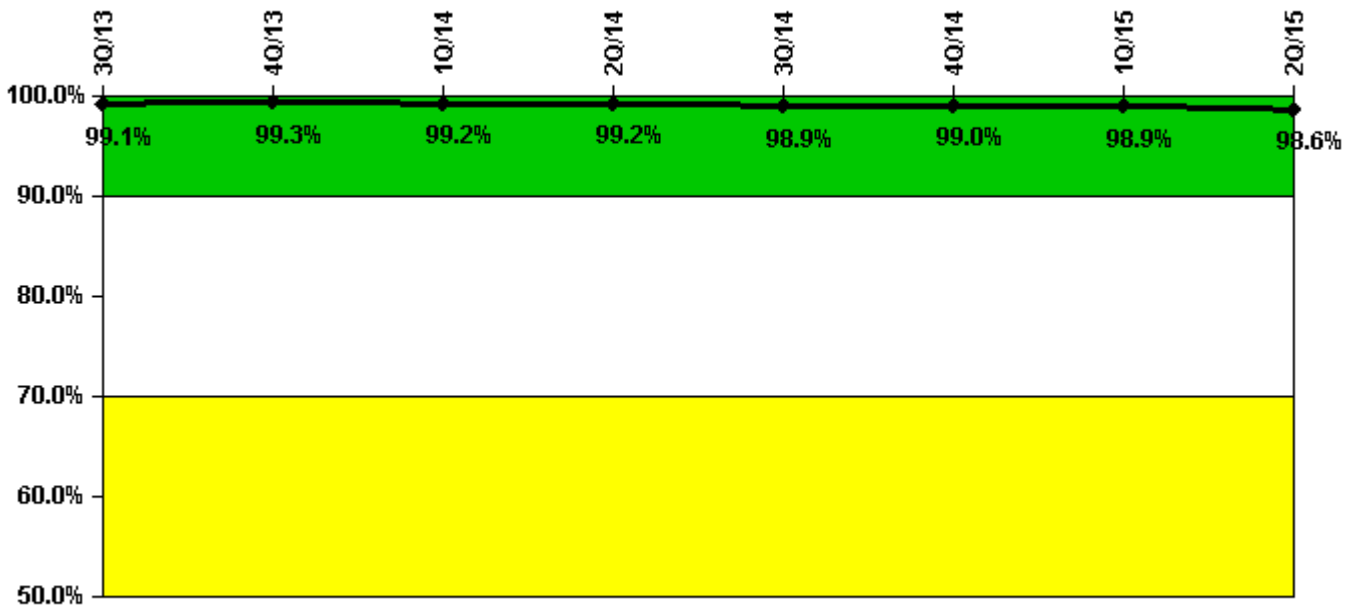


Thresholds: White < 90.0% Yellow < 70.0%

#### Notes

Drill/Exercise Performance	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Successful opportunities	291.0	127.0	50.0	108.0	200.0	109.0	20.0	71.0
Total opportunities	297.0	127.0	51.0	110.0	203.0	109.0	21.0	72.0
Indicator value	99.1%	99.3%	99.2%	99.2%	98.9%	99.0%	98.9%	98.6%

Licensee Comments: none

### ERO Drill Participation

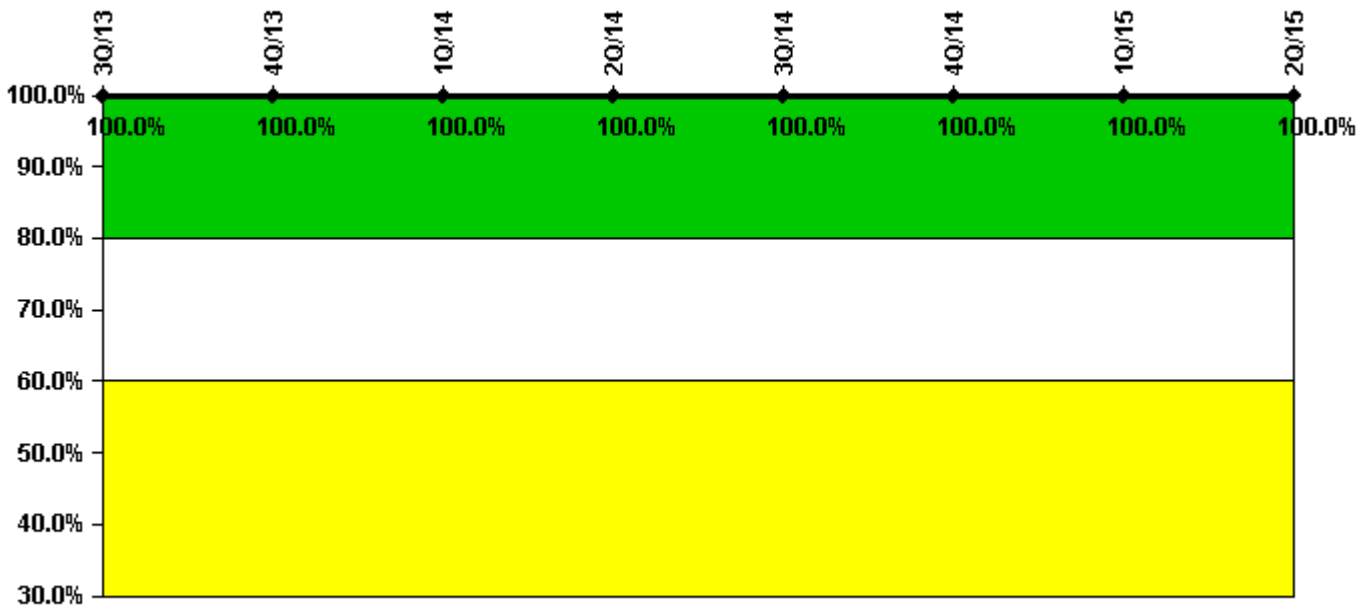


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Participating Key personnel	109.0	111.0	104.0	104.0	100.0	106.0	104.0	104.0
Total Key personnel	109.0	111.0	104.0	104.0	100.0	106.0	104.0	104.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

### Alert & Notification System

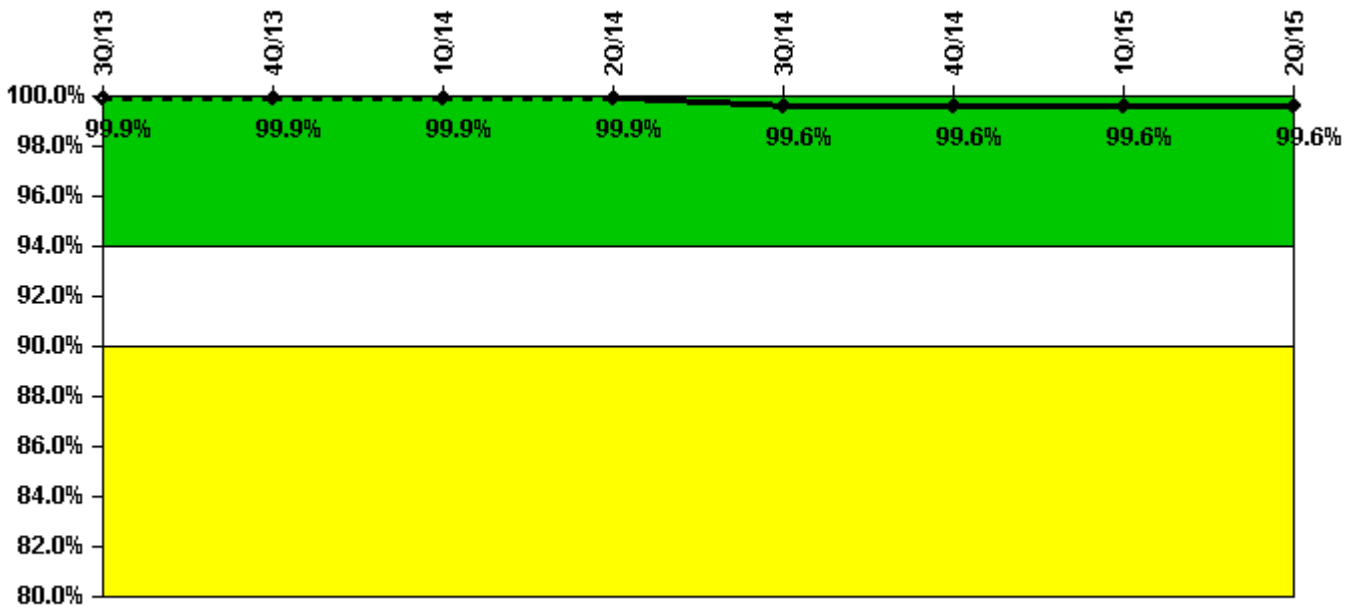


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Successful siren-tests	936	1226	1148	1079	1110	1104	1135	917
Total sirens-tests	938	1227	1148	1081	1126	1104	1135	917
Indicator value	99.9%	99.9%	99.9%	99.9%	99.6%	99.6%	99.6%	99.6%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

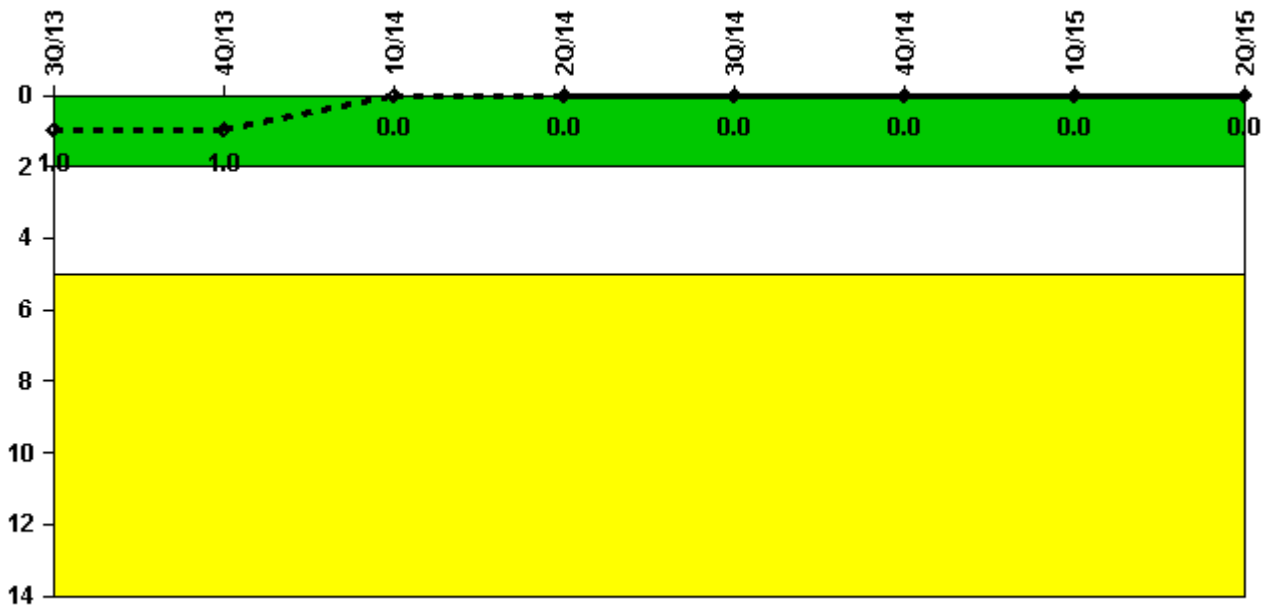


Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>1</b>	<b>1</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### RETS/ODCM Radiological Effluent

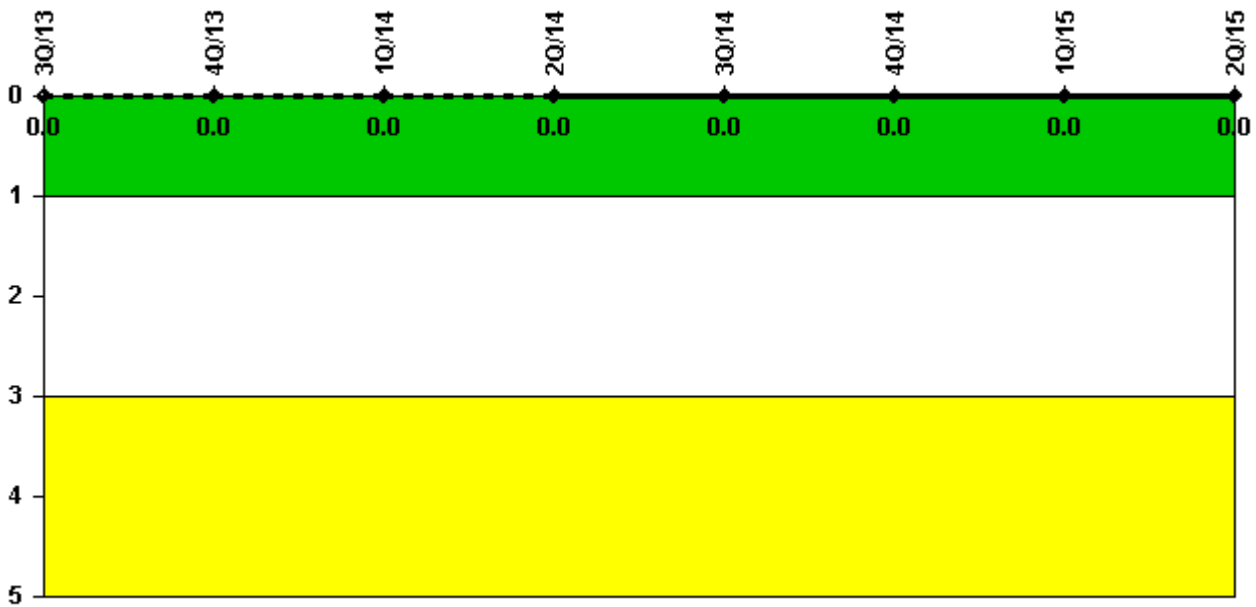

Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.



 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

*Last Modified: July 24, 2015*