


# Surry 1

## 2Q/2015 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

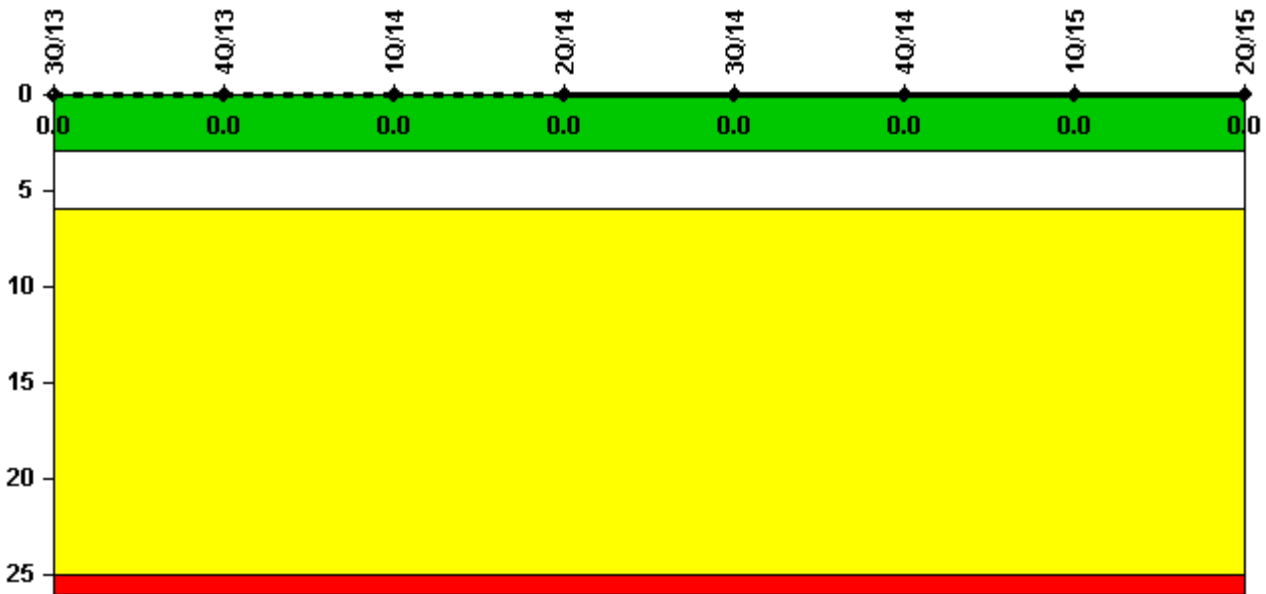


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2208.0	1450.9	2159.0	2184.0	2208.0	2209.0	2159.0	1272.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

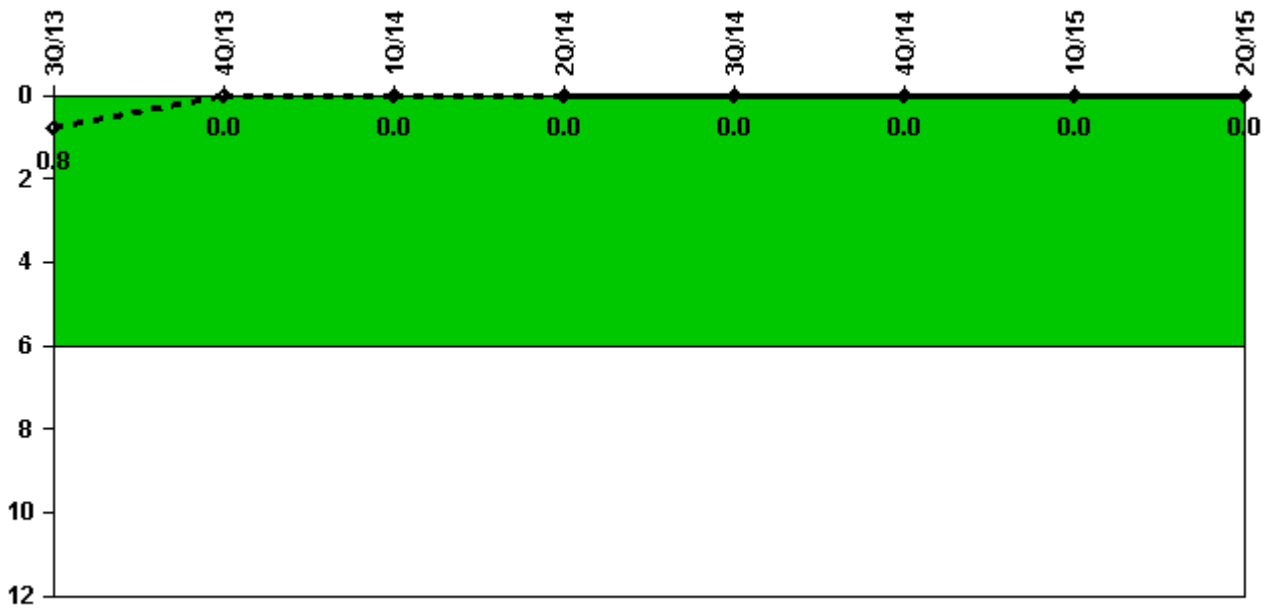


Thresholds: White > 6.0

#### Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2208.0	1450.9	2159.0	2184.0	2208.0	2209.0	2159.0	1272.0
<b>Indicator value</b>	<b>0.8</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### Unplanned Scrams with Complications

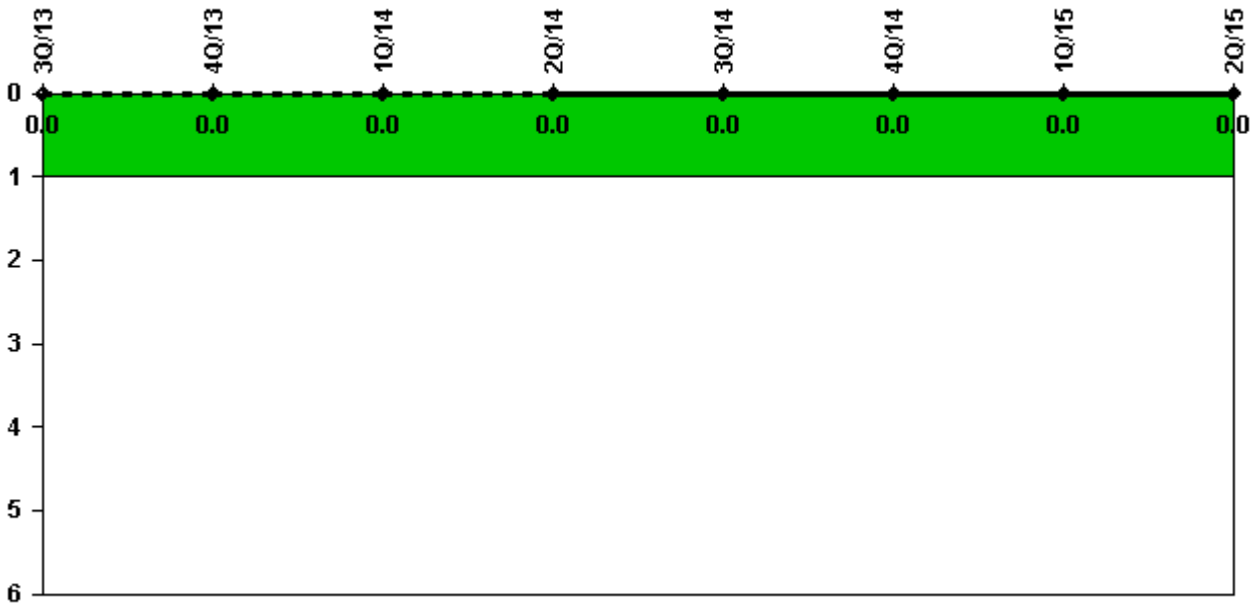


Thresholds: White > 1.0

#### Notes

Unplanned Scrams with Complications	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Scrams with complications	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>

Licensee Comments: none

### Safety System Functional Failures (PWR)

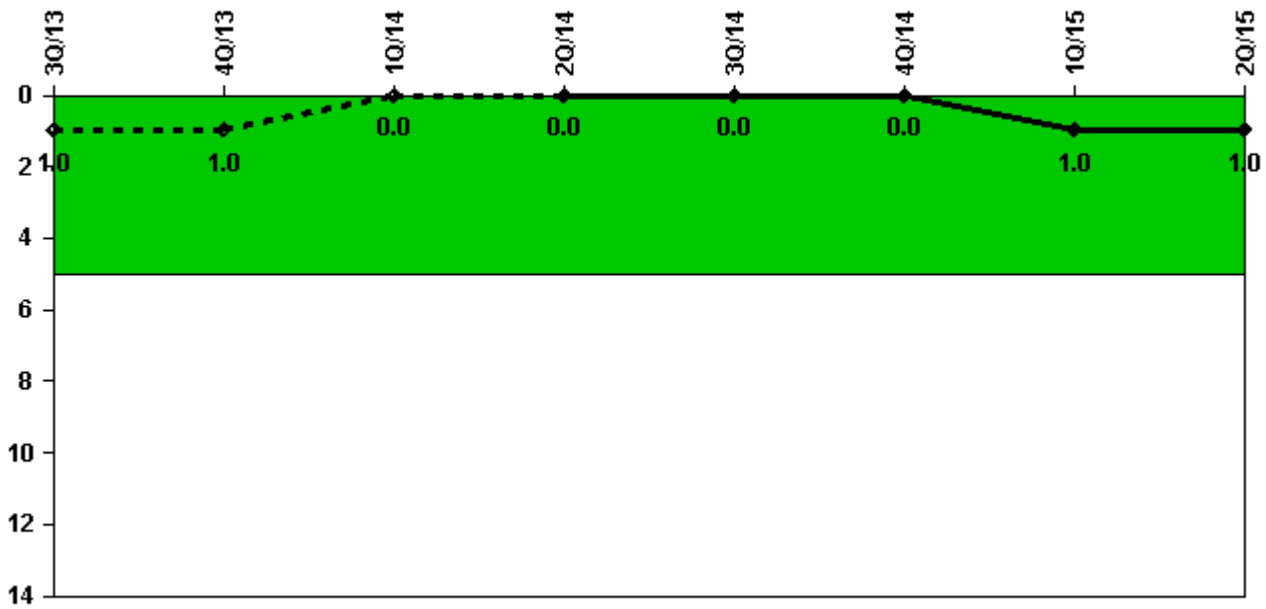

Thresholds: White > 5.0


#### Notes

Safety System Functional Failures (PWR)	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Safety System Functional Failures	0	0	0	0	0	0	1	0
<b>Indicator value</b>	<b>1</b>	<b>1</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>1</b>	<b>1</b>

Licensee Comments:

2Q/15: An assessment revealed a SSFF for March 2015 (see LER 50-280, 50-281/2015-001-00). Historical data was corrected with no change in color.

### Mitigating Systems Performance Index, Emergency AC Power System

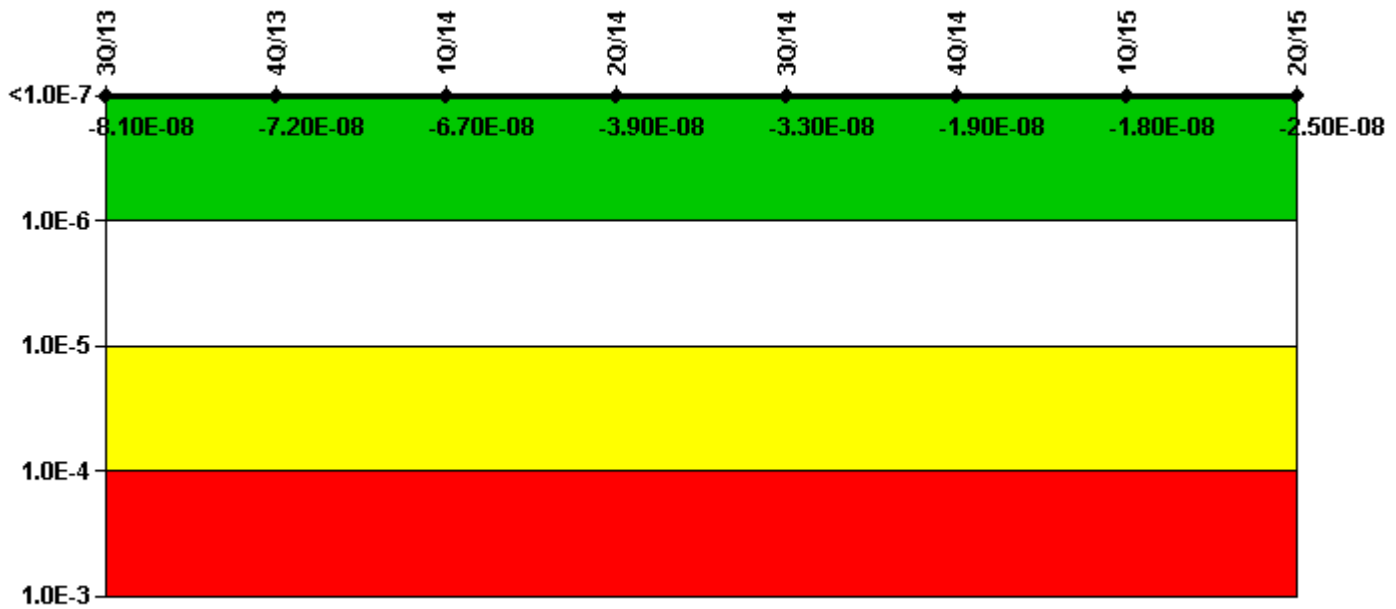

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	-1.39E-08	-1.39E-08	-1.39E-08	-1.39E-08	-1.39E-08	-2.75E-09	-2.74E-09	-2.64E-09
URI ( $\Delta$ CDF)	-6.70E-08	-5.84E-08	-5.33E-08	-2.55E-08	-1.96E-08	-1.61E-08	-1.50E-08	-2.24E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.10E-08	-7.20E-08	-6.70E-08	-3.90E-08	-3.30E-08	-1.90E-08	-1.80E-08	-2.50E-08

Licensee Comments: none

### Mitigating Systems Performance Index, High Pressure Injection System



Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	-7.80E-10	-7.85E-10	-8.09E-10	-8.72E-10	-8.26E-10	-7.99E-10	-9.98E-10	-9.95E-10
URI ( $\Delta$ CDF)	-1.41E-08	-1.39E-08	-1.39E-08	-1.36E-08	-1.38E-08	-1.36E-08	-1.32E-08	-1.27E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.50E-08	-1.50E-08	-1.50E-08	-1.40E-08	-1.50E-08	-1.40E-08	-1.40E-08	-1.40E-08

Licensee Comments:

4Q/14: Changed PRA Parameter(s). An MSPI review identified several probabilistic risk analysis coefficients that were incorrect. The MSPI Basis Document and coefficients were corrected with no change in color.

3Q/14: Changed PRA Parameter(s).


2Q/14: Changed PRA Parameter(s).

1Q/14: Changed PRA Parameter(s).

4Q/13: Changed PRA Parameter(s).

3Q/13: Changed PRA Parameter(s).

### Mitigating Systems Performance Index, Heat Removal System

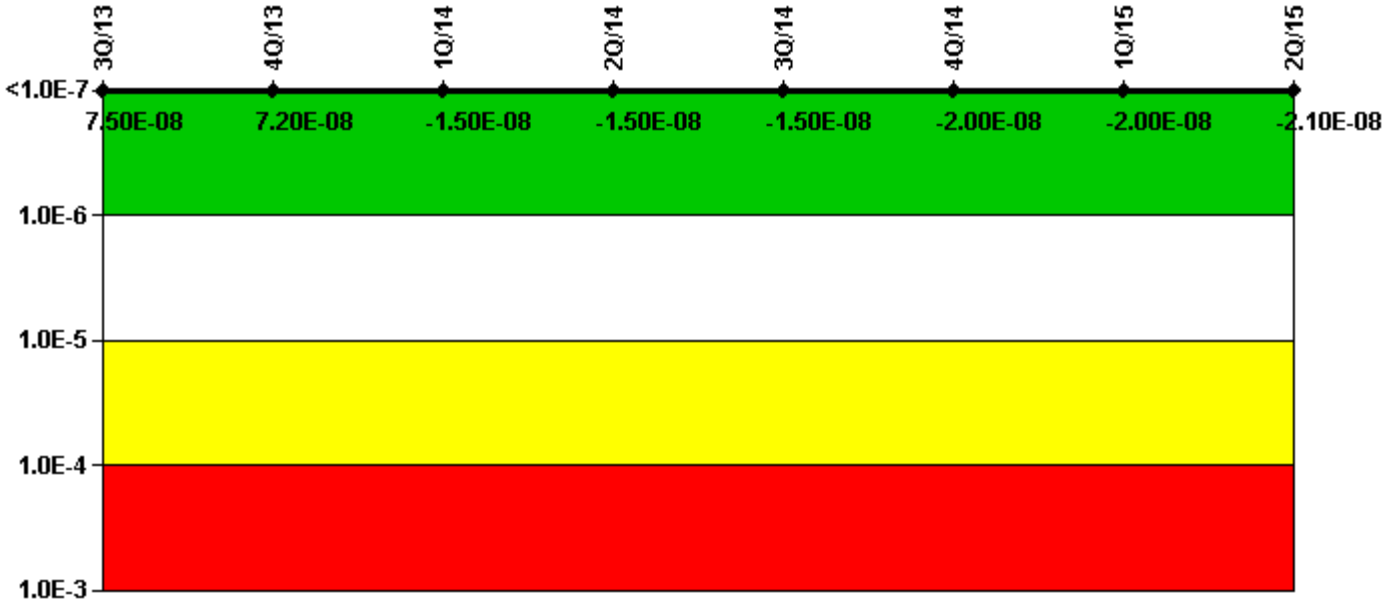

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	1.69E-09	2.32E-09	1.66E-09	1.25E-09	1.48E-09	-2.13E-09	-2.02E-09	-2.62E-09
URI ( $\Delta$ CDF)	7.32E-08	6.96E-08	-1.63E-08	-1.63E-08	-1.69E-08	-1.74E-08	-1.79E-08	-1.79E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	7.50E-08	7.20E-08	-1.50E-08	-1.50E-08	-1.50E-08	-2.00E-08	-2.00E-08	-2.10E-08

Licensee Comments:

4Q/14: Changed PRA Parameter(s). An MSPI review identified several probabilistic risk analysis coefficients that were incorrect. The MSPI Basis Document and coefficients were corrected with no change in color.


3Q/14: Changed PRA Parameter(s).

2Q/14: Changed PRA Parameter(s).

1Q/14: Changed PRA Parameter(s).

4Q/13: Changed PRA Parameter(s).

3Q/13: Changed PRA Parameter(s).

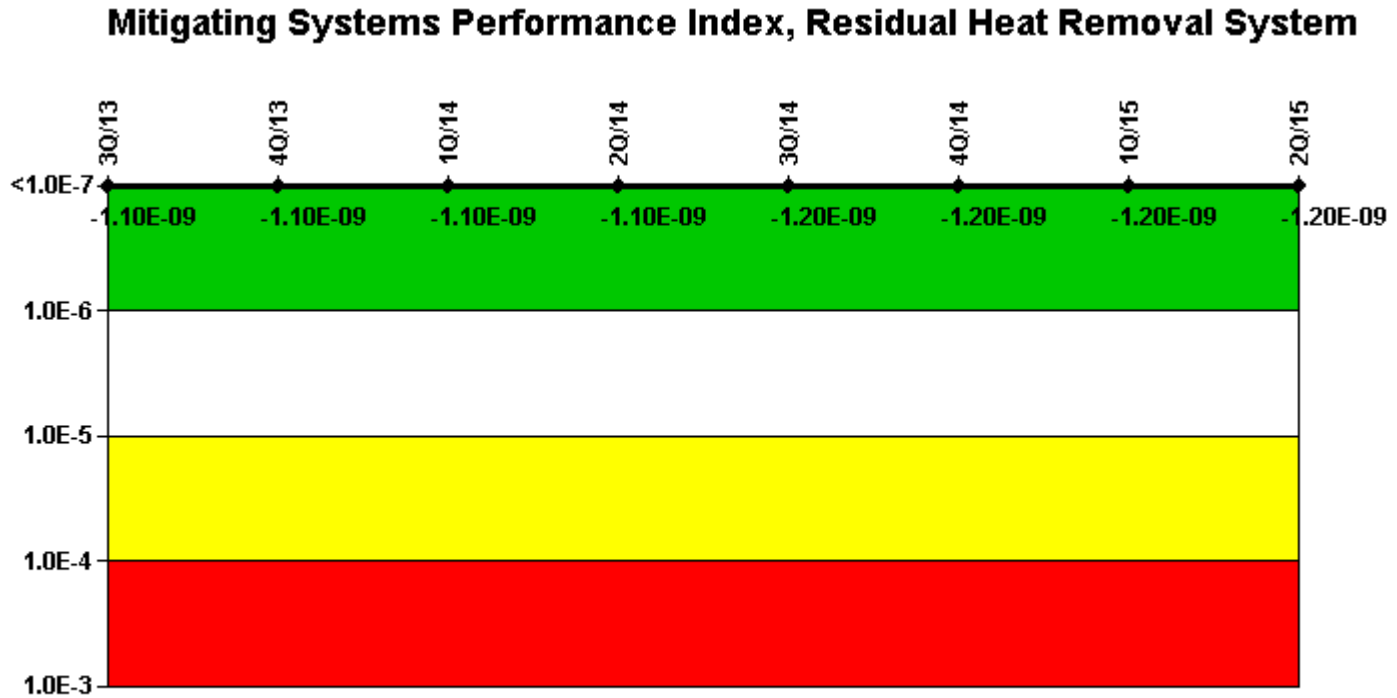

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

**Notes**

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	-2.28E-10	-2.29E-10	-2.43E-10	-2.43E-10	-2.55E-10	-2.55E-10	-2.70E-10	-2.70E-10
URI ( $\Delta$ CDF)	-8.96E-10	-9.03E-10	-9.03E-10	-9.03E-10	-9.03E-10	-9.03E-10	-9.03E-10	-9.27E-10
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.10E-09	-1.10E-09	-1.10E-09	-1.10E-09	-1.20E-09	-1.20E-09	-1.20E-09	-1.20E-09

Licensee Comments:

4Q/14: Changed PRA Parameter(s). An MSPI review identified several probabilistic risk analysis coefficients that were incorrect. The MSPI Basis Document and coefficients were corrected with no change in color.

3Q/14: Changed PRA Parameter(s).

2Q/14: Changed PRA Parameter(s).




1Q/14: Changed PRA Parameter(s).

4Q/13: Changed PRA Parameter(s).

3Q/13: Changed PRA Parameter(s).

### Mitigating Systems Performance Index, Cooling Water Systems

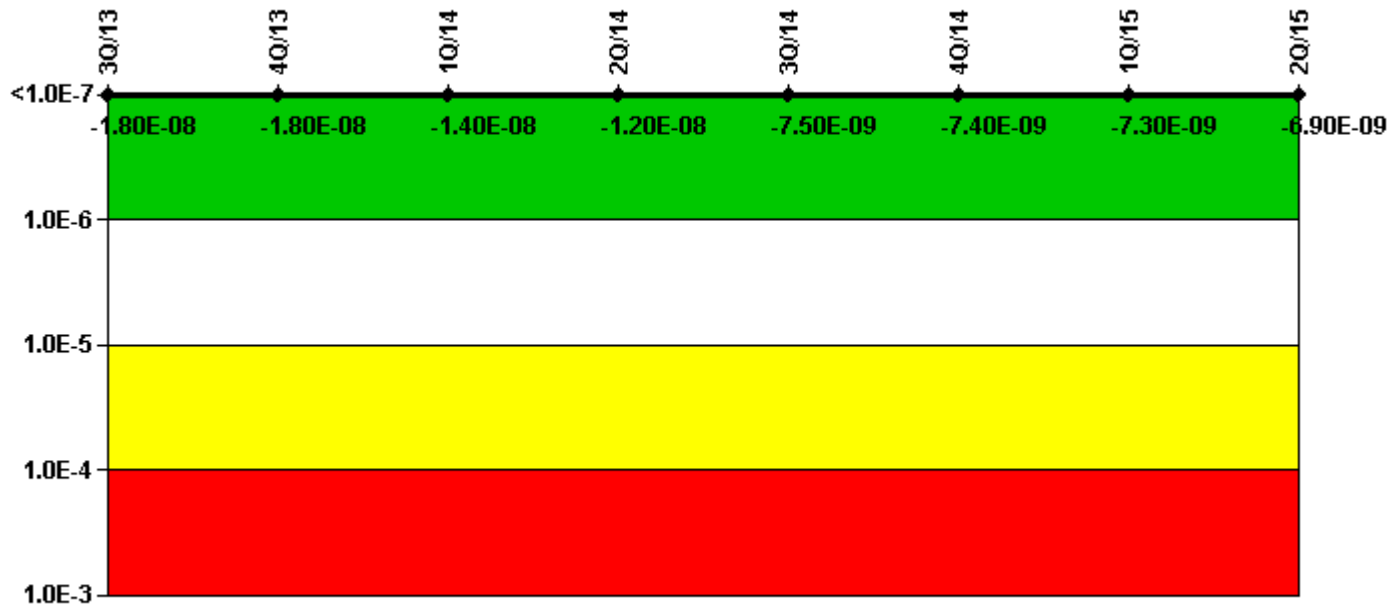

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
UAI ( $\Delta$ CDF)	1.59E-09	1.58E-09	1.27E-09	3.30E-09	3.04E-09	3.25E-09	3.15E-09	3.13E-09
URI ( $\Delta$ CDF)	-2.01E-08	-1.99E-08	-1.53E-08	-1.49E-08	-1.05E-08	-1.07E-08	-1.05E-08	-1.00E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.80E-08	-1.80E-08	-1.40E-08	-1.20E-08	-7.50E-09	-7.40E-09	-7.30E-09	-6.90E-09

Licensee Comments:

4Q/14: Changed PRA Parameter(s). An MSPI review identified several probabilistic risk analysis coefficients that were incorrect. The MSPI Basis Document and coefficients were corrected with no change in color.

3Q/14: Changed PRA Parameter(s).

2Q/14: Failure No. 311011 on March 29 was added which changed the first quarter indicator with no change in color. See LER report No. 50-280/2014-001-00.


2Q/14: Changed PRA Parameter(s).

1Q/14: Changed PRA Parameter(s).

4Q/13: Changed PRA Parameter(s).

3Q/13: Changed PRA Parameter(s).

### Reactor Coolant System Activity

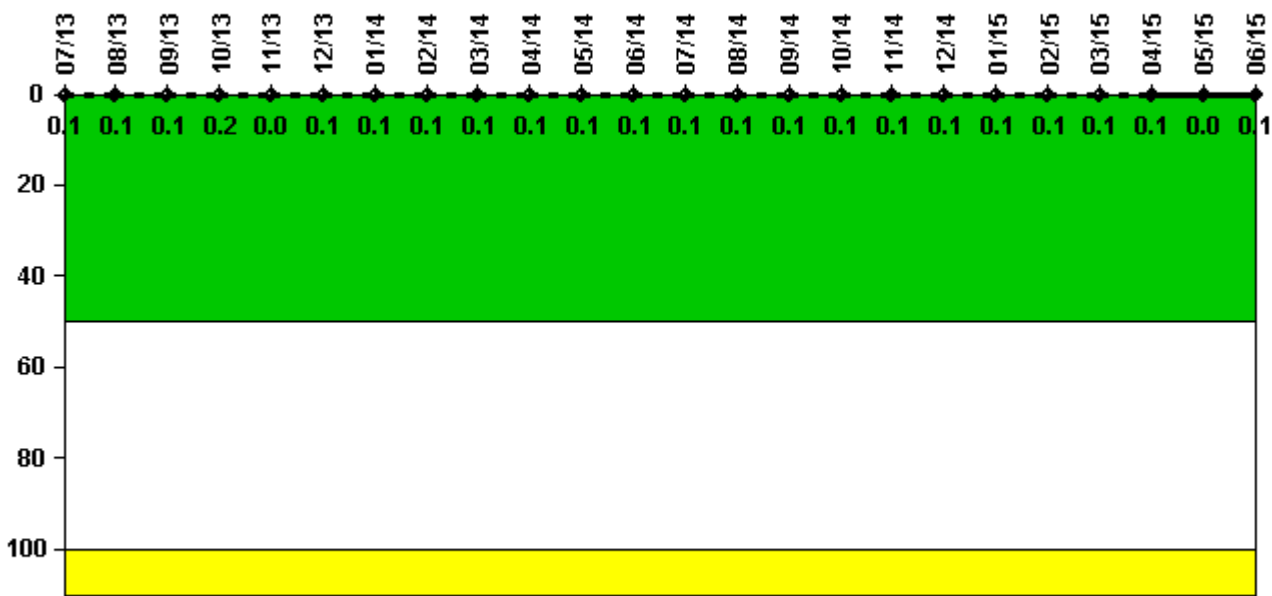

Thresholds: White > 50.0 Yellow > 100.0


### Notes

Reactor Coolant System Activity	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum activity	0.001120	0.001320	0.001490	0.001580	0.000475	0.000601	0.000632	0.000631	0.000729	0.000749	0.000817	0.000839
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0

<b>Indicator value</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.2</b>	<b>0</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>
<b>Reactor Coolant System Activity</b>	<b>7/14</b>	<b>8/14</b>	<b>9/14</b>	<b>10/14</b>	<b>11/14</b>	<b>12/14</b>	<b>1/15</b>	<b>2/15</b>	<b>3/15</b>	<b>4/15</b>	<b>5/15</b>	<b>6/15</b>
Maximum activity	0.000828	0.000910	0.000928	0.000929	0.001020	0.001030	0.001140	0.001110	0.001280	0.001190	0.000171	0.000544
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
<b>Indicator value</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0.1</b>	<b>0</b>	<b>0.1</b>

Licensee Comments: none

### Reactor Coolant System Leakage

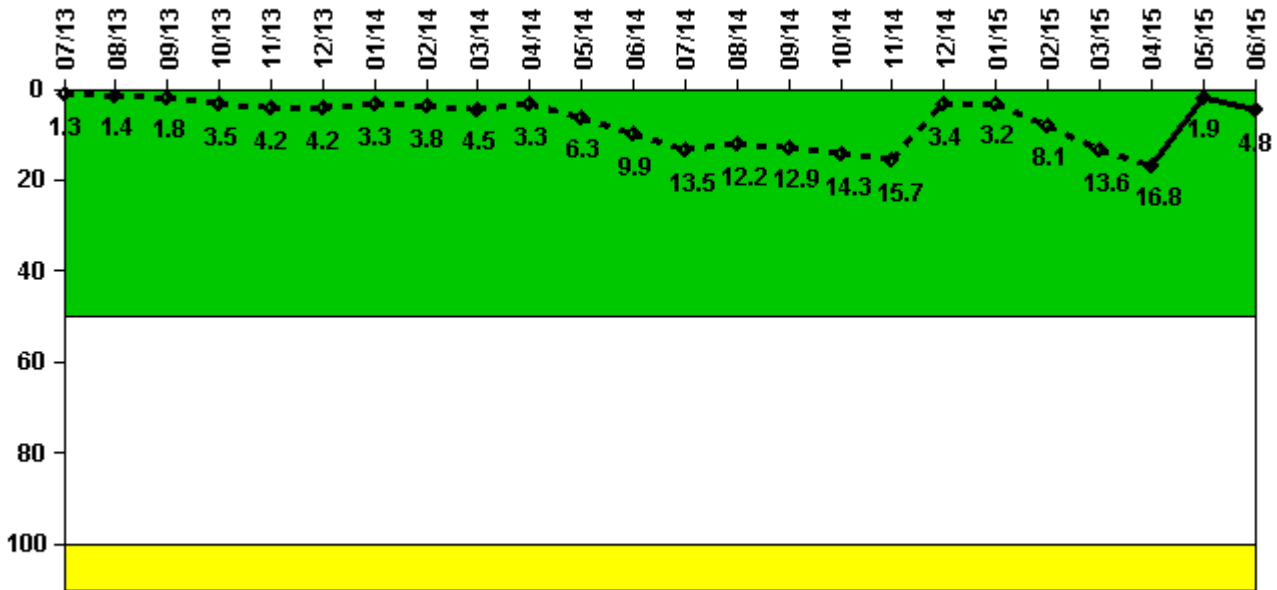

Thresholds: White > 50.0 Yellow > 100.0


### Notes

Reactor Coolant System Leakage	7/13	8/13	9/13	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14
Maximum leakage	0.130	0.140	0.180	0.350	0.420	0.420	0.330	0.380	0.450	0.330	0.630	0.990
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0

<b>Indicator value</b>	<b>1.3</b>	<b>1.4</b>	<b>1.8</b>	<b>3.5</b>	<b>4.2</b>	<b>4.2</b>	<b>3.3</b>	<b>3.8</b>	<b>4.5</b>	<b>3.3</b>	<b>6.3</b>	<b>9.9</b>
<b>Reactor Coolant System Leakage</b>	<b>7/14</b>	<b>8/14</b>	<b>9/14</b>	<b>10/14</b>	<b>11/14</b>	<b>12/14</b>	<b>1/15</b>	<b>2/15</b>	<b>3/15</b>	<b>4/15</b>	<b>5/15</b>	<b>6/15</b>
Maximum leakage	1.350	1.220	1.290	1.430	1.570	0.340	0.320	0.810	1.360	1.680	0.190	0.480
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
<b>Indicator value</b>	<b>13.5</b>	<b>12.2</b>	<b>12.9</b>	<b>14.3</b>	<b>15.7</b>	<b>3.4</b>	<b>3.2</b>	<b>8.1</b>	<b>13.6</b>	<b>16.8</b>	<b>1.9</b>	<b>4.8</b>

Licensee Comments: none

### Drill/Exercise Performance

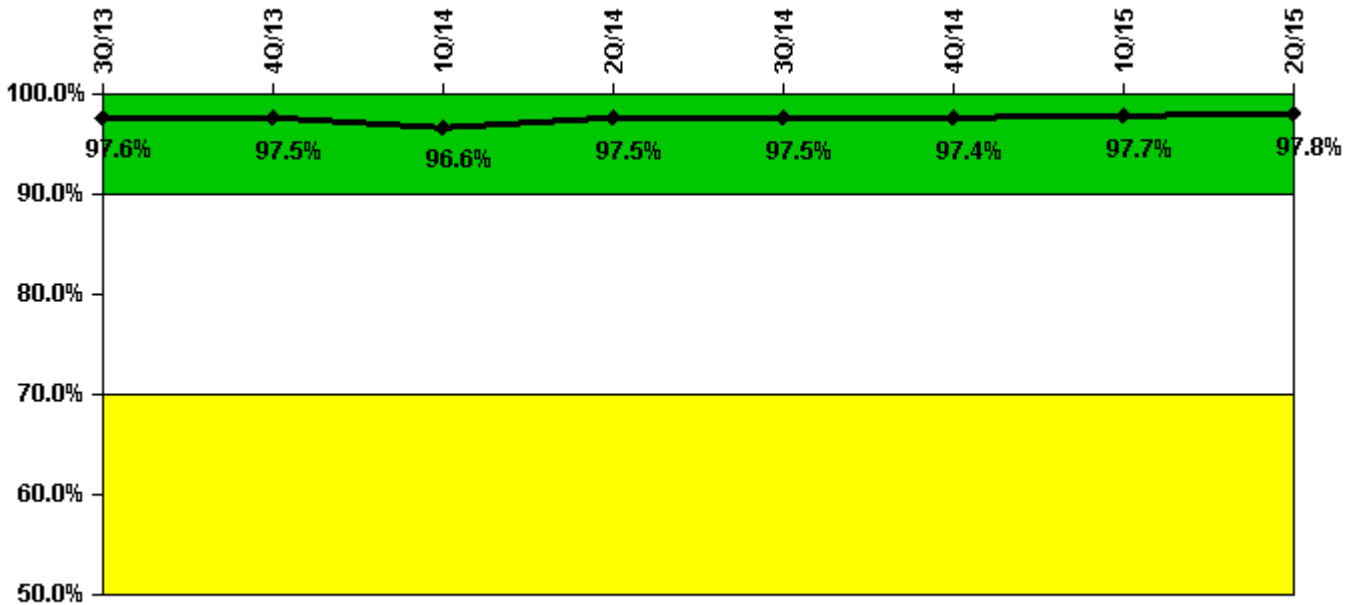

Thresholds: White < 90.0% Yellow < 70.0%


### Notes

Drill/Exercise Performance	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Successful opportunities	28.0	14.0	36.0	28.0	33.0	19.0	31.0	31.0
Total opportunities	31.0	14.0	38.0	28.0	33.0	19.0	31.0	31.0
<b>Indicator value</b>	<b>97.6%</b>	<b>97.5%</b>	<b>96.6%</b>	<b>97.5%</b>	<b>97.5%</b>	<b>97.4%</b>	<b>97.7%</b>	<b>97.8%</b>

Licensee Comments:

3Q/14: Further review of a March 2014 ERO drill determined an initial successful DEP opportunity was not successful. Historical data was corrected with no change in color.

### ERO Drill Participation

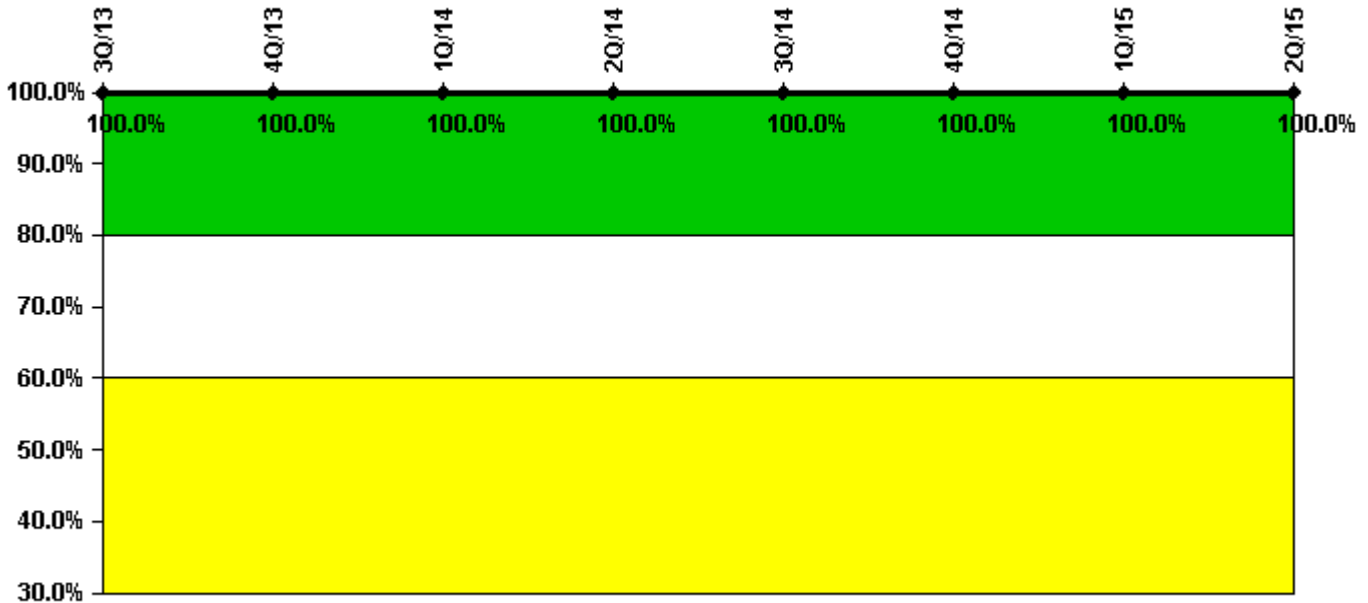

Thresholds: White < 80.0% Yellow < 60.0%

#### Notes


ERO Drill Participation	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Participating Key personnel	160.0	159.0	156.0	152.0	154.0	151.0	141.0	157.0
Total Key personnel	160.0	159.0	156.0	152.0	154.0	151.0	141.0	157.0
<b>Indicator value</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>

#### Licensee Comments:

2Q/15: An assessment revealed additional key personnel for March 2015. Historical data was corrected with no change in color.

3Q/14: An assessment determined the total number of personnel in key ERO positions was inaccurate. Historical data was corrected with no change in color.

### Alert & Notification System

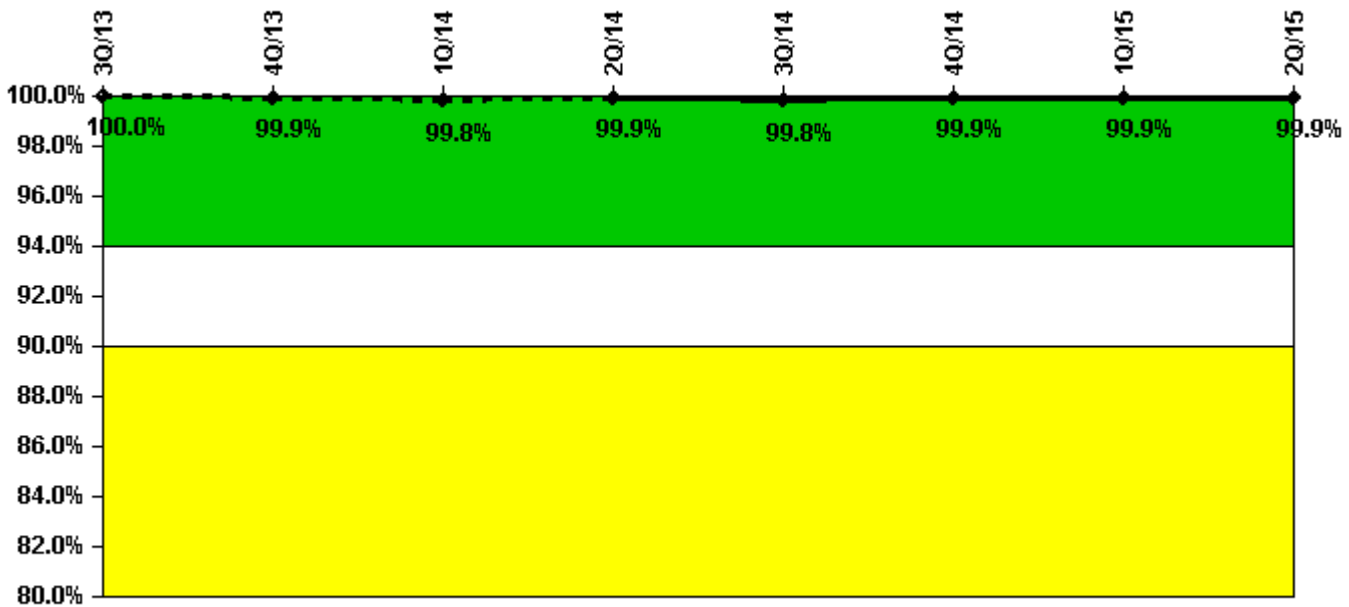


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
Successful siren-tests	497	566	496	568	567	497	567	497
Total sirens-tests	497	568	497	568	568	497	568	497
Indicator value	100.0%	99.9%	99.8%	99.9%	99.8%	99.9%	99.9%	99.9%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

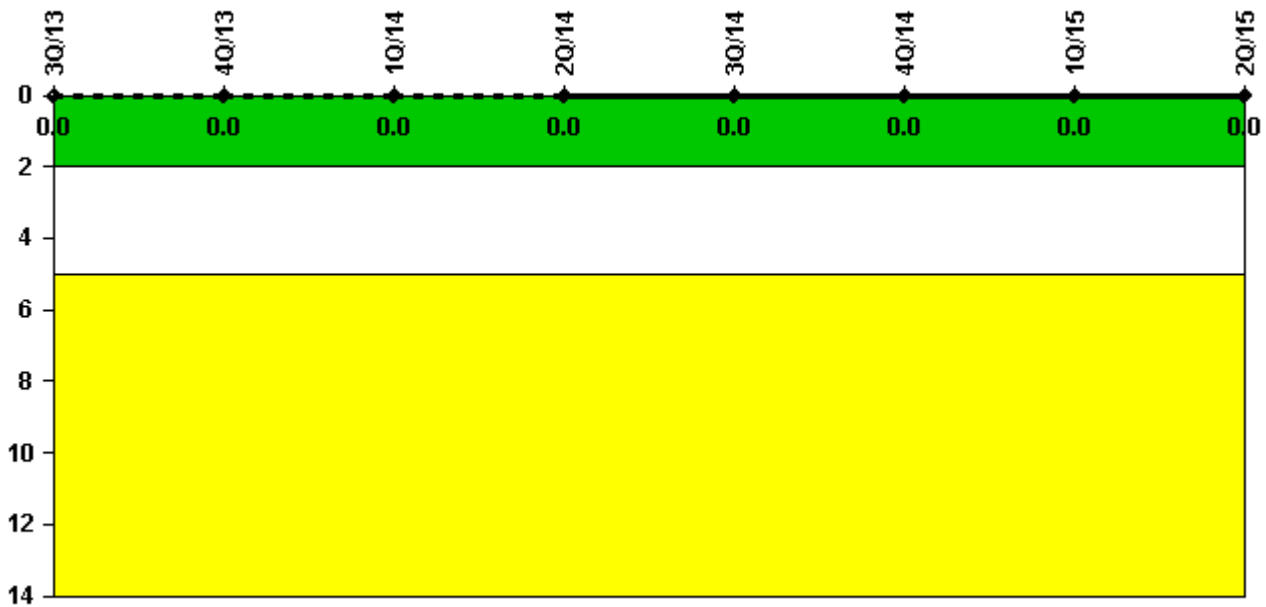

Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	3Q/13	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.



 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

*Last Modified: July 24, 2015*