


Comanche Peak 2

4Q/2015 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

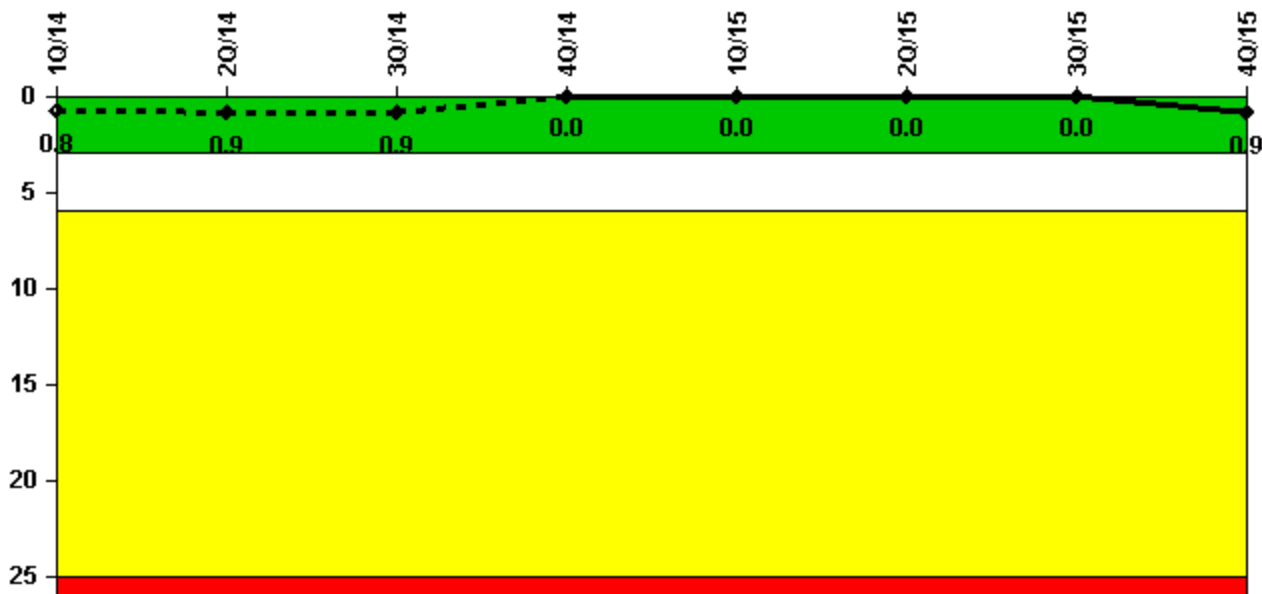


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
Unplanned scrams	0	0	0	0	0	0	0	1.0
Critical hours	2099.0	1563.6	2208.0	2209.0	2159.0	2184.0	2208.0	1277.7
Indicator value	0.8	0.9	0.9	0	0	0	0	0.9

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

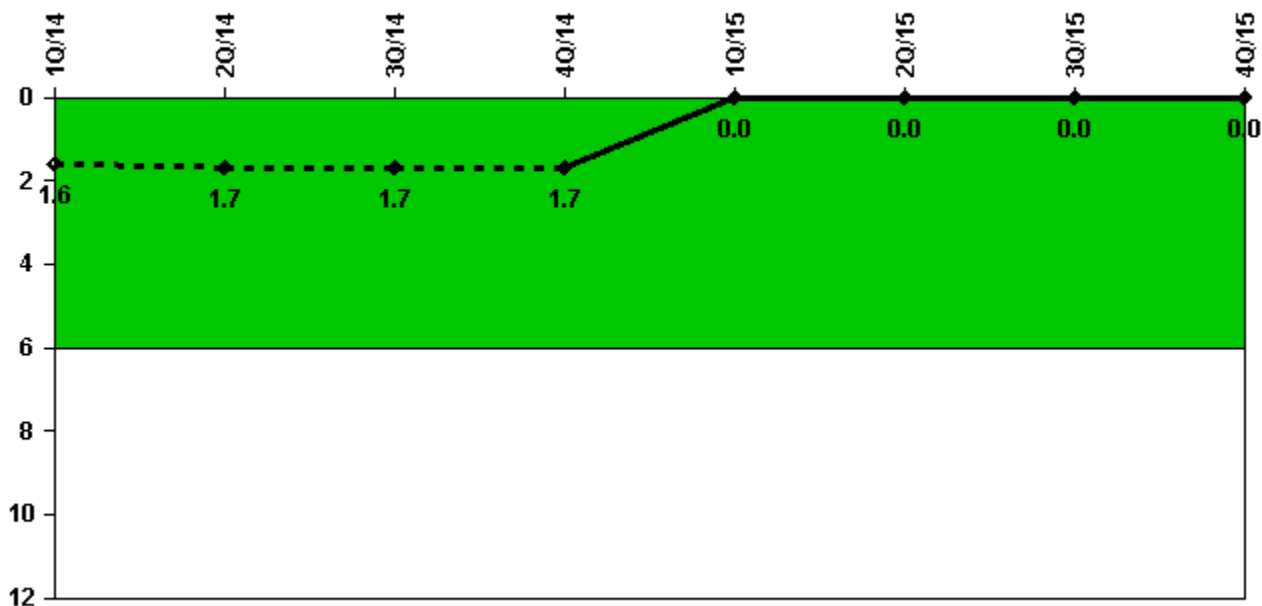

Thresholds: White > 6.0

Notes


Unplanned Power Changes per 7000 Critical Hrs	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
Unplanned power changes	2.0	0	0	0	0	0	0	0
Critical hours	2099.0	1563.6	2208.0	2209.0	2159.0	2184.0	2208.0	1277.7
Indicator value	1.6	1.7	1.7	1.7	0	0	0	0

Licensee Comments:

3Q/15: A Notice of Enforcement Discretion has been granted without which the unit would have had an unplanned power change of greater than 20-percent of full power.

1Q/14: One additional unplanned power change for Feb 2014 was identified. This change does not affect the ??? color??? of the indicator.

Unplanned Scrams with Complications

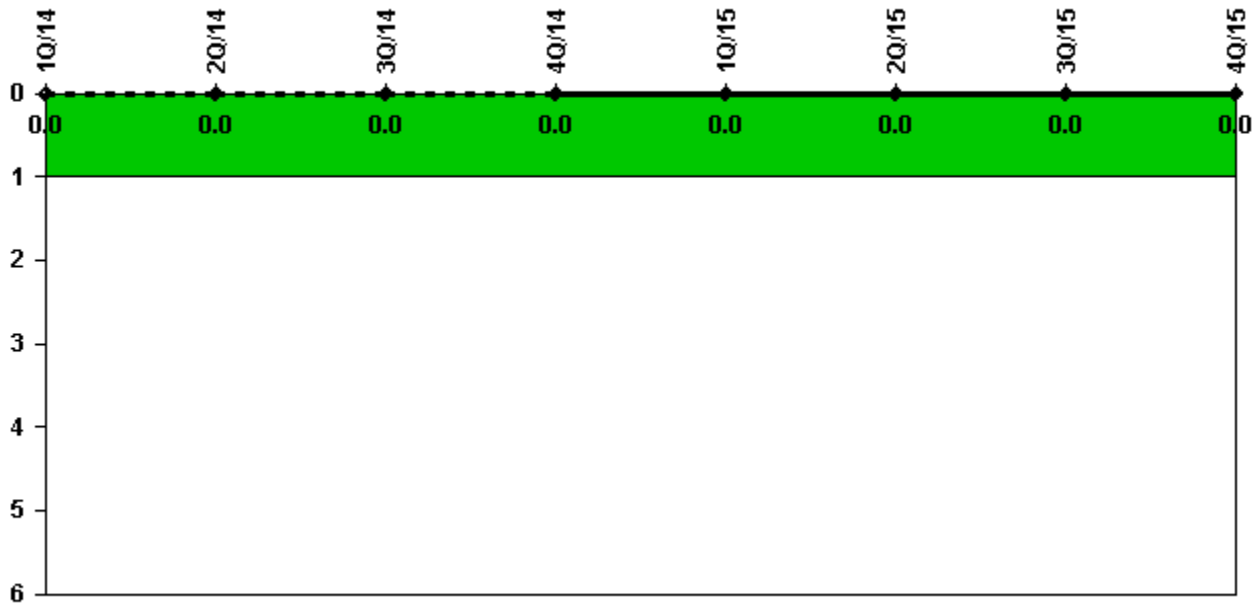


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

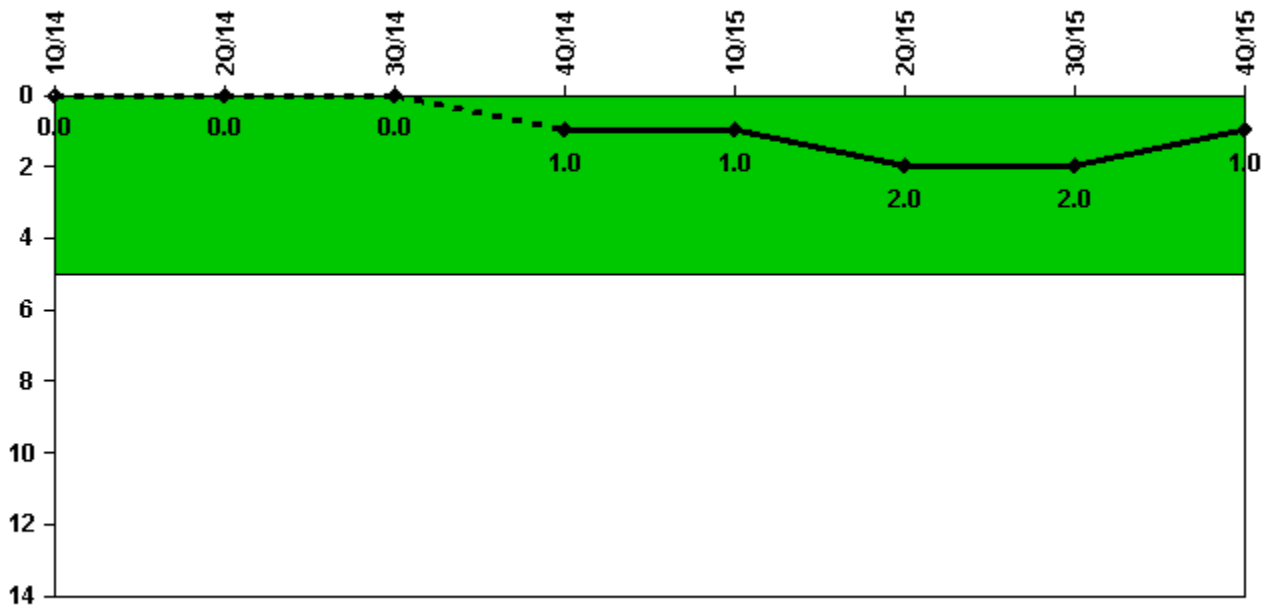

Thresholds: White > 5.0

Notes


Safety System Functional Failures (PWR)	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
Safety System Functional Failures	0	0	0	1	0	1	0	0
Indicator value	0	0	0	1	1	2	2	1

Licensee Comments:

2Q/15: LER 1-15-001.

4Q/14: LER 446/14-005-00

Mitigating Systems Performance Index, Emergency AC Power System

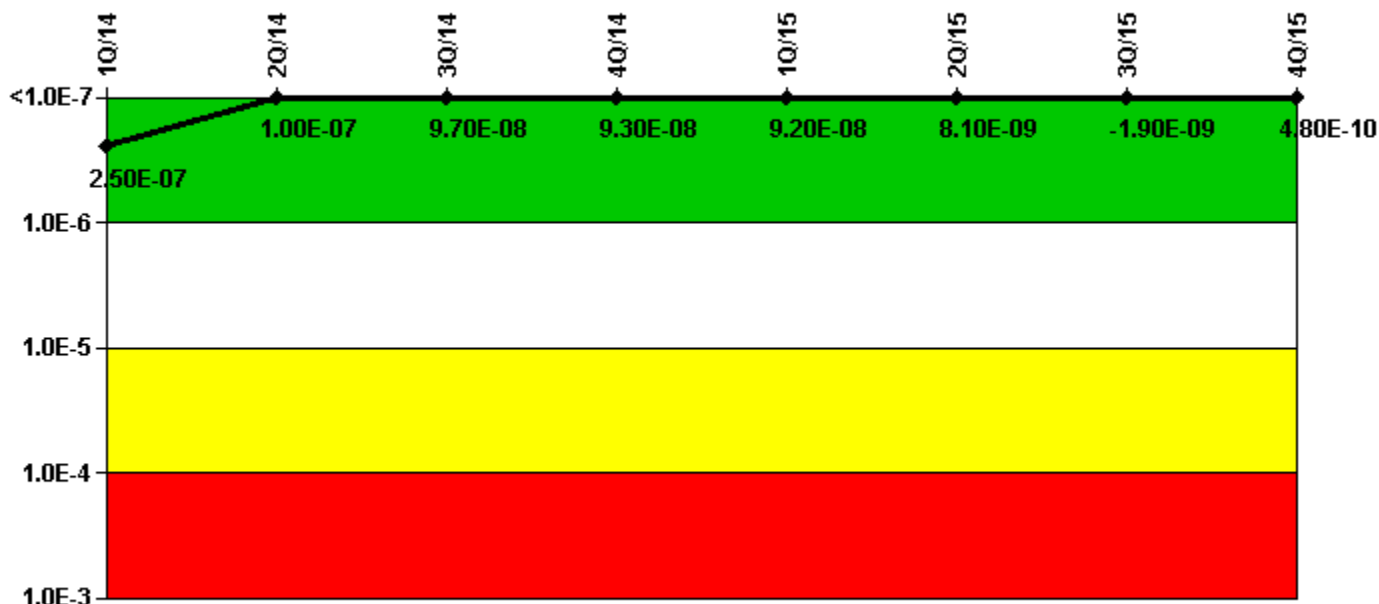

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
UAI (Δ CDF)	4.95E-08	4.62E-08	4.14E-08	4.05E-08	4.05E-08	2.98E-08	2.14E-08	1.94E-08
URI (Δ CDF)	2.03E-07	5.73E-08	5.54E-08	5.22E-08	5.14E-08	-2.18E-08	-2.33E-08	-1.89E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.50E-07	1.00E-07	9.70E-08	9.30E-08	9.20E-08	8.10E-09	-1.90E-09	4.80E-10

Licensee Comments:

2Q/14: Added 1.7 hours of unavailability for EDG 2-02 in June 2014 that was previously overlooked. This change did not affect the color of the indicator.

Mitigating Systems Performance Index, High Pressure Injection System

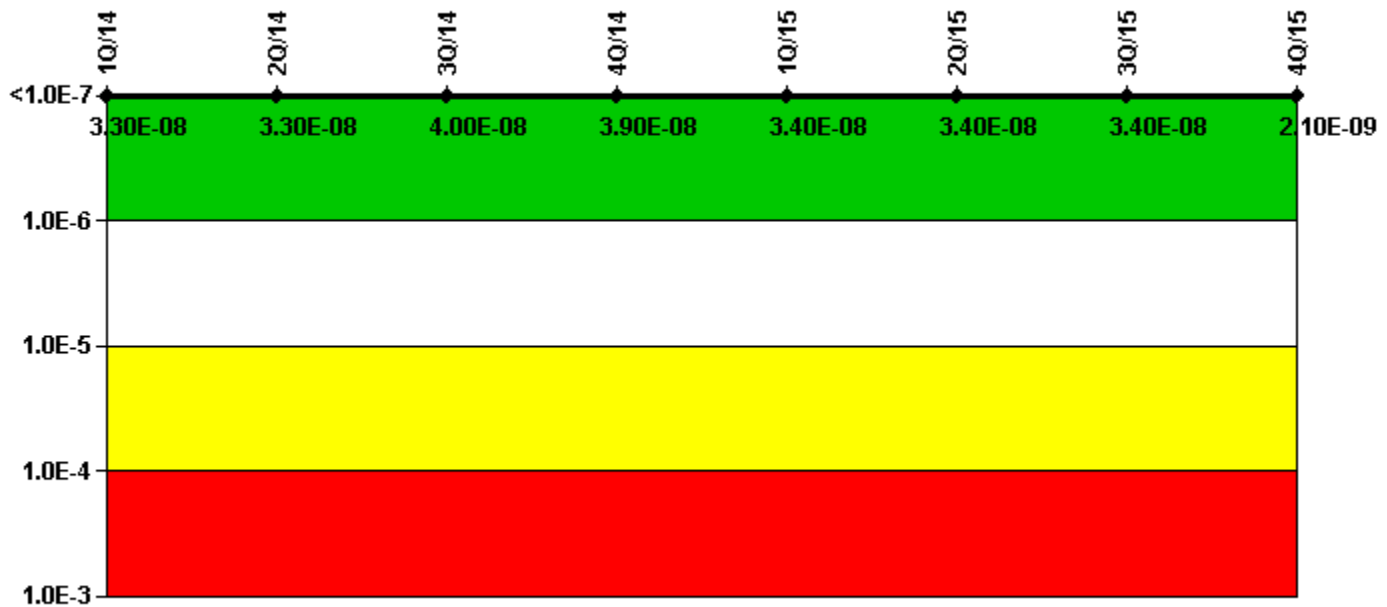


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
UAI (Δ CDF)	1.57E-11	1.54E-11	1.73E-09	1.73E-09	1.45E-09	1.45E-09	1.50E-09	-2.94E-10
URI (Δ CDF)	3.33E-08	3.33E-08	3.78E-08	3.76E-08	3.29E-08	3.27E-08	3.26E-08	2.40E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.30E-08	3.30E-08	4.00E-08	3.90E-08	3.40E-08	3.40E-08	3.40E-08	2.10E-09

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

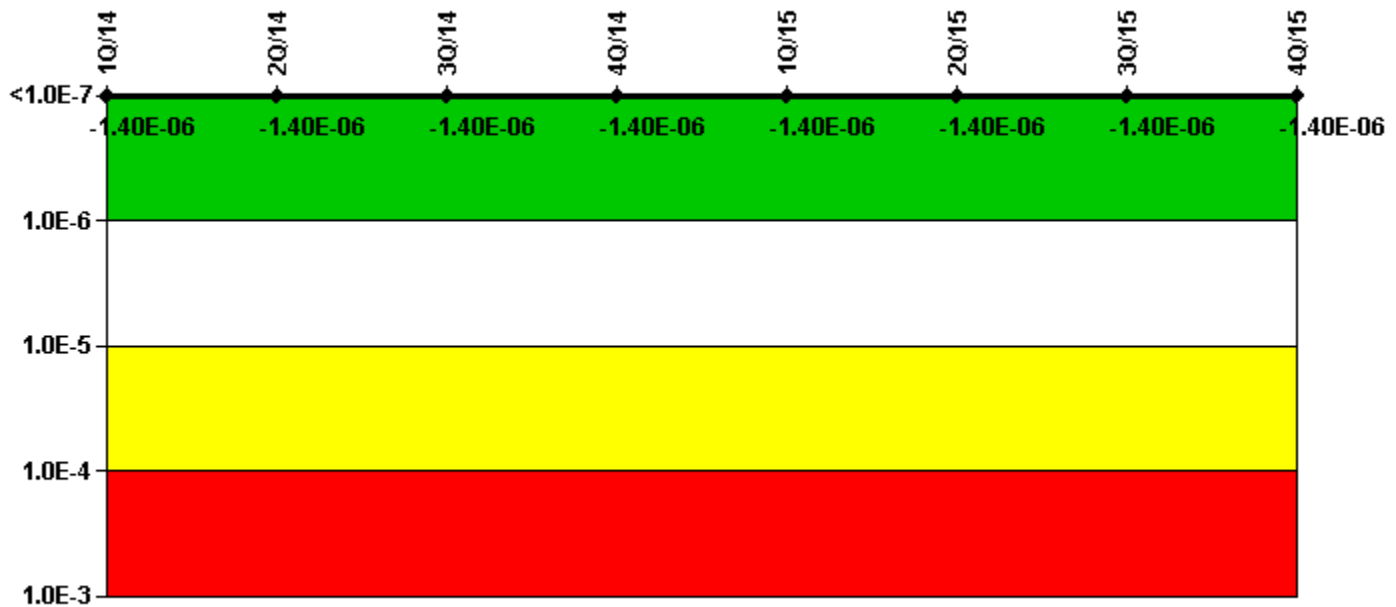


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
UAI (Δ CDF)	-1.07E-06	-1.09E-06	-1.09E-06	-1.09E-06	-1.09E-06	-1.09E-06	-1.09E-06	-1.09E-06
URI (Δ CDF)	-2.99E-07	-2.97E-07	-2.96E-07	-2.95E-07	-3.02E-07	-3.01E-07	-3.08E-07	-2.89E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.40E-06	-1.40E-06	-1.40E-06	-1.40E-06	-1.40E-06	-1.40E-06	-1.40E-06	-1.40E-06

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

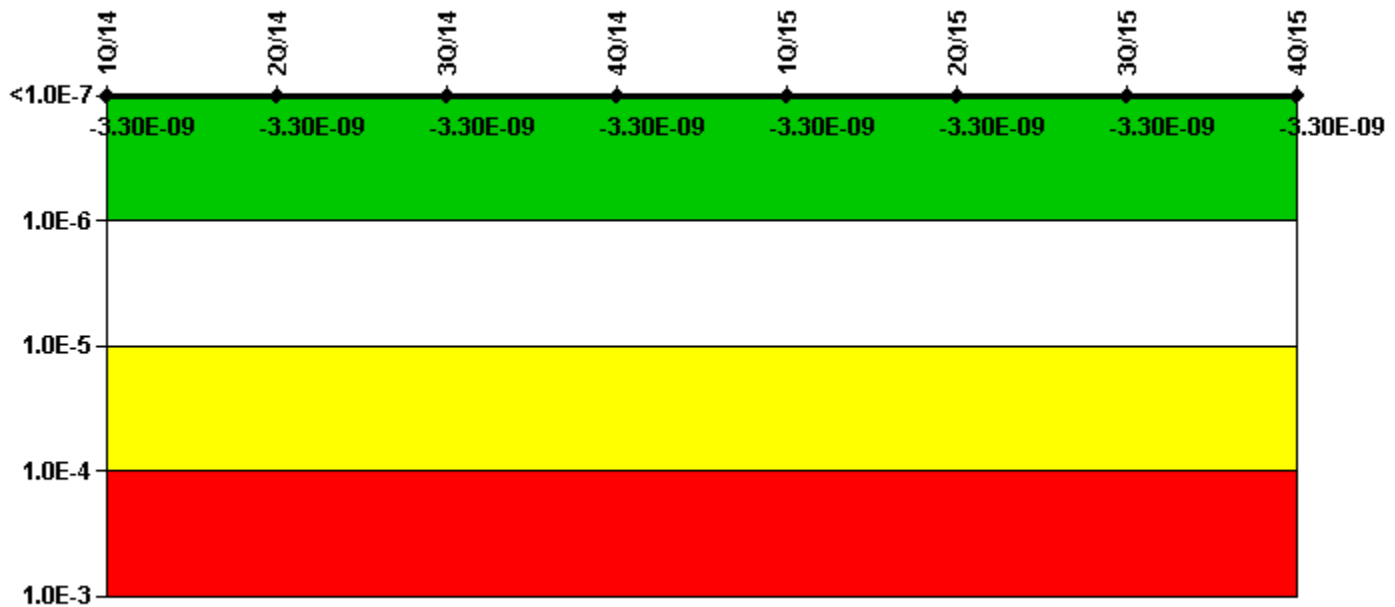


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
UAI (Δ CDF)	-8.59E-10	-8.41E-10	-8.41E-10	-8.41E-10	-8.41E-10	-8.41E-10	-8.41E-10	-8.41E-10
URI (Δ CDF)	-2.47E-09	-2.48E-09	-2.47E-09	-2.47E-09	-2.47E-09	-2.47E-09	-2.47E-09	-2.46E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.30E-09	-3.30E-09	-3.30E-09	-3.30E-09	-3.30E-09	-3.30E-09	-3.30E-09	-3.30E-09

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

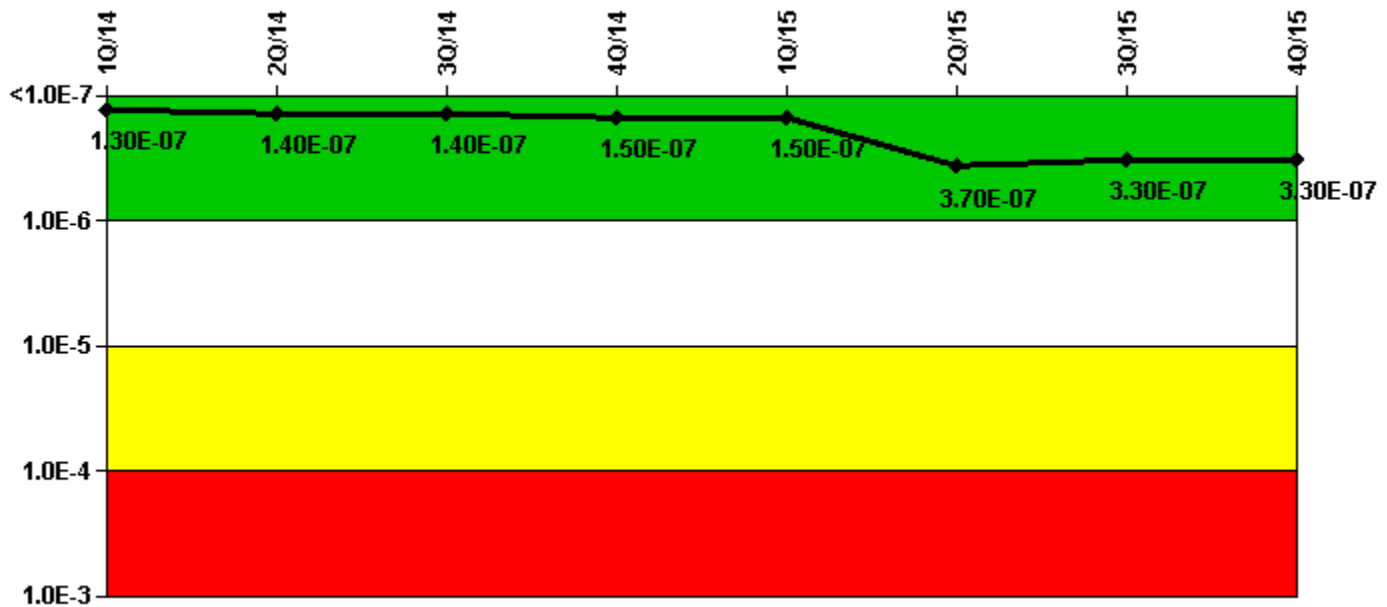

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
UAI (ΔCDF)	-9.93E-09	2.39E-09	1.69E-09	9.18E-09	8.66E-09	1.57E-08	-2.97E-08	-2.90E-08
URI (ΔCDF)	1.38E-07	1.40E-07	1.40E-07	1.39E-07	1.37E-07	3.56E-07	3.57E-07	3.62E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.30E-07	1.40E-07	1.40E-07	1.50E-07	1.50E-07	3.70E-07	3.30E-07	3.30E-07

Licensee Comments:

2Q/15: The MS10 Cooling Water System data for 2Q15 was corrected for an ICES report on a Service Water pump breaker issue that needed to be included as a failure. This change did not affect the color of the indicator.

Reactor Coolant System Activity

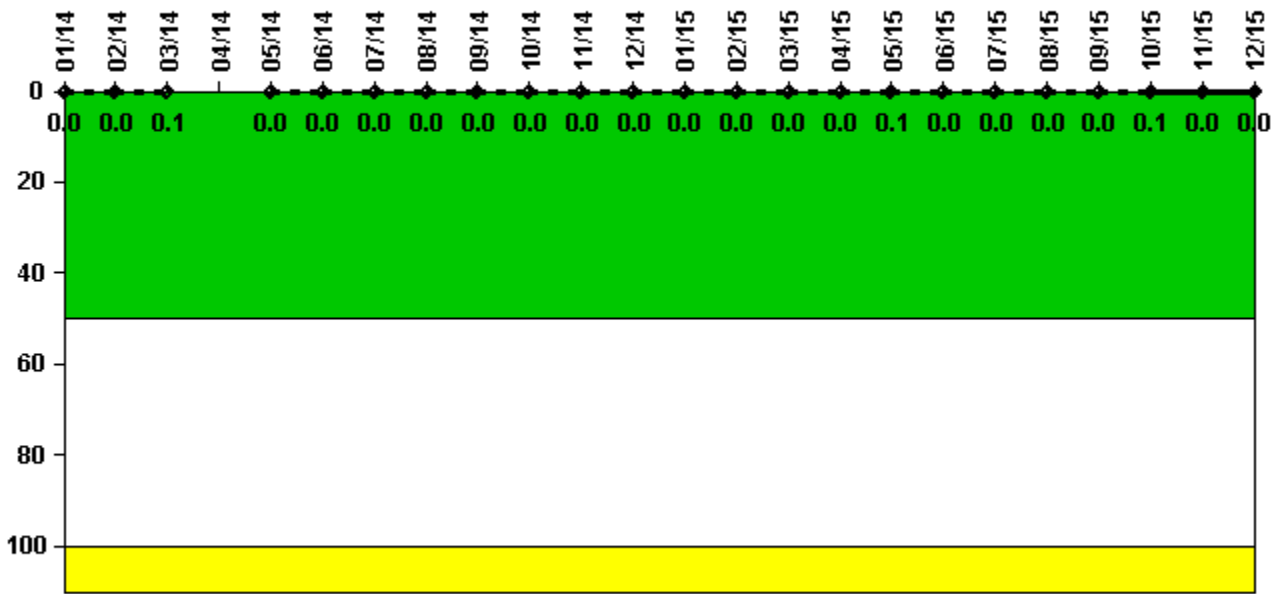

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	1/14	2/14	3/14	4/14	5/14	6/14	7/14	8/14	9/14	10/14	11/14	12/14
Maximum activity	0.000168	0.000158	0.000439	N/A	0.000098	0.000097	0.000113	0.000146	0.000140	0.000133	0.000170	0.000130
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0	0	0.1	N/A	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	1/15	2/15	3/15	4/15	5/15	6/15	7/15	8/15	9/15	10/15	11/15	12/15
Maximum activity	0.000140	0.000161	0.000156	0.000158	0.000566	0.000145	0.000177	0.000156	0.000185	0.000449	0.000081	0.000105
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0	0	0	0	0.1	0	0	0	0	0.1	0	0

Licensee Comments: none

Reactor Coolant System Leakage

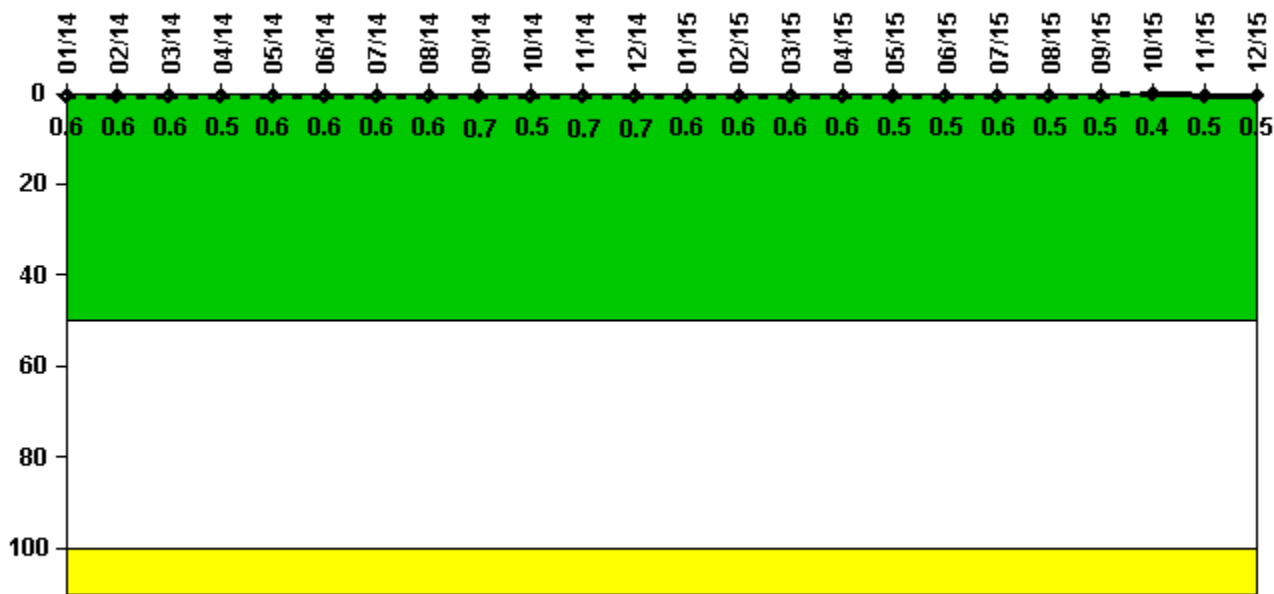

Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	1/14	2/14	3/14	4/14	5/14	6/14	7/14	8/14	9/14	10/14	11/14	12/14
Maximum leakage	0.060	0.059	0.064	0.054	0.060	0.055	0.060	0.060	0.067	0.053	0.069	0.065
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.6	0.6	0.6	0.5	0.6	0.6	0.6	0.6	0.7	0.5	0.7	0.7
Reactor Coolant System Leakage	1/15	2/15	3/15	4/15	5/15	6/15	7/15	8/15	9/15	10/15	11/15	12/15
Maximum leakage	0.064	0.055	0.061	0.059	0.052	0.053	0.056	0.050	0.050	0.042	0.052	0.054
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.6	0.6	0.6	0.6	0.5	0.5	0.6	0.5	0.5	0.4	0.5	0.5

Licensee Comments:

12/15: RCS total leakage is being reported as identified leakage.

9/15: RCS total leakage is being reported as identified leakage.

6/15: RCS total leakage is being reported as identified leakage.

3/15: RCS total leakage is being reported as identified leakage.


12/14: RCS total leakage is being reported as identified leakage.

9/14: RCS total leakage is being reported as identified leakage.

6/14: RCS total leakage is being reported as identified leakage.

3/14: RCS total leakage is being reported as identified leakage.

Drill/Exercise Performance

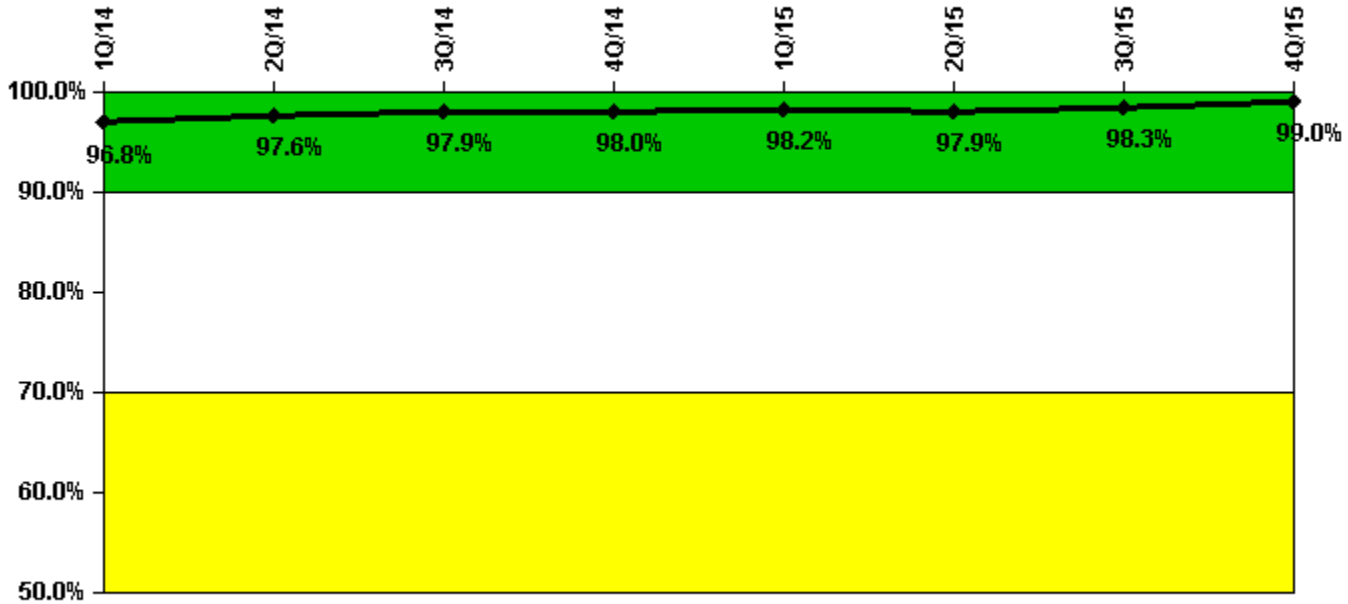


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
Successful opportunities	36.0	43.0	58.0	13.0	63.0	76.0	76.0	34.0
Total opportunities	36.0	43.0	58.0	13.0	63.0	79.0	77.0	34.0
Indicator value	96.8%	97.6%	97.9%	98.0%	98.2%	97.9%	98.3%	99.0%

Licensee Comments: none

ERO Drill Participation

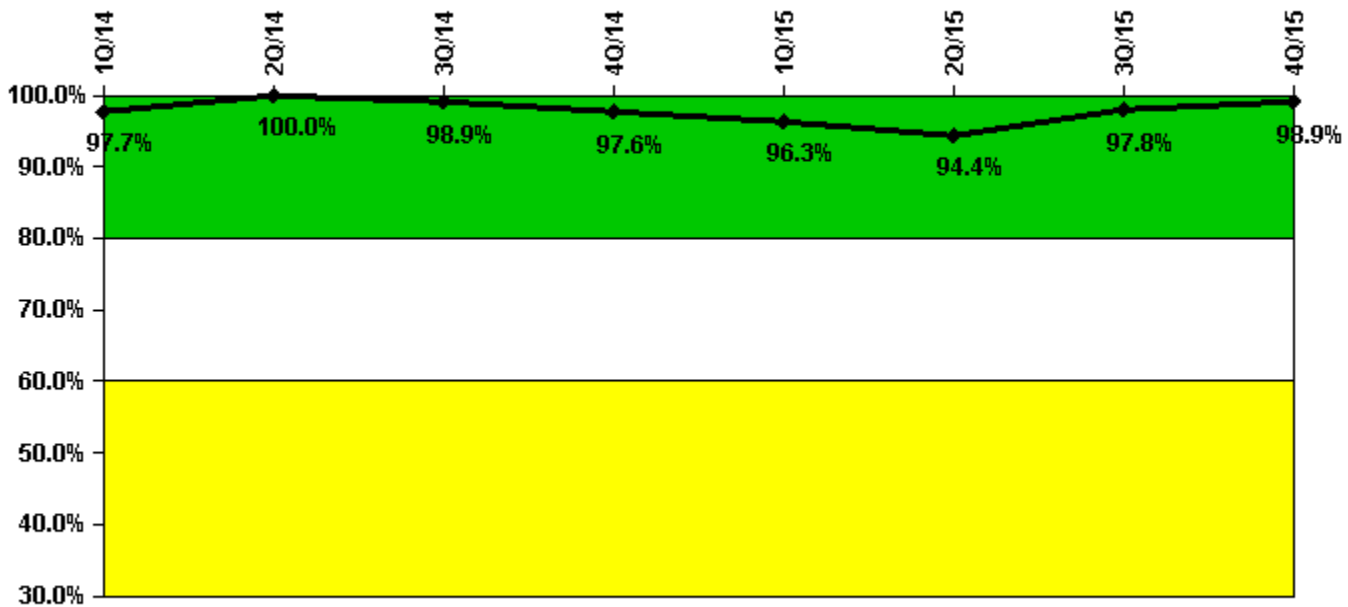


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
Participating Key personnel	85.0	87.0	86.0	83.0	77.0	84.0	90.0	94.0
Total Key personnel	87.0	87.0	87.0	85.0	80.0	89.0	92.0	95.0
Indicator value	97.7%	100.0%	98.9%	97.6%	96.3%	94.4%	97.8%	98.9%

Licensee Comments: none

Alert & Notification System

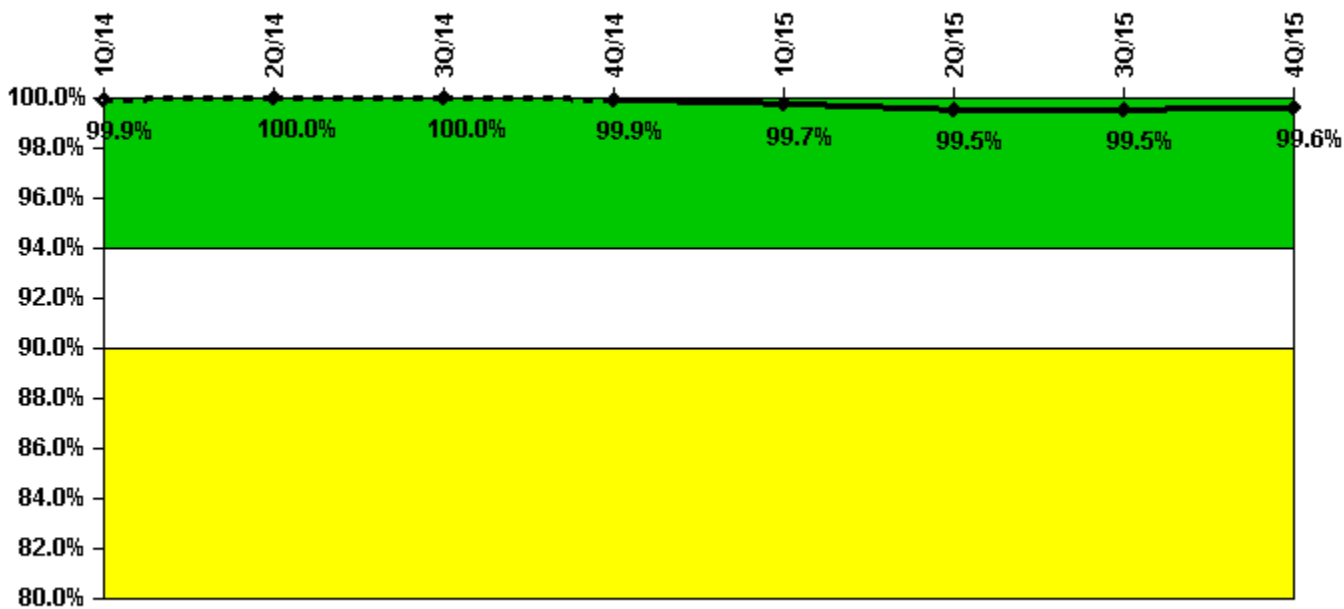


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
Successful siren-tests	432	432	432	431	428	429	432	432
Total sirens-tests	432	432	432	432	432	432	432	432
Indicator value	99.9%	100.0%	100.0%	99.9%	99.7%	99.5%	99.5%	99.6%

Licensee Comments: none

Occupational Exposure Control Effectiveness

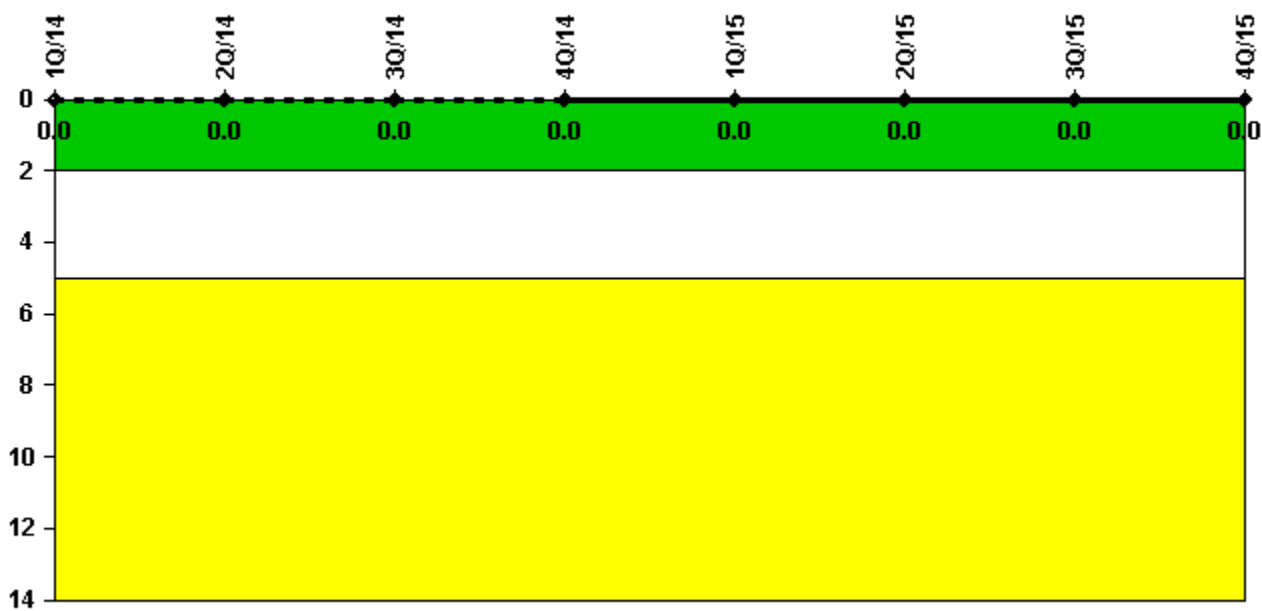

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: March 1, 2016