


Hatch 2

1Q/2016 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

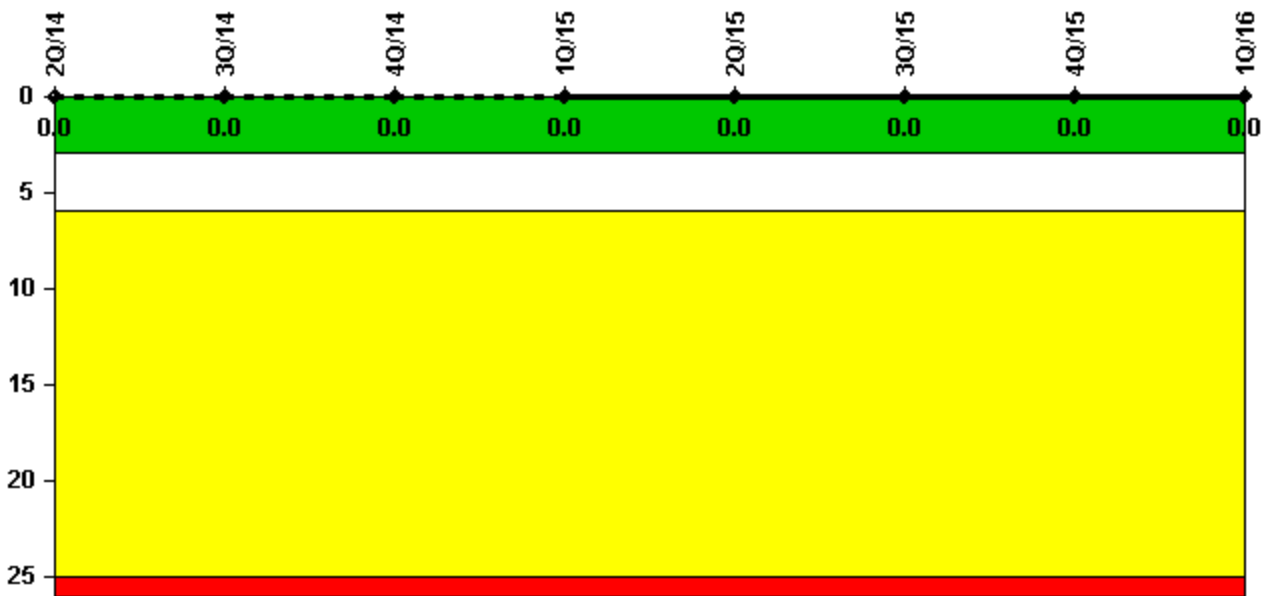


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2184.0	2208.0	2209.0	1424.6	2184.0	2208.0	2209.0	2183.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

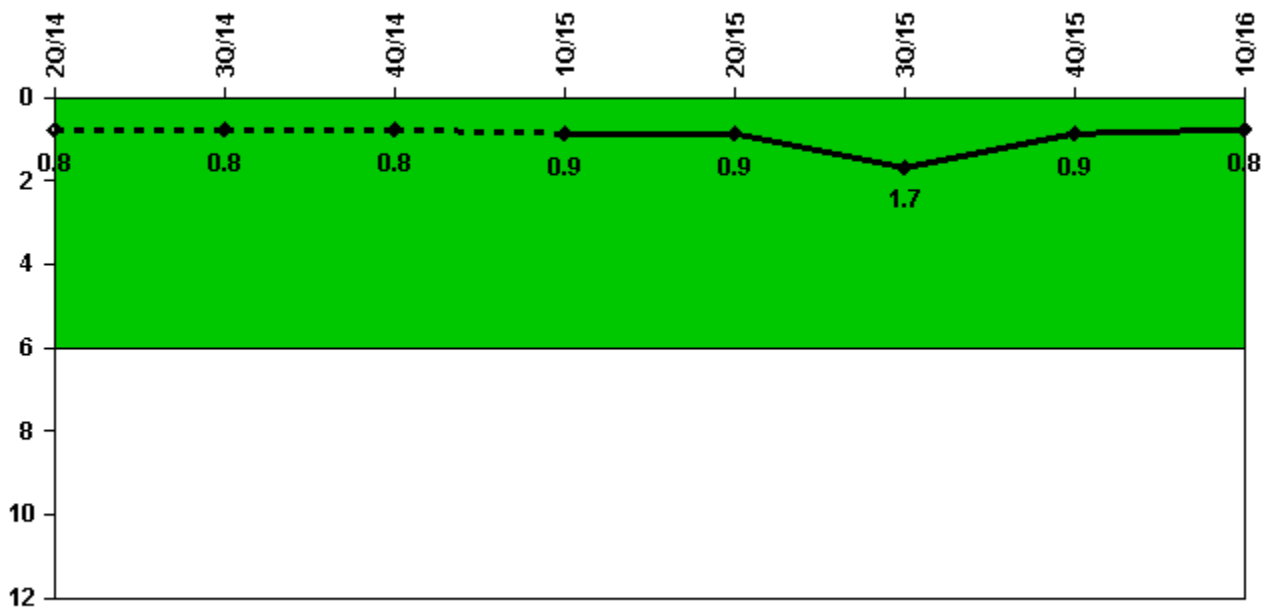

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Unplanned power changes	0	0	1.0	0	0	1.0	0	0
Critical hours	2184.0	2208.0	2209.0	1424.6	2184.0	2208.0	2209.0	2183.0
Indicator value	0.8	0.8	0.8	0.9	0.9	1.7	0.9	0.8

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

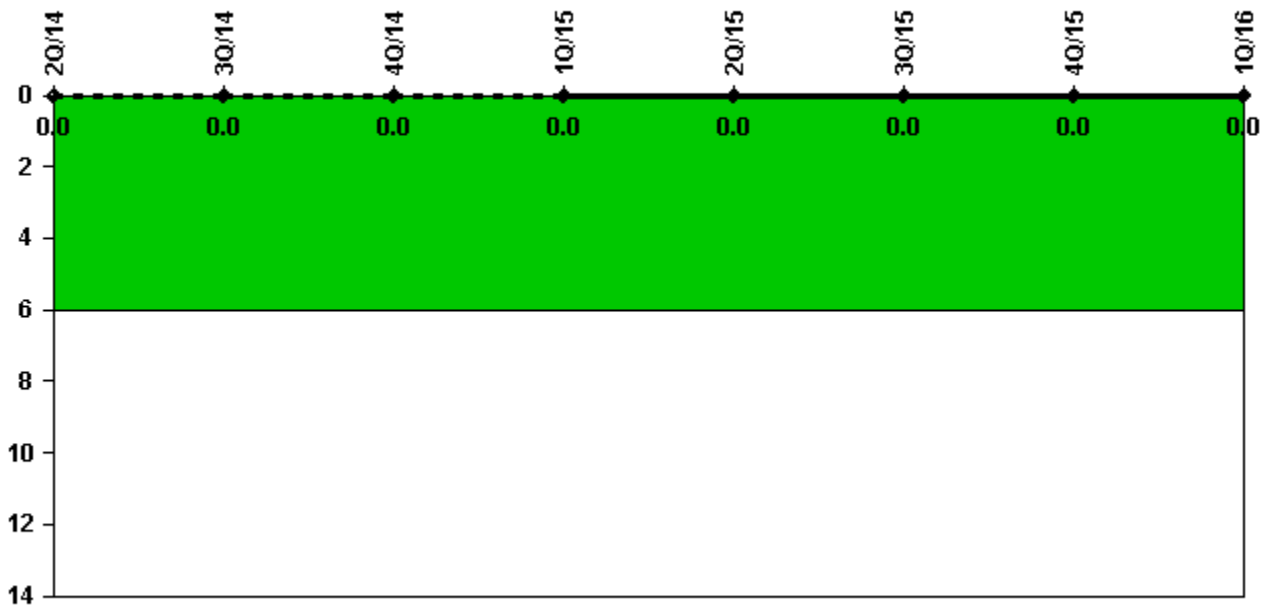


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

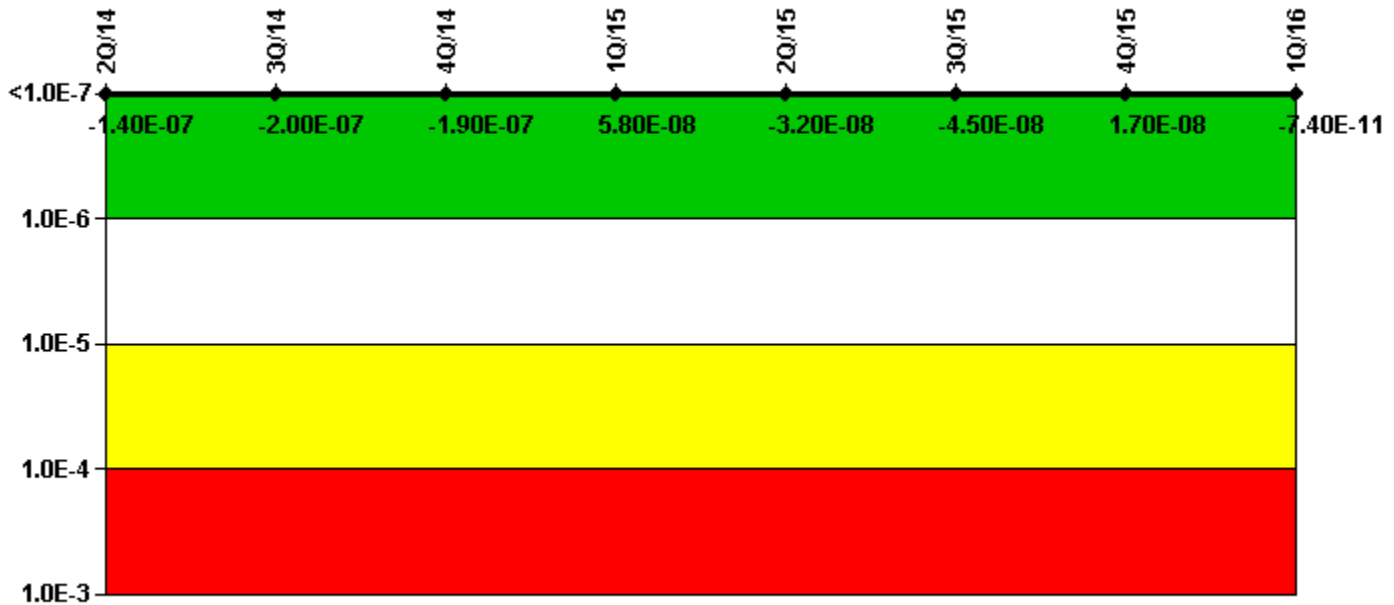

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
UAI (Δ CDF)	1.50E-07	9.22E-08	9.47E-08	1.12E-07	2.22E-08	5.53E-09	6.75E-08	5.92E-08
URI (Δ CDF)	-2.95E-07	-2.95E-07	-2.88E-07	-5.42E-08	-5.38E-08	-5.05E-08	-5.05E-08	-5.92E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.40E-07	-2.00E-07	-1.90E-07	5.80E-08	-3.20E-08	-4.50E-08	1.70E-08	-7.40E-11

Licensee Comments:

1Q/16: One fuel leak condition affecting the 2C diesel is under evaluation.

Mitigating Systems Performance Index, High Pressure Injection System

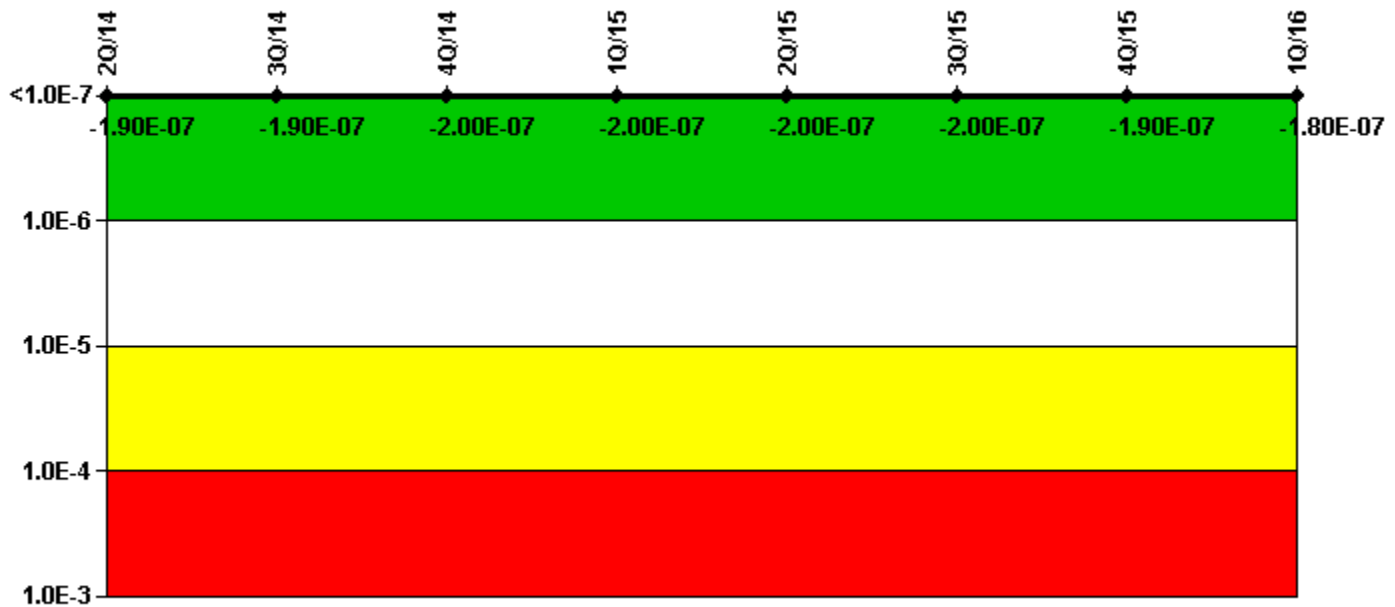


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
UAI (Δ CDF)	-7.82E-08	-7.82E-08	-7.82E-08	-7.82E-08	-7.82E-08	-7.82E-08	-7.82E-08	-7.82E-08
URI (Δ CDF)	-1.16E-07	-1.16E-07	-1.21E-07	-1.26E-07	-1.26E-07	-1.26E-07	-1.12E-07	-1.01E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.90E-07	-1.90E-07	-2.00E-07	-2.00E-07	-2.00E-07	-2.00E-07	-1.90E-07	-1.80E-07

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

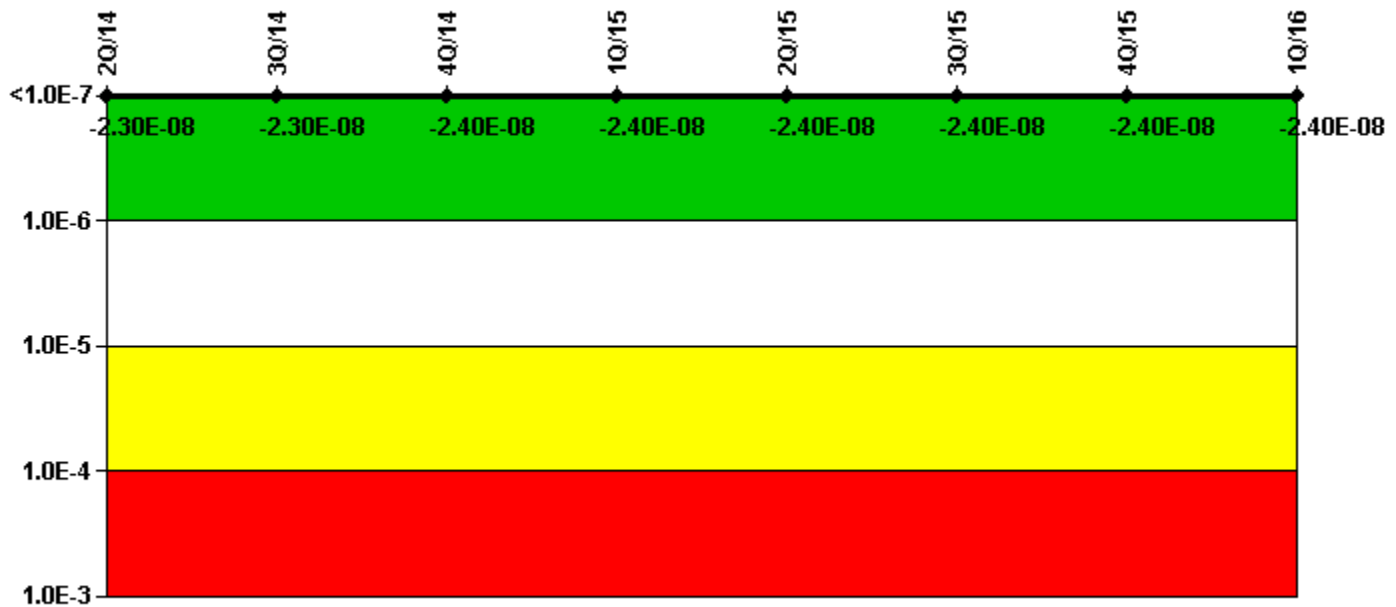


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
UAI (Δ CDF)	-6.20E-09	-6.20E-09	-6.20E-09	-6.18E-09	-6.19E-09	-6.69E-09	-6.69E-09	-6.69E-09
URI (Δ CDF)	-1.67E-08	-1.67E-08	-1.74E-08	-1.77E-08	-1.77E-08	-1.76E-08	-1.76E-08	-1.68E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.30E-08	-2.30E-08	-2.40E-08	-2.40E-08	-2.40E-08	-2.40E-08	-2.40E-08	-2.40E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

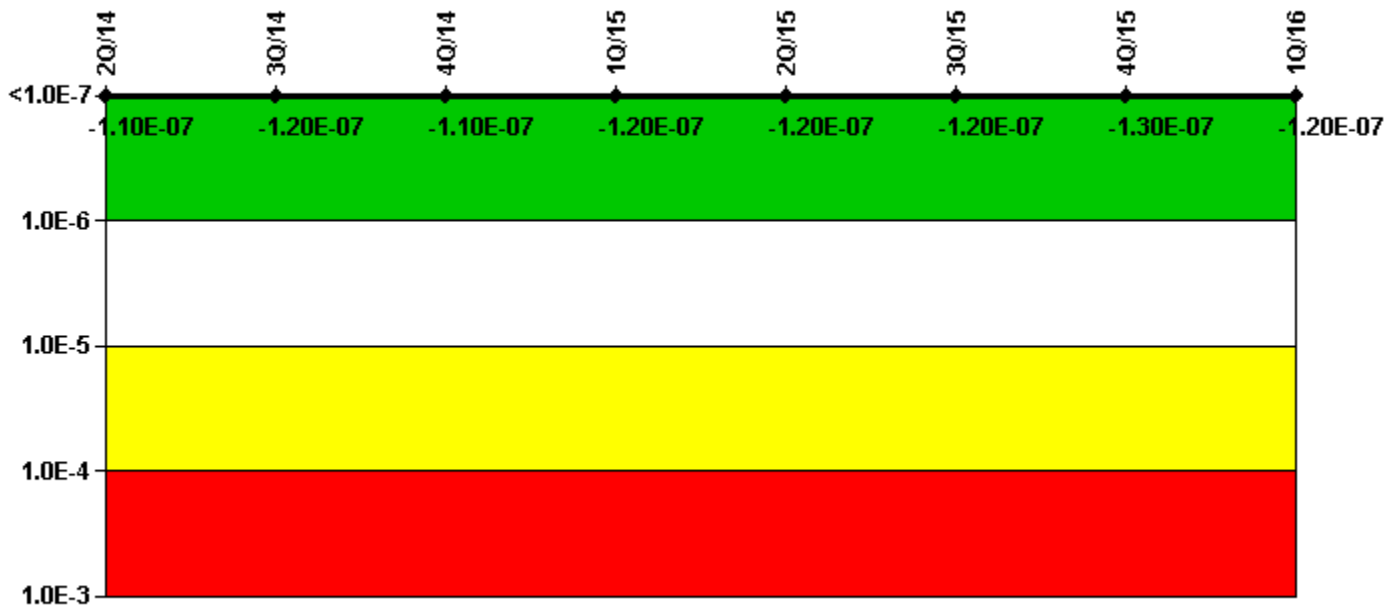

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
UAI (Δ CDF)	-9.00E-09	-9.00E-09	-6.25E-09	-1.22E-09	-2.28E-09	-6.82E-09	-1.18E-08	-1.18E-08
URI (Δ CDF)	-1.04E-07	-1.07E-07	-1.06E-07	-1.14E-07	-1.15E-07	-1.14E-07	-1.14E-07	-1.11E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.10E-07	-1.20E-07	-1.10E-07	-1.20E-07	-1.20E-07	-1.20E-07	-1.30E-07	-1.20E-07

Licensee Comments:

2Q/14: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Cooling Water Systems

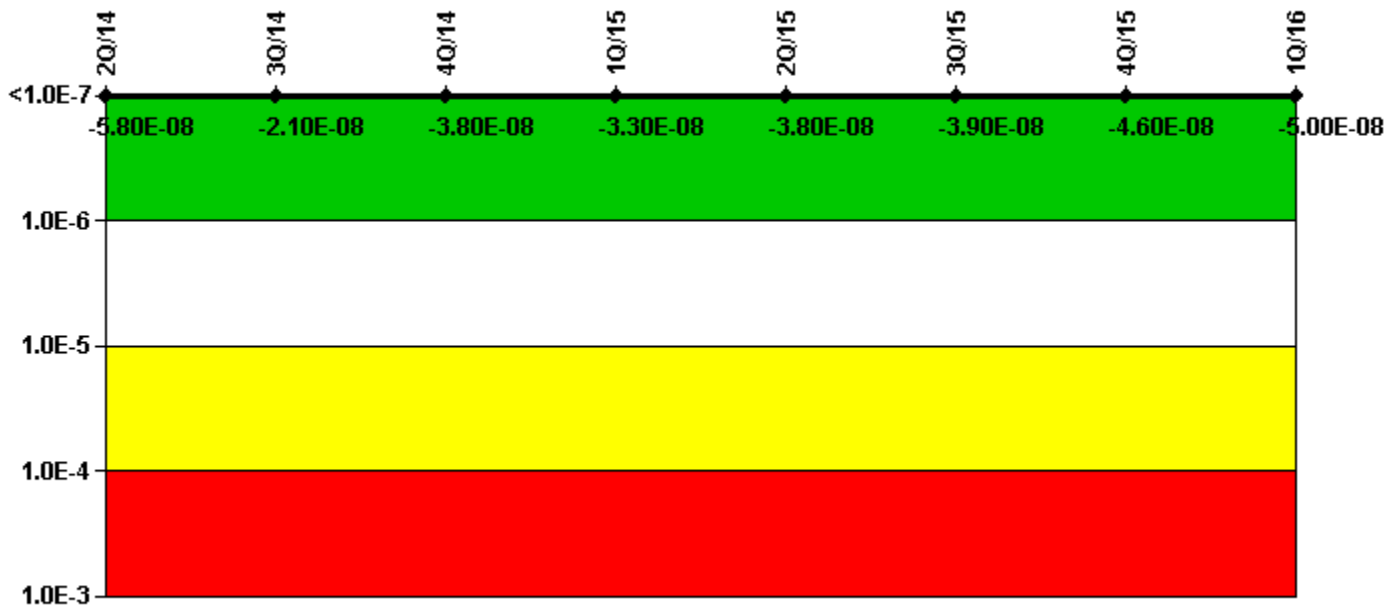


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
UAI (Δ CDF)	2.10E-08	6.12E-08	4.64E-08	5.14E-08	4.96E-08	4.96E-08	4.48E-08	3.91E-08
URI (Δ CDF)	-7.86E-08	-8.23E-08	-8.45E-08	-8.47E-08	-8.72E-08	-8.90E-08	-9.07E-08	-8.93E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.80E-08	-2.10E-08	-3.80E-08	-3.30E-08	-3.80E-08	-3.90E-08	-4.60E-08	-5.00E-08

Licensee Comments: none

Reactor Coolant System Activity

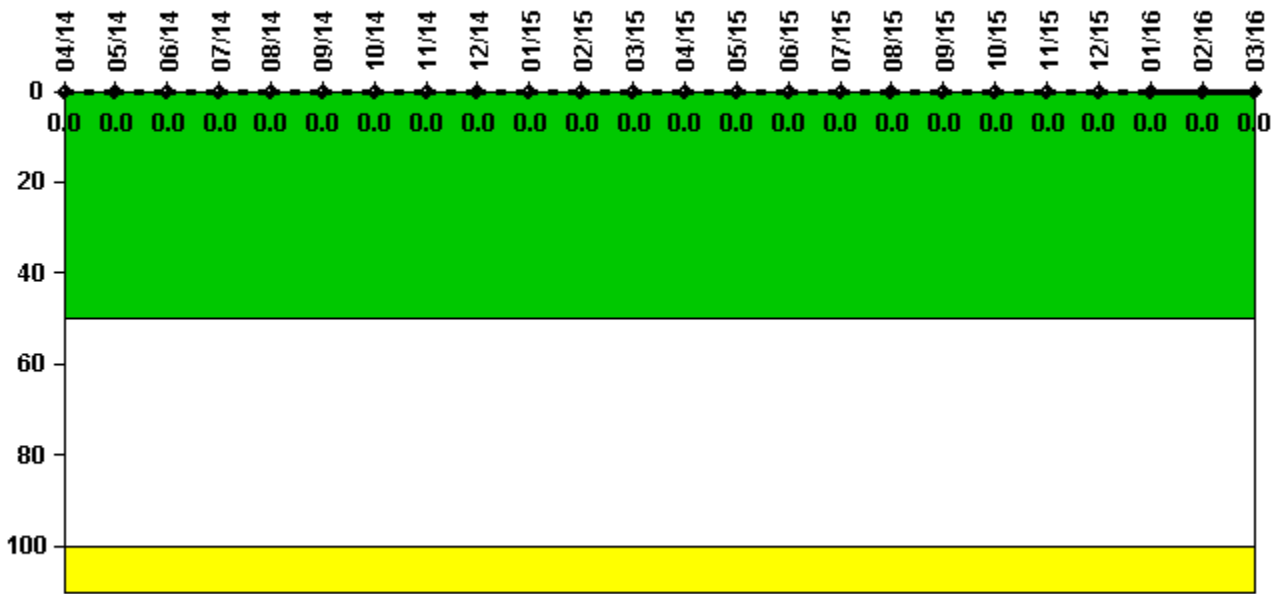

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/14	5/14	6/14	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15
Maximum activity	0.000027	0.000051	0.000061	0.000030	0.000027	0.000027	0.000027	0.000019	0.000088	0.000016	0.000020	0.000010
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	4/15	5/15	6/15	7/15	8/15	9/15	10/15	11/15	12/15	1/16	2/16	3/16
Maximum activity	0.000012	0.000013	0.000016	0.000016	0.000016	0.000013	0.000013	0.000010	0.000005	0.000010	0.000008	0.000007
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

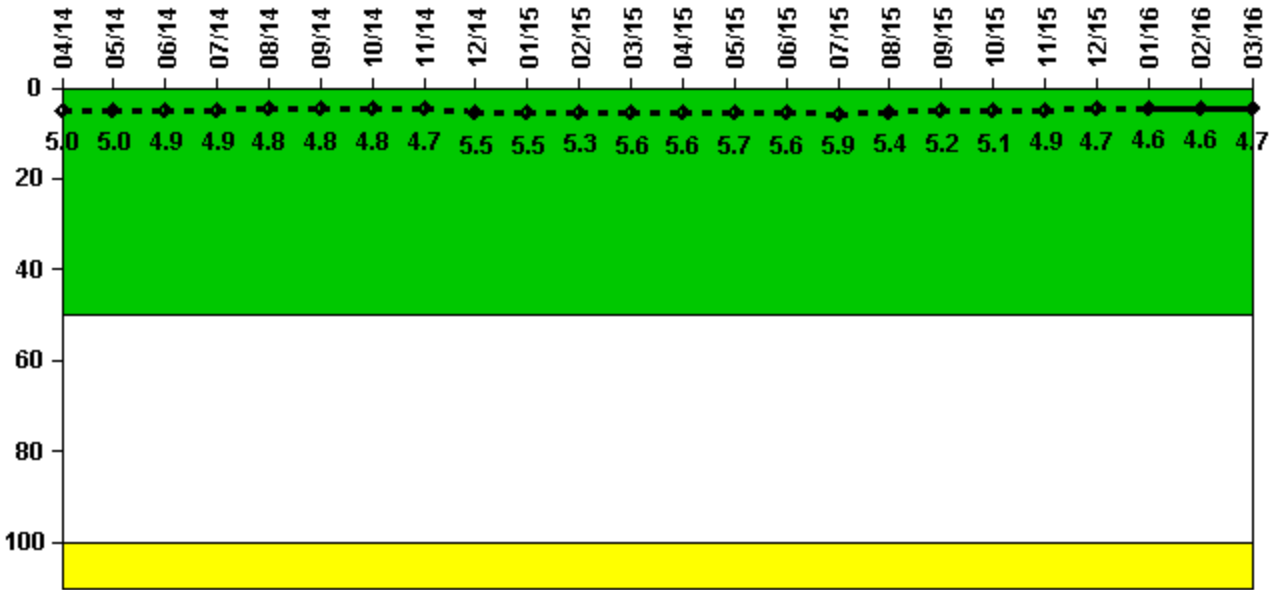

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	4/14	5/14	6/14	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15
Maximum leakage	1.510	1.510	1.460	1.470	1.450	1.430	1.430	1.410	1.660	1.660	1.600	1.690
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	5.0	5.0	4.9	4.9	4.8	4.8	4.8	4.7	5.5	5.5	5.3	5.6

Reactor Coolant System Leakage	4/15	5/15	6/15	7/15	8/15	9/15	10/15	11/15	12/15	1/16	2/16	3/16
Maximum leakage	1.690	1.710	1.670	1.760	1.630	1.560	1.540	1.470	1.420	1.380	1.370	1.400
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	5.6	5.7	5.6	5.9	5.4	5.2	5.1	4.9	4.7	4.6	4.6	4.7

Licensee Comments: none

Drill/Exercise Performance

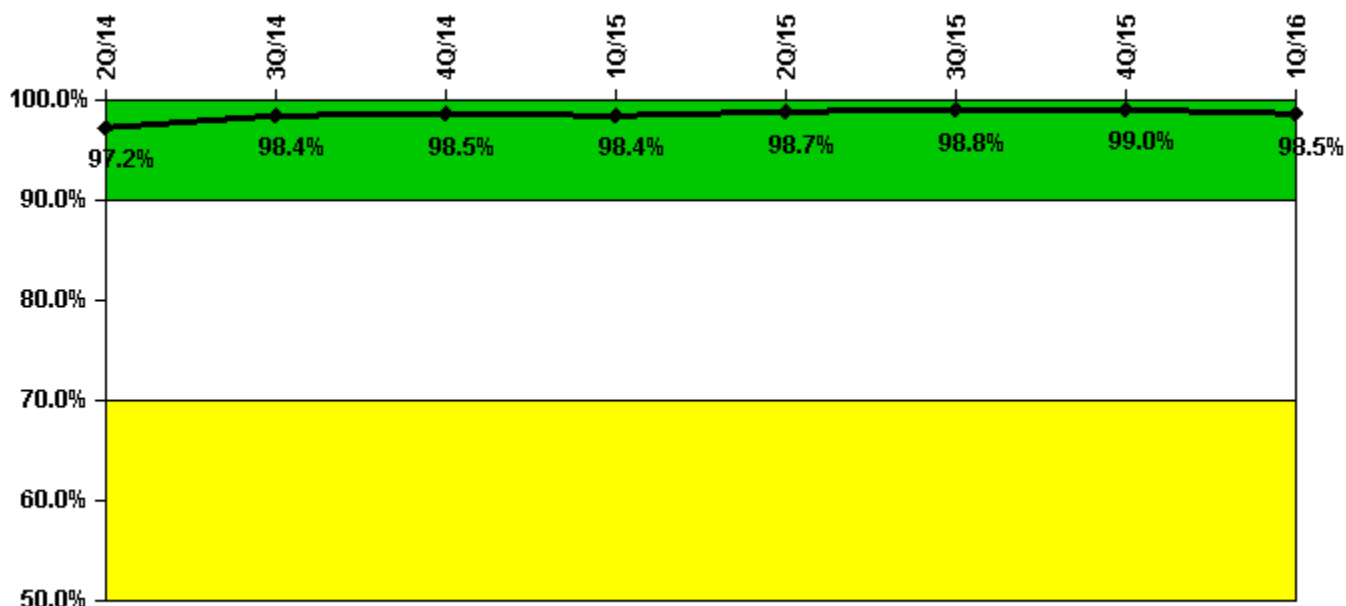

Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Successful opportunities	64.0	78.0	50.0	26.0	53.0	58.0	41.0	22.0
Total opportunities	65.0	78.0	50.0	26.0	55.0	58.0	42.0	24.0
Indicator value	97.2%	98.4%	98.5%	98.4%	98.7%	98.8%	99.0%	98.5%

Licensee Comments: none

ERO Drill Participation



Thresholds: White < 80.0% Yellow < 60.0%

Notes


ERO Drill Participation	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Participating Key personnel	106.0	109.0	112.0	109.0	107.0	101.0	105.0	99.0
Total Key personnel	106.0	109.0	112.0	109.0	107.0	101.0	105.0	99.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments:

4Q/15: November and December values revised due to a failure to remove an individual that no longer required to be tracked in the Control Room ENN Communicator position

3Q/14: Correction to the original data submitted in 3rd quarter 2014. This correction is due to the identification of members added to the ERO but not included in the participation data.

Alert & Notification System

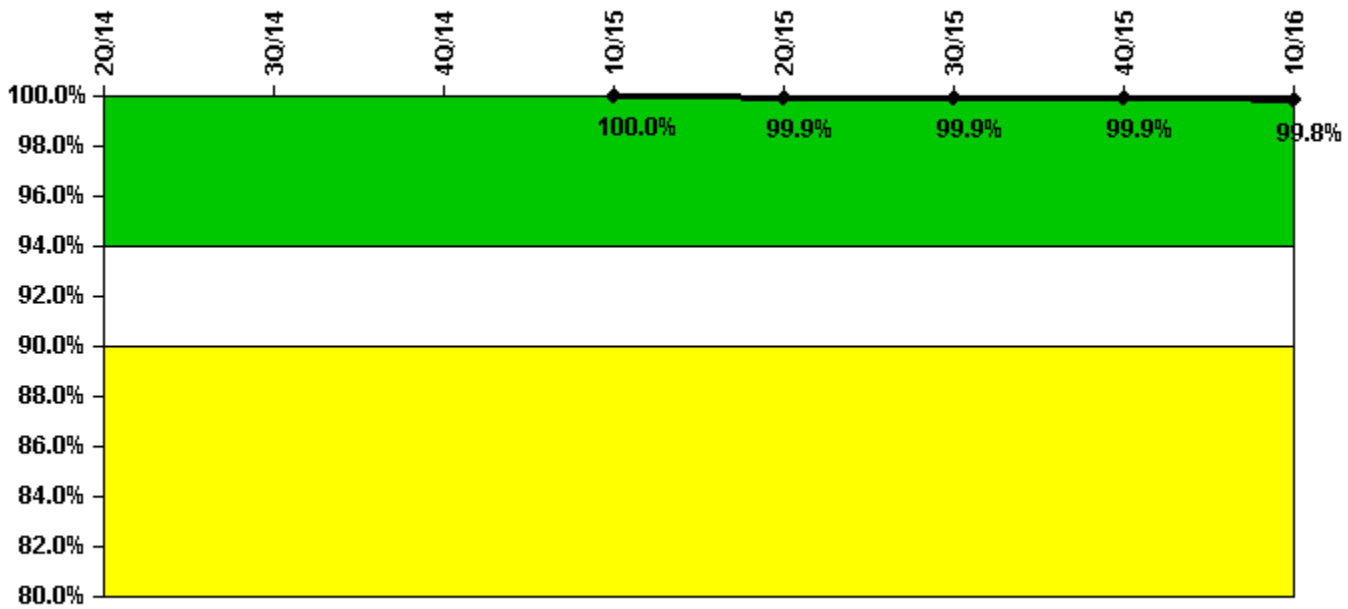


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Successful siren-tests	1040	1117	1120	960	1039	1117	1039	1038
Total sirens-tests	1040	1119	1120	960	1040	1120	1040	1040
Indicator value				100.0%	99.9%	99.9%	99.9%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

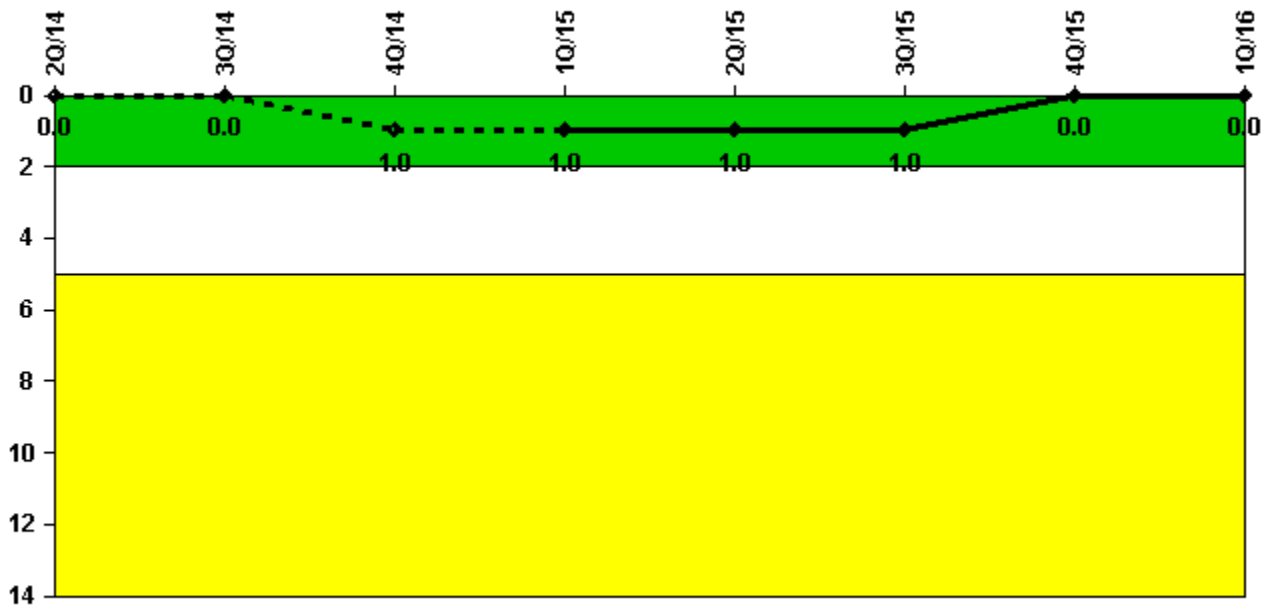


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
High radiation area occurrences	0	0	1	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	1	1	1	1	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

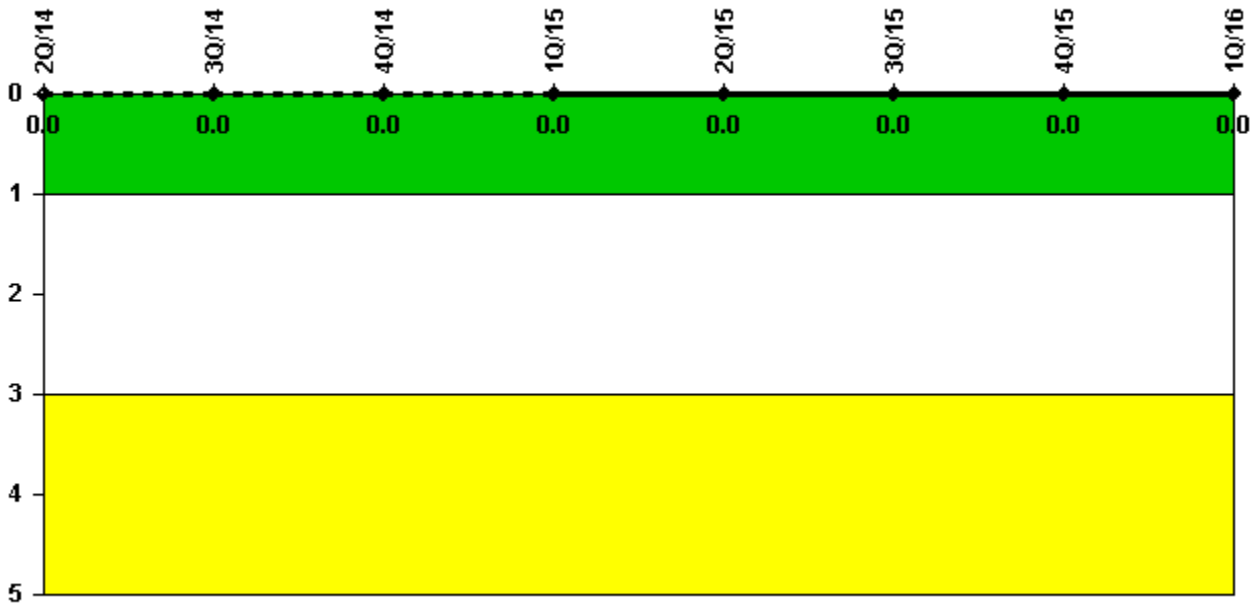

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 23, 2016