


Millstone 3

1Q/2016 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

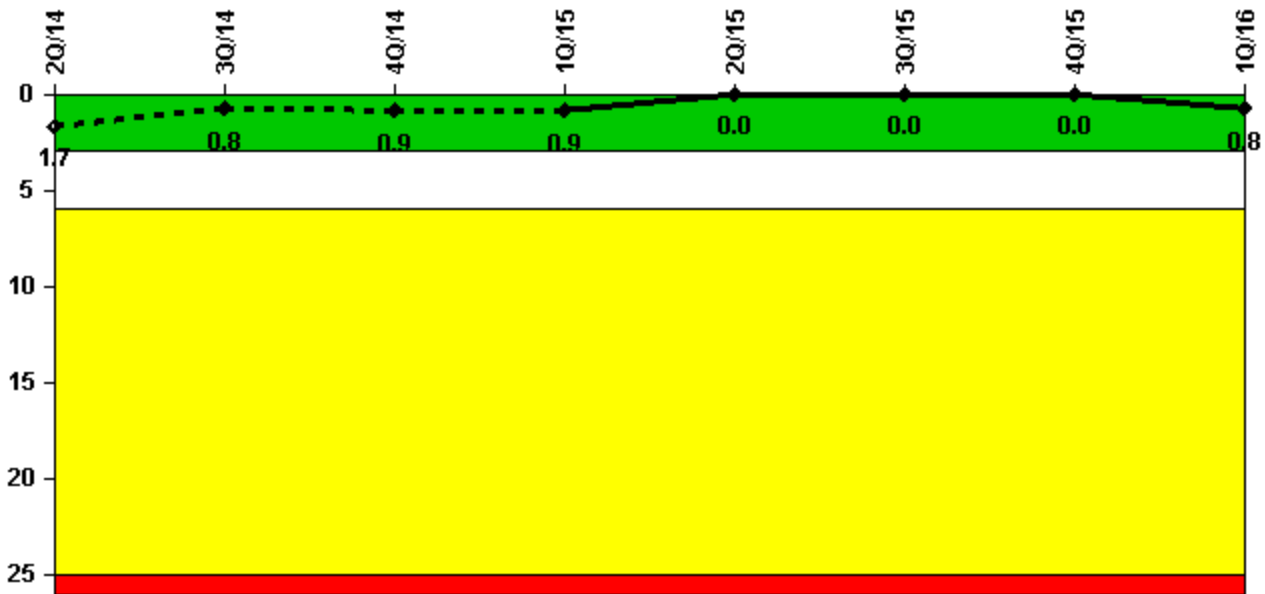


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Unplanned scrams	1.0	0	0	0	0	0	0	1.0
Critical hours	1994.9	2208.0	1363.8	2159.0	2184.0	2208.0	2209.0	2097.9
Indicator value	1.7	0.8	0.9	0.9	0	0	0	0.8

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

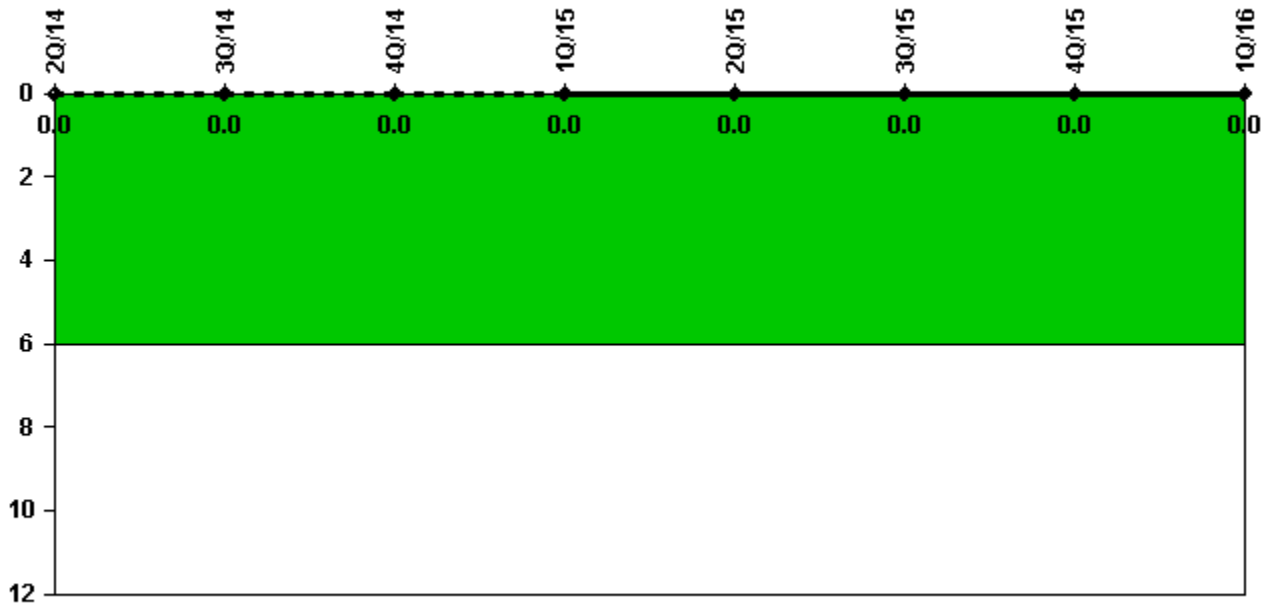


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	1994.9	2208.0	1363.8	2159.0	2184.0	2208.0	2209.0	2097.9
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

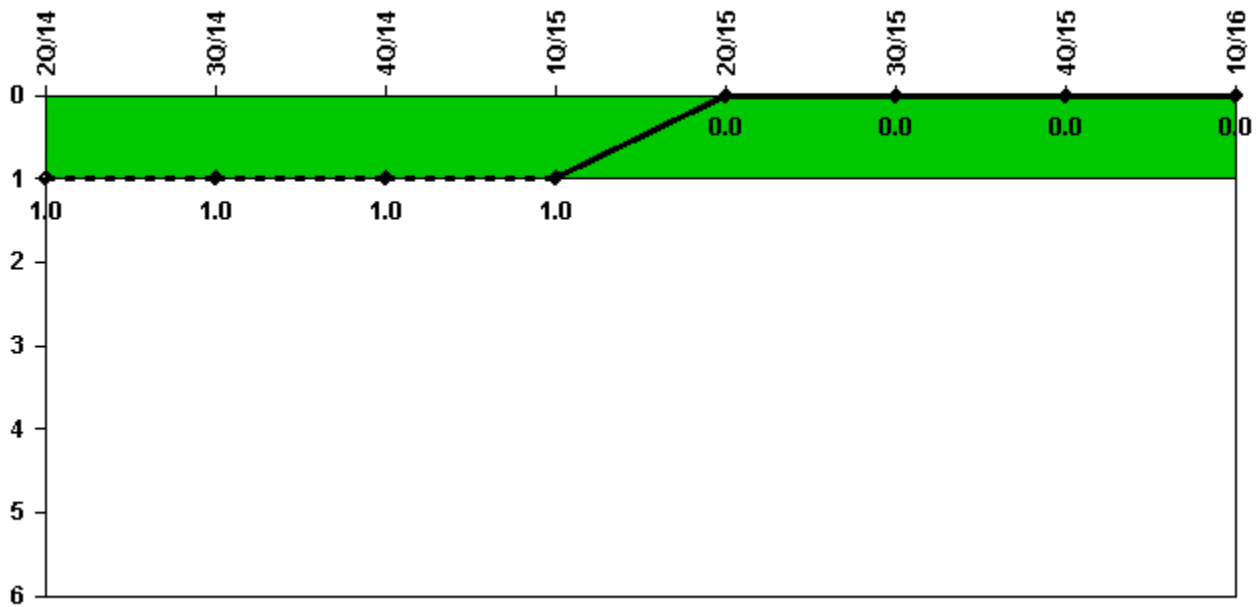


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Scrams with complications	1.0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	1.0	1.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

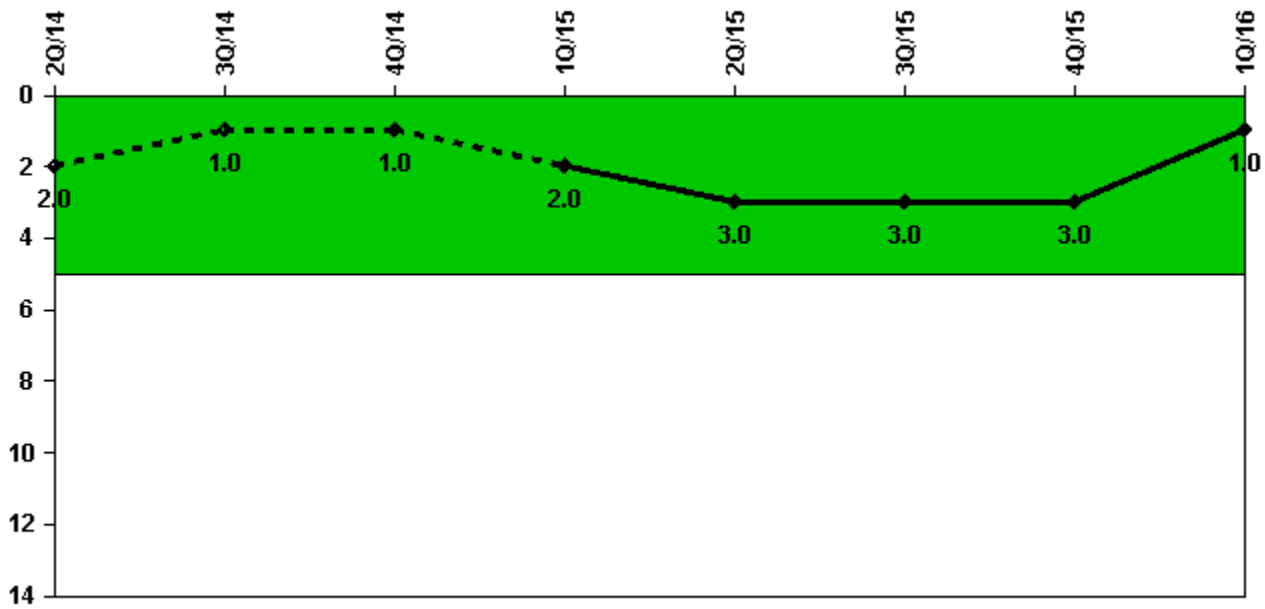

Thresholds: White > 5.0

Notes


Safety System Functional Failures (PWR)	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Safety System Functional Failures	0	0	0	2	1	0	0	0
Indicator value	2	1	1	2	3	3	3	1

Licensee Comments:

2Q/15: LER 2015-001-00, Unlatched Dual Train HELB Door Results in Potential Loss of Safety Function

1Q/15: LER 2014-004-00, Unlatched Dual Train HELB Door Results in Potential Loss of Safety Function.

Mitigating Systems Performance Index, Emergency AC Power System

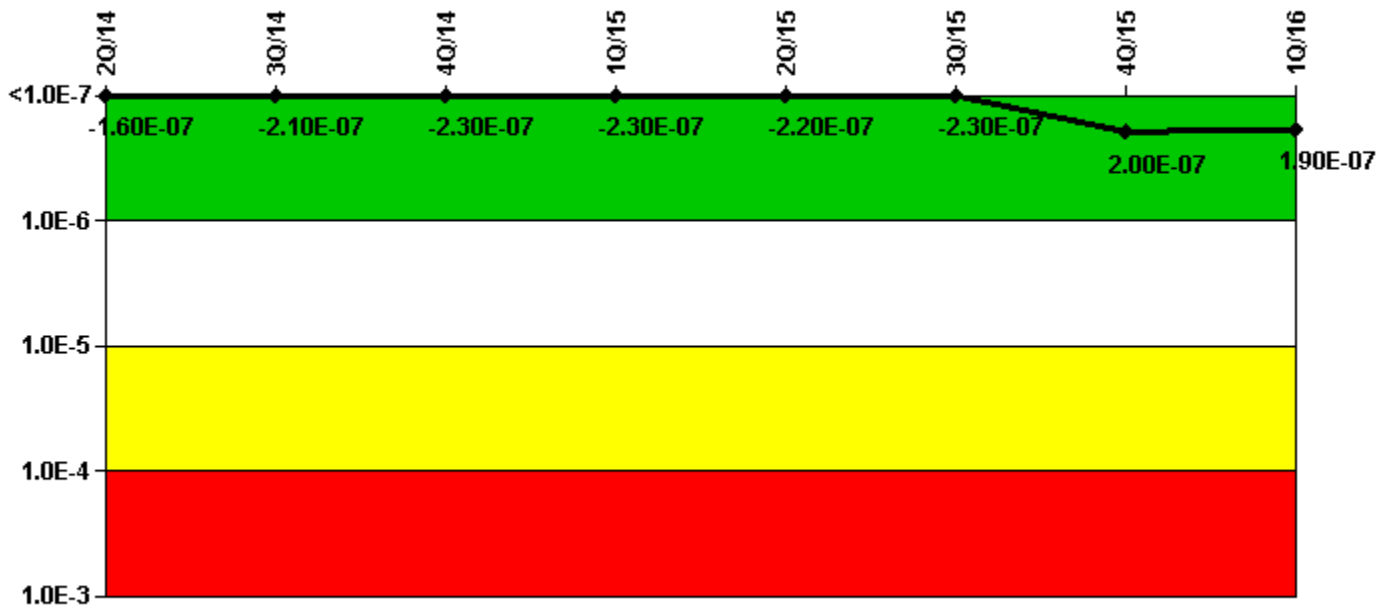

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
UAI (Δ CDF)	4.84E-08	-4.59E-09	-3.06E-08	-3.06E-08	-3.06E-08	-3.06E-08	4.82E-08	4.84E-08
URI (Δ CDF)	-2.10E-07	-2.09E-07	-2.03E-07	-2.00E-07	-1.91E-07	-1.95E-07	1.48E-07	1.46E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.60E-07	-2.10E-07	-2.30E-07	-2.30E-07	-2.20E-07	-2.30E-07	2.00E-07	1.90E-07

Licensee Comments:

4Q/14: Basis document updated in 4th quarter to update PRA values. No change to calculated MSPI.

Mitigating Systems Performance Index, High Pressure Injection System

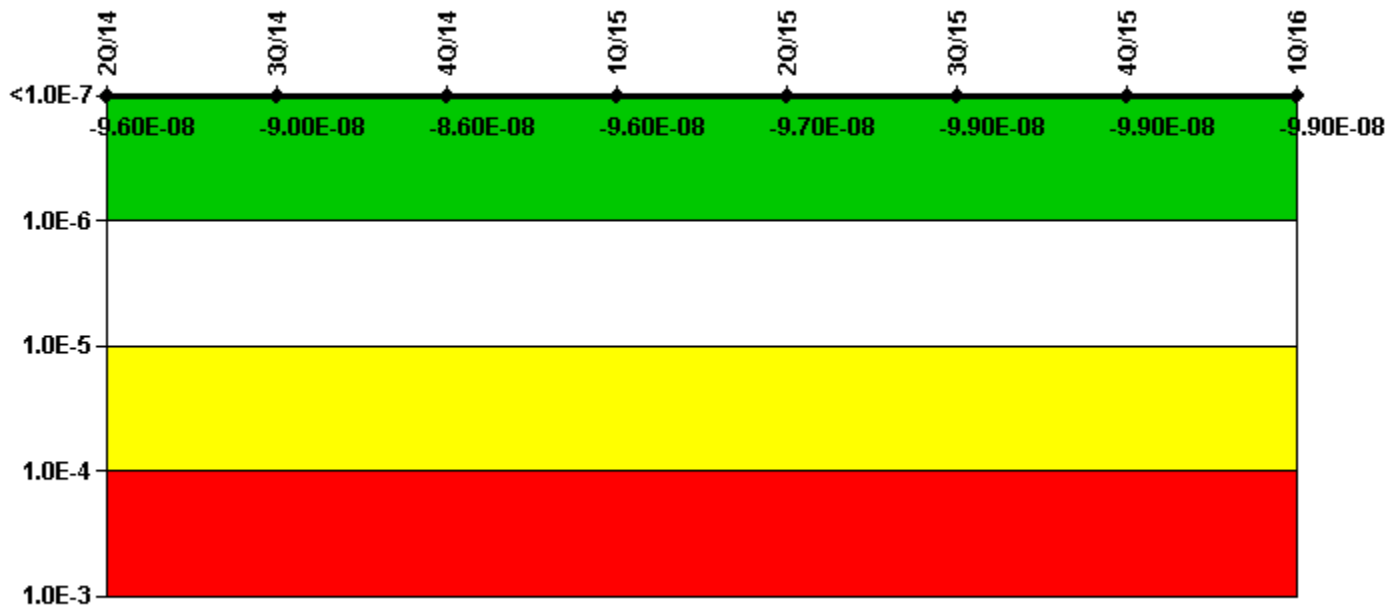

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
UAI (Δ CDF)	8.75E-09	1.43E-08	1.87E-08	1.35E-08	1.28E-08	1.11E-08	1.07E-08	1.14E-08
URI (Δ CDF)	-1.04E-07	-1.04E-07	-1.04E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-9.60E-08	-9.00E-08	-8.60E-08	-9.60E-08	-9.70E-08	-9.90E-08	-9.90E-08	-9.90E-08

Licensee Comments:

4Q/14: Basis document updated in 4th quarter to update PRA values. No change to calculated MSPI.

Mitigating Systems Performance Index, Heat Removal System

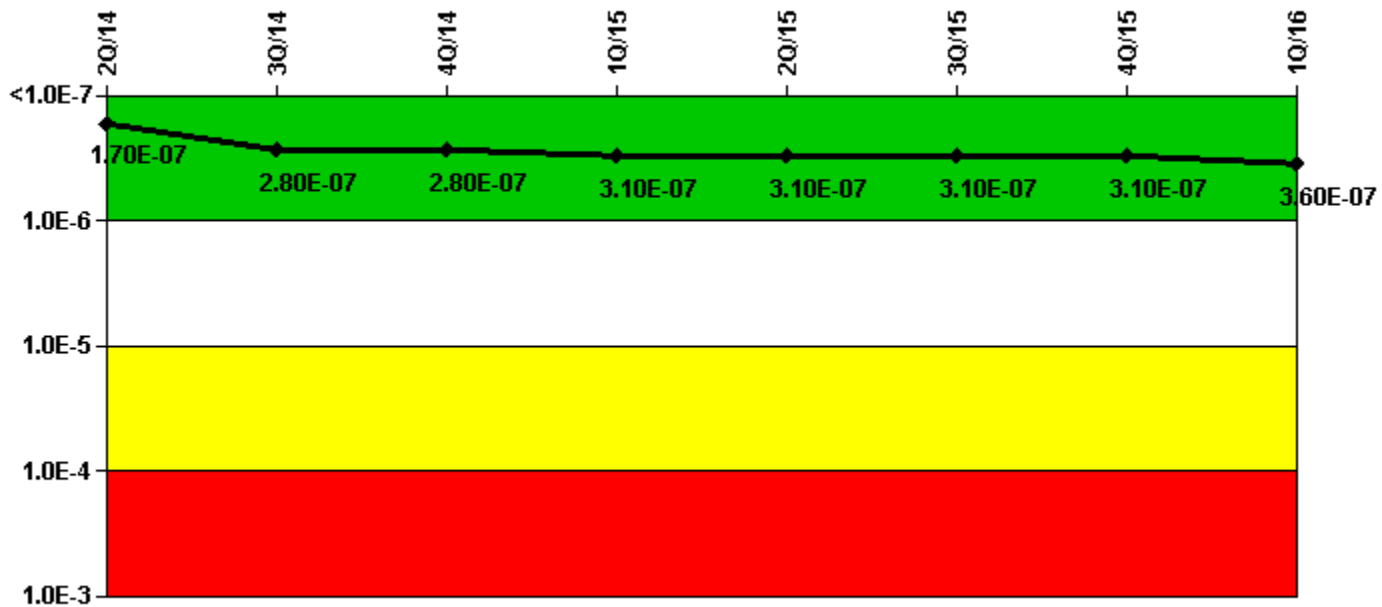

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
UAI (Δ CDF)	5.26E-08	7.85E-08	7.83E-08	7.34E-08	7.41E-08	7.44E-08	7.42E-08	8.26E-08
URI (Δ CDF)	1.20E-07	2.05E-07	2.03E-07	2.37E-07	2.37E-07	2.34E-07	2.34E-07	2.78E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.70E-07	2.80E-07	2.80E-07	3.10E-07	3.10E-07	3.10E-07	3.10E-07	3.60E-07


Licensee Comments:

4Q/14: Basis document updated in 4th quarter to update PRA values. No change to calculated MSPI. The open issue for the turbine driven auxiliary feedwater pump identified in July 2014 was determined to be a failure.

3Q/14: A condition report was written on the turbine driven Auxiliary Feedwater pump in July 2014. This condition report is under review. If the event is determined to be a failure the 3rd quarter values will be updated in the 4th quarter.

3Q/14: A condition report was written on the turbine driven Auxiliary Feedwater pump in July 2014. This condition report is under review. If the event is determined to be a failure the 3rd quarter values will be updated in the 4th quarter.

Mitigating Systems Performance Index, Residual Heat Removal System

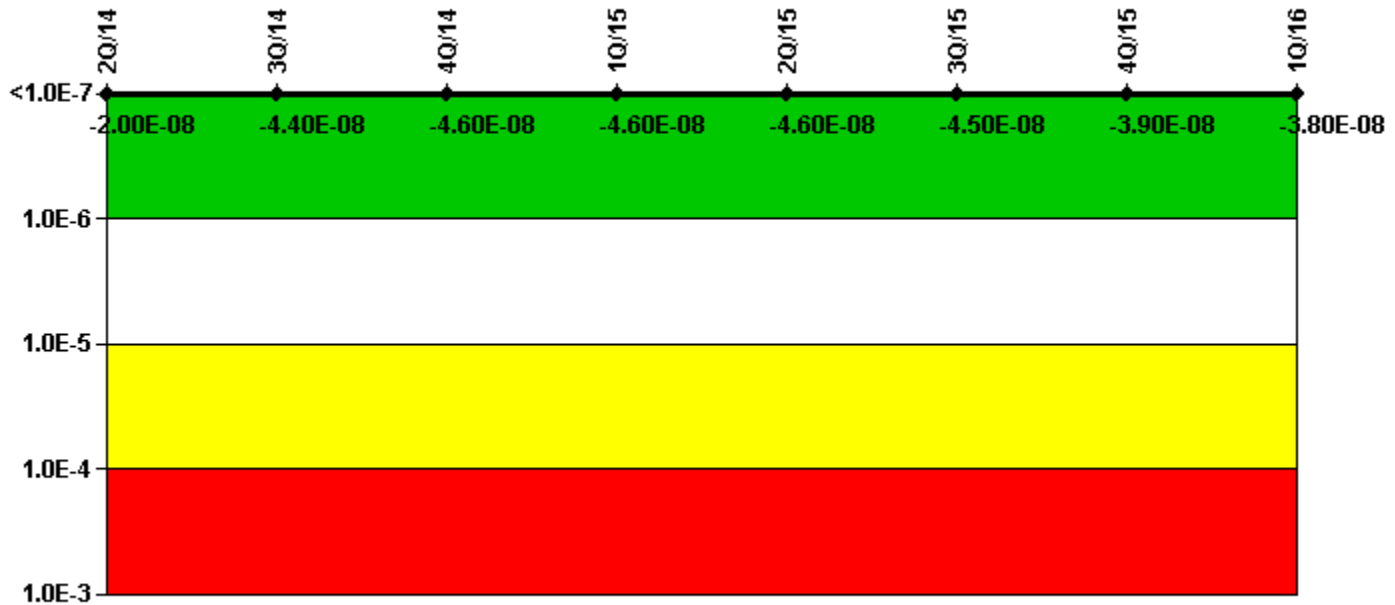


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
UAI (Δ CDF)	1.40E-08	-1.11E-08	-1.13E-08	-1.30E-08	-1.30E-08	-1.30E-08	-6.71E-09	-6.64E-09
URI (Δ CDF)	-3.40E-08	-3.33E-08	-3.45E-08	-3.29E-08	-3.31E-08	-3.20E-08	-3.24E-08	-3.16E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.00E-08	-4.40E-08	-4.60E-08	-4.60E-08	-4.60E-08	-4.50E-08	-3.90E-08	-3.80E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

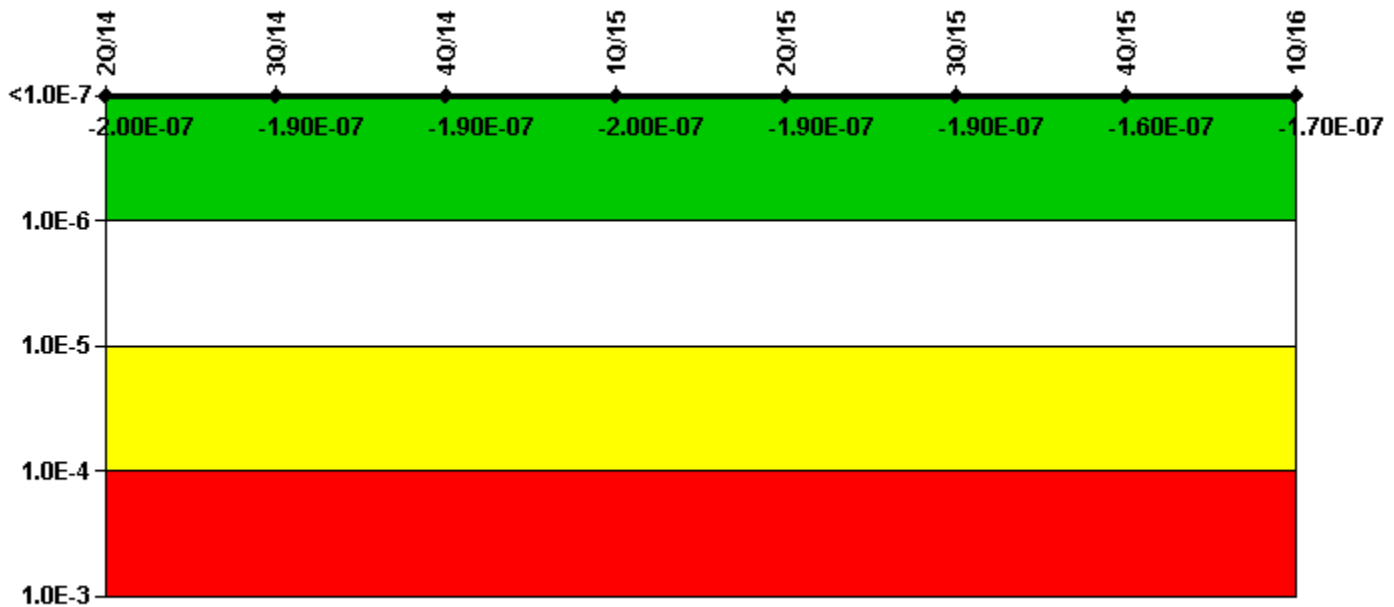


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
UAI (Δ CDF)	-1.65E-07	-1.62E-07	-1.64E-07	-1.65E-07	-1.64E-07	-1.64E-07	-1.30E-07	-1.45E-07
URI (Δ CDF)	-3.01E-08	-3.01E-08	-3.01E-08	-3.01E-08	-3.01E-08	-3.01E-08	-3.01E-08	-3.01E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.00E-07	-1.90E-07	-1.90E-07	-2.00E-07	-1.90E-07	-1.90E-07	-1.60E-07	-1.70E-07

Licensee Comments: none

Reactor Coolant System Activity

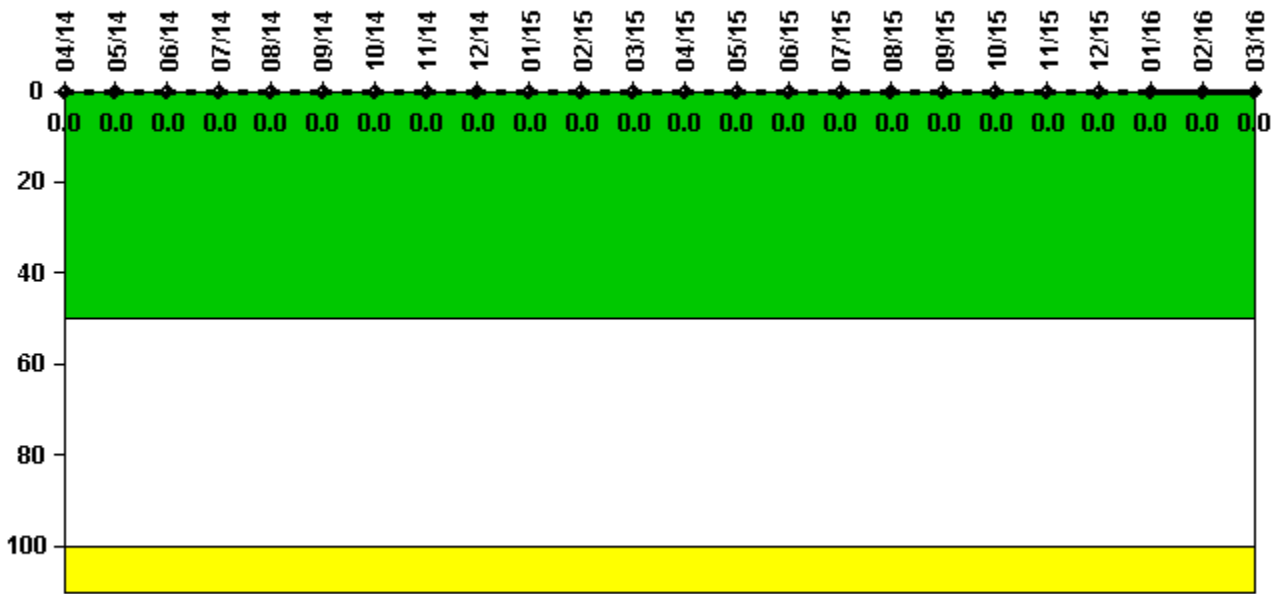

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/14	5/14	6/14	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15
Maximum activity	0.000148	0.000134	0.000138	0.000162	0.000186	0.000191	0.000176	0.000041	0.000084	0.000104	0.000084	0.000077
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	4/15	5/15	6/15	7/15	8/15	9/15	10/15	11/15	12/15	1/16	2/16	3/16
Maximum activity	0.000100	0.000090	0.000089	0.000103	0.000089	0.000105	0.000123	0.000112	0.000113	0.000124	0.000128	0.000134
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

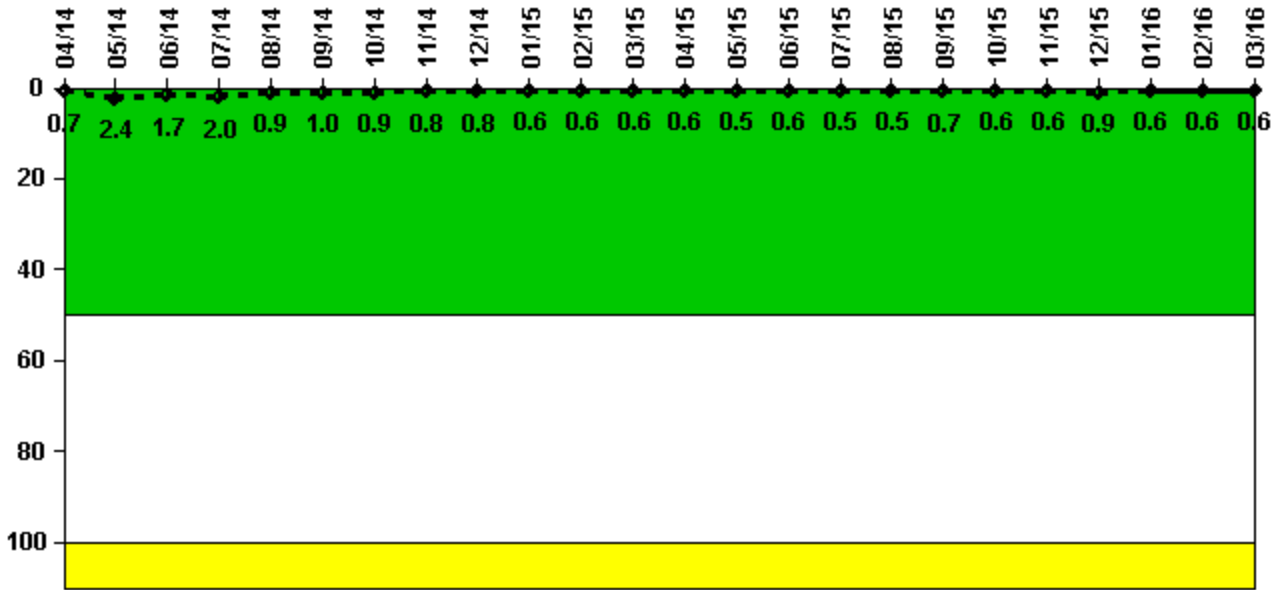

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	4/14	5/14	6/14	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15
Maximum leakage	0.070	0.236	0.174	0.199	0.086	0.095	0.085	0.076	0.078	0.061	0.063	0.055
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.7	2.4	1.7	2.0	0.9	1.0	0.9	0.8	0.8	0.6	0.6	0.6

Reactor Coolant System Leakage	4/15	5/15	6/15	7/15	8/15	9/15	10/15	11/15	12/15	1/16	2/16	3/16
Maximum leakage	0.055	0.054	0.057	0.052	0.050	0.067	0.058	0.059	0.087	0.059	0.058	0.059
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.6	0.5	0.6	0.5	0.5	0.7	0.6	0.6	0.9	0.6	0.6	0.6

Licensee Comments: none

Drill/Exercise Performance

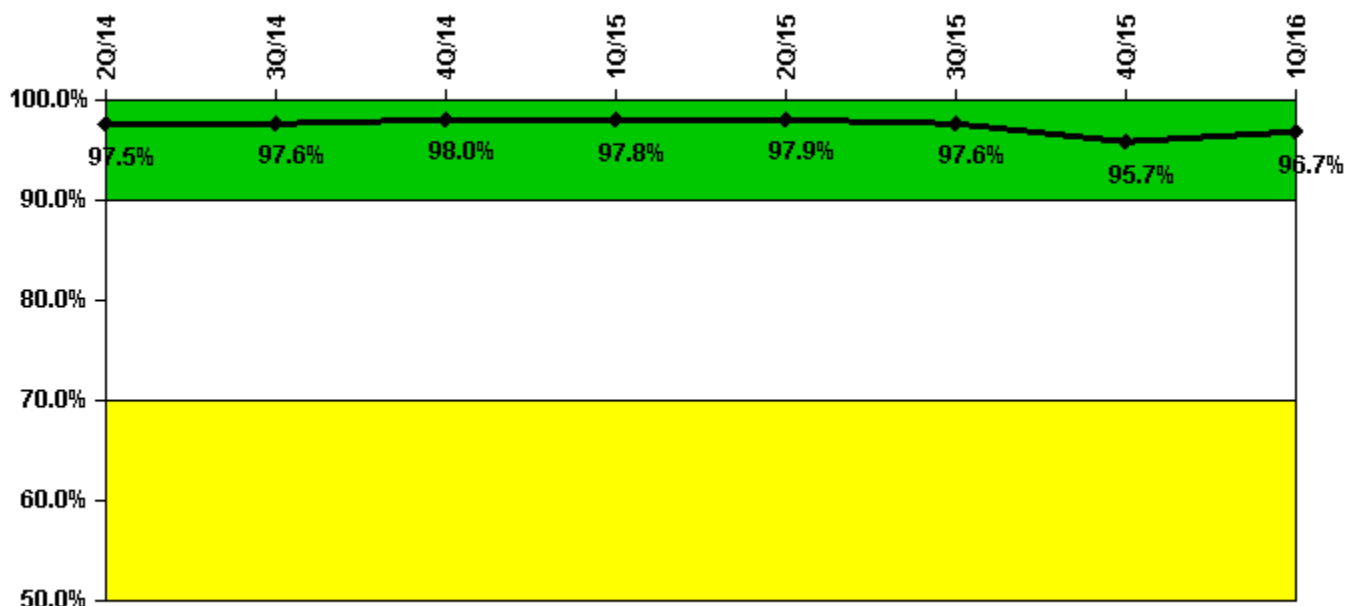


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Successful opportunities	25.0	27.0	6.0	23.0	36.0	30.0	24.0	36.0
Total opportunities	25.0	27.0	6.0	23.0	36.0	32.0	28.0	37.0
Indicator value	97.5%	97.6%	98.0%	97.8%	97.9%	97.6%	95.7%	96.7%

Licensee Comments: none

ERO Drill Participation

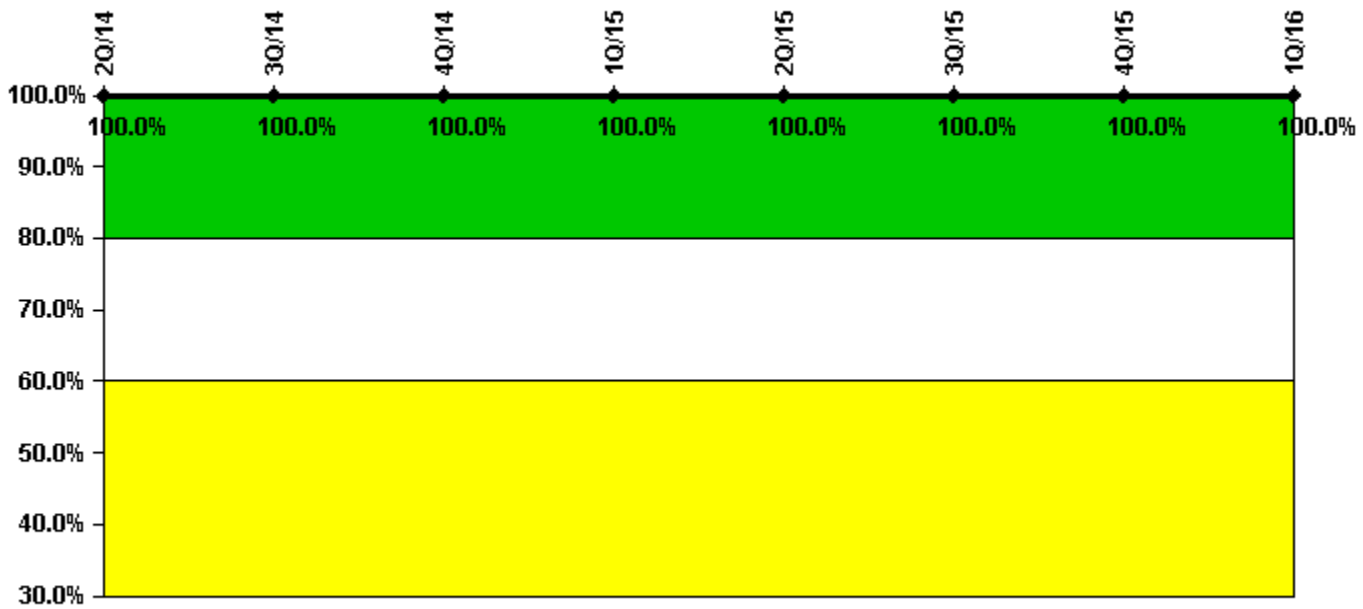


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Participating Key personnel	130.0	128.0	126.0	127.0	123.0	120.0	120.0	120.0
Total Key personnel	130.0	128.0	126.0	127.0	123.0	120.0	120.0	120.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

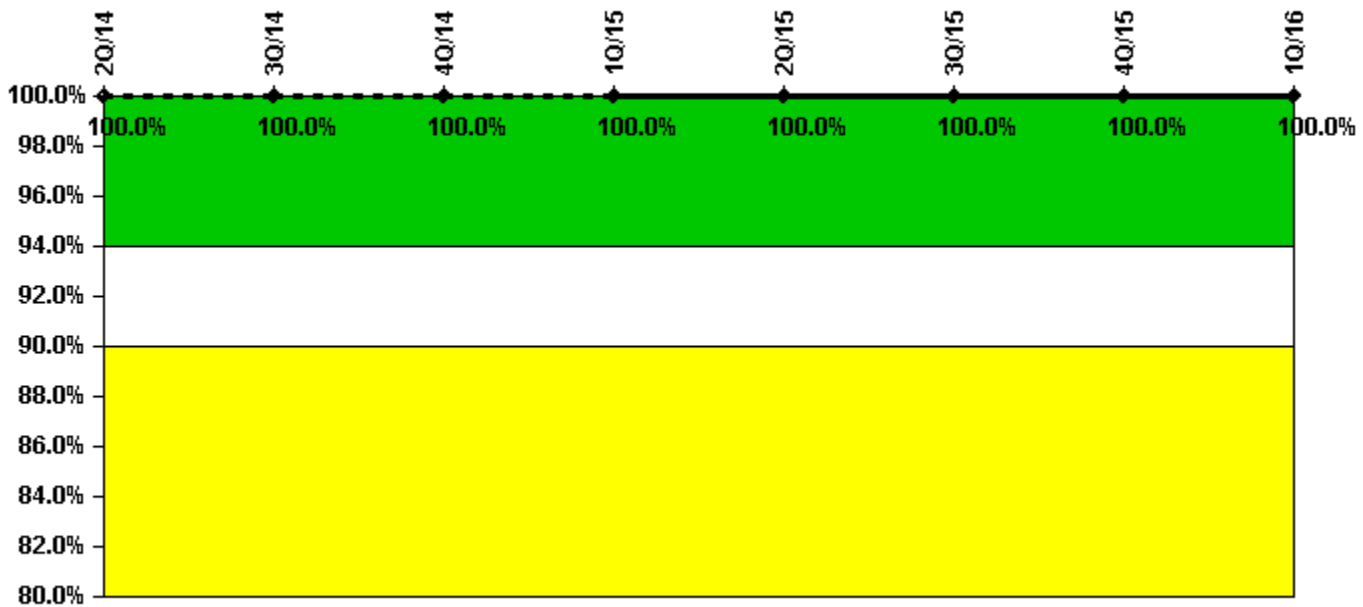


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Successful siren-tests	553	474	553	474	553	528	499	553
Total sirens-tests	553	474	553	474	553	528	499	553
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

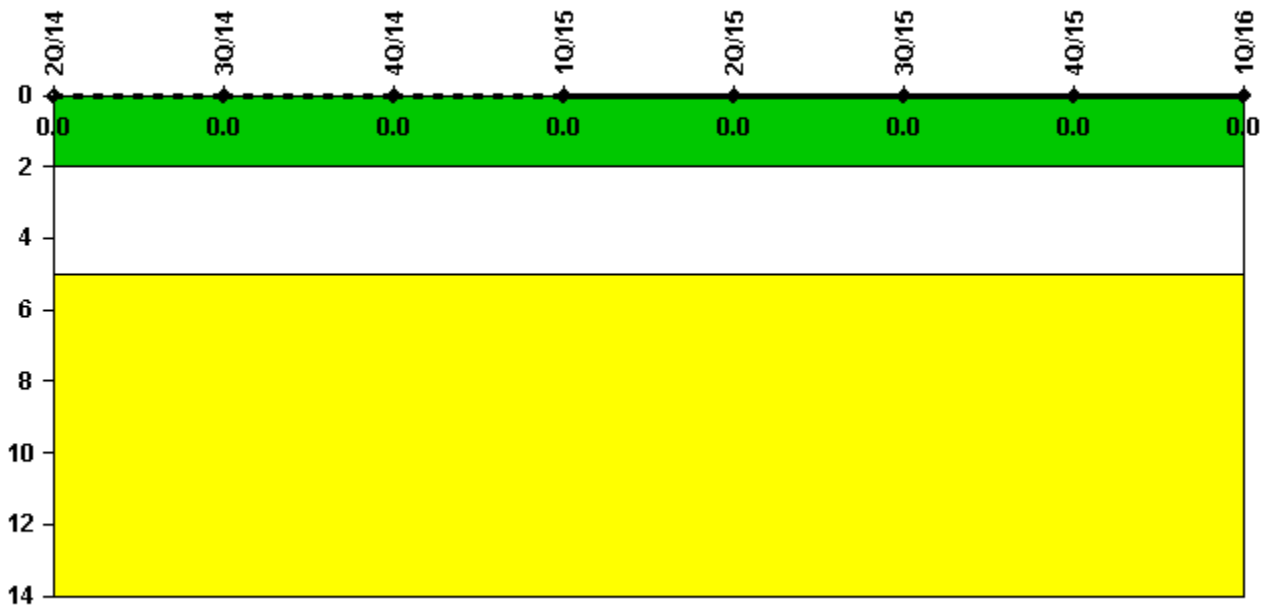


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

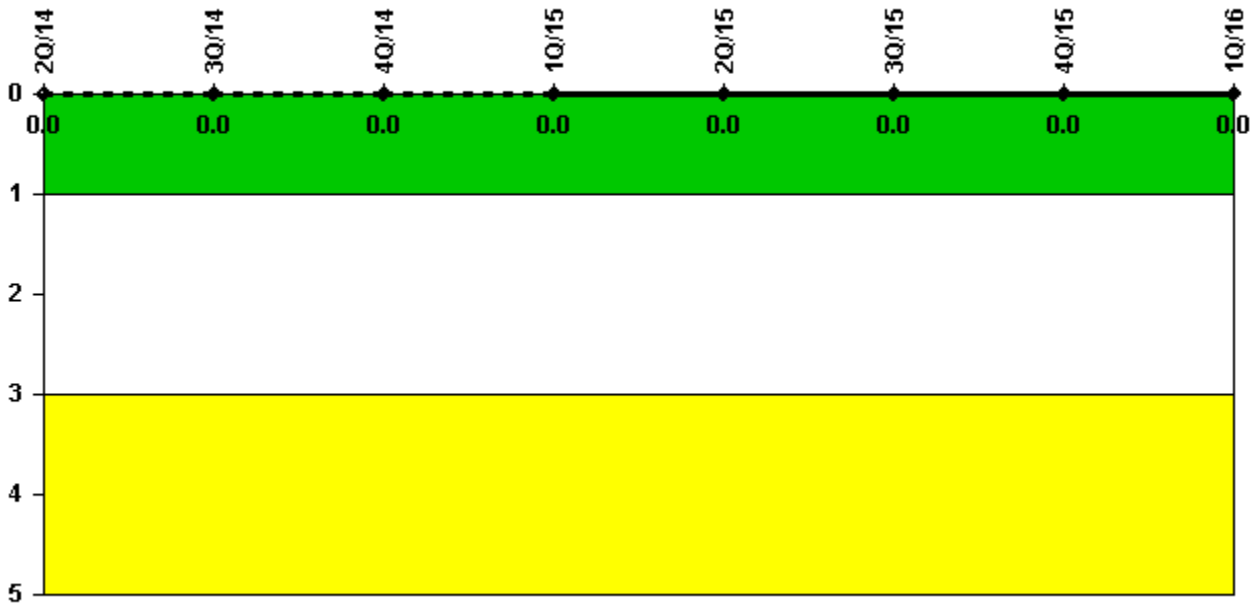

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 23, 2016