


Dresden 3

2Q/2016 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

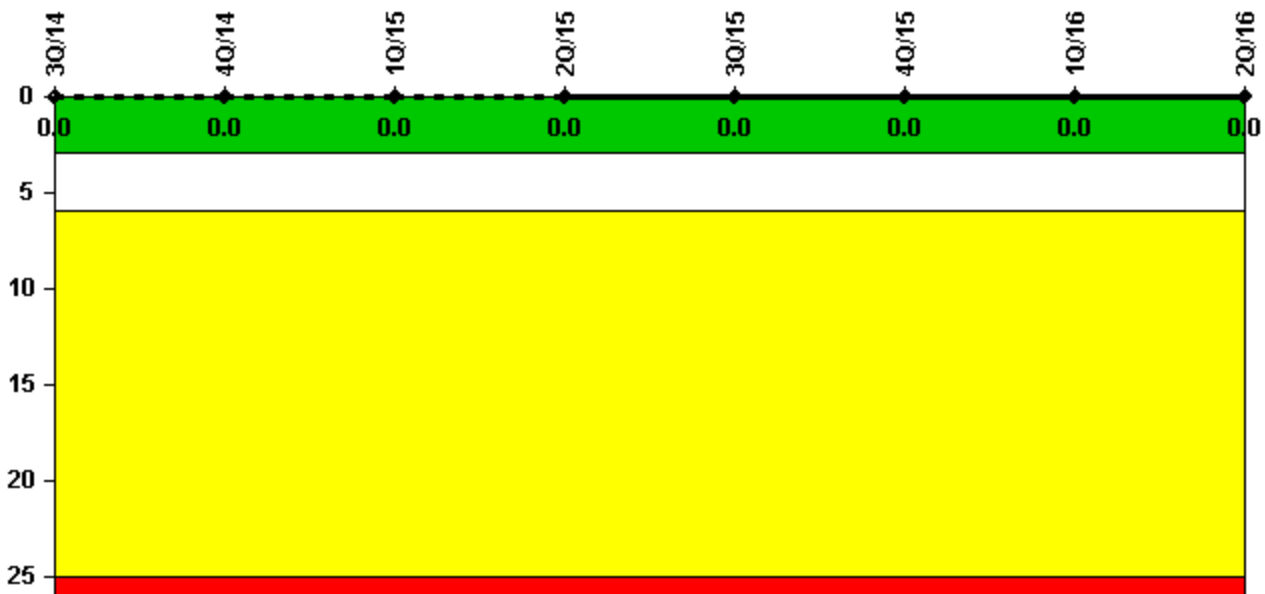


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2208.0	1845.6	2159.0	2184.0	2208.0	2063.8	2183.0	2184.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

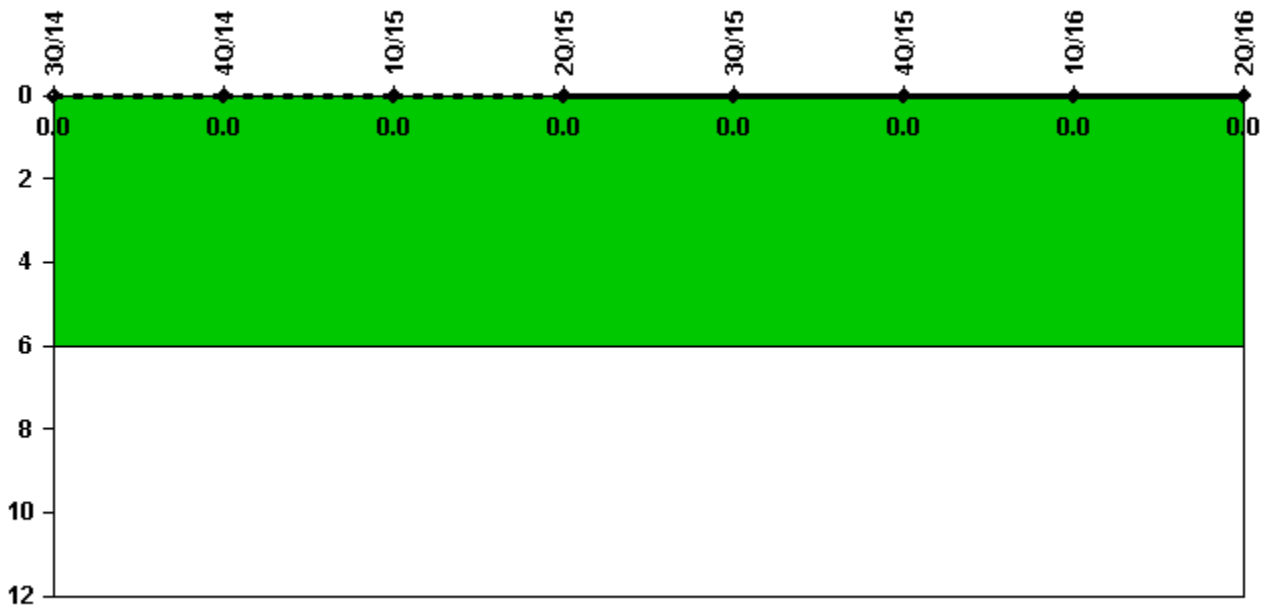


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2208.0	1845.6	2159.0	2184.0	2208.0	2063.8	2183.0	2184.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

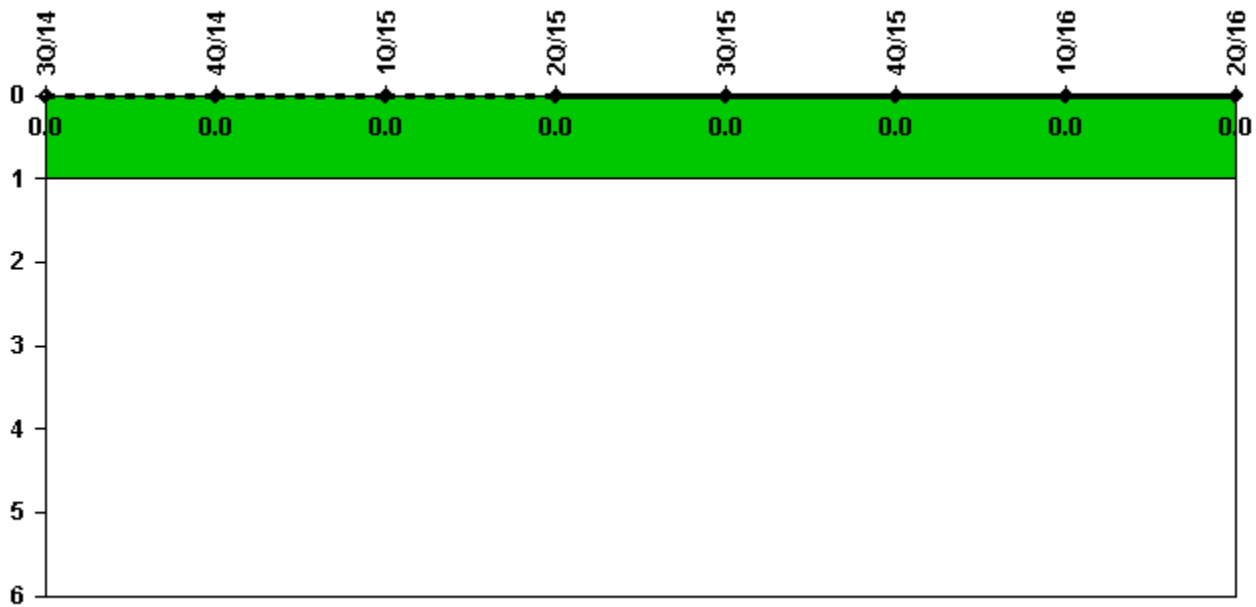


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

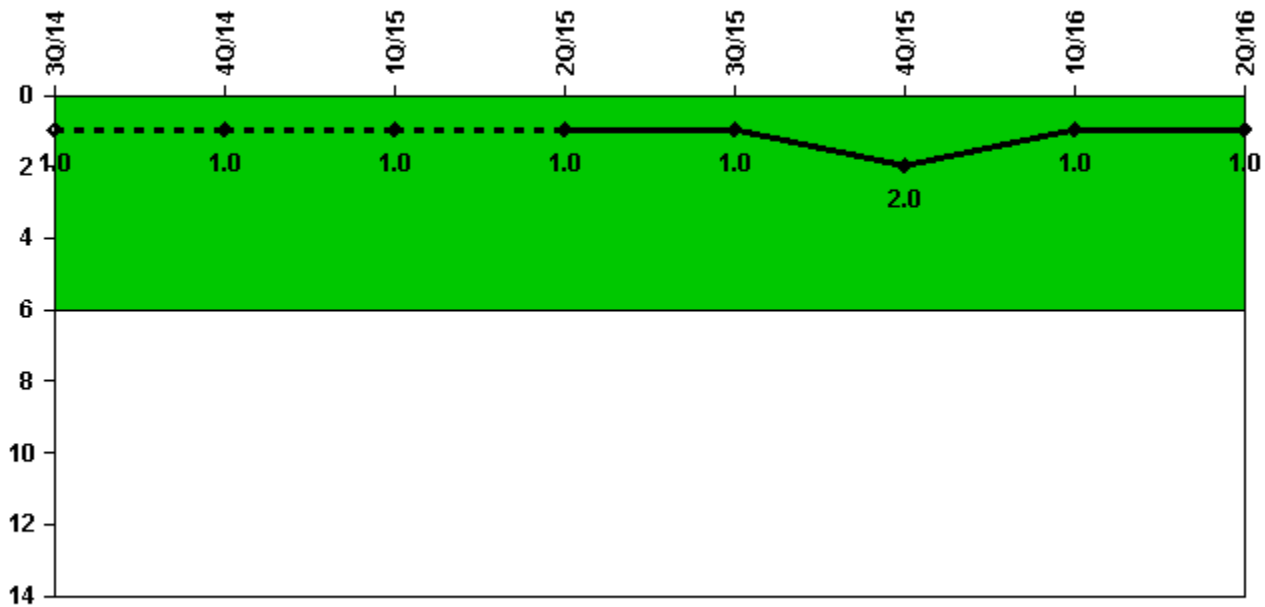

Thresholds: White > 6.0

Notes


Safety System Functional Failures (BWR)	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
Safety System Functional Failures	0	0	1	0	0	1	0	0
Indicator value	1	1	1	1	1	2	1	1

Licensee Comments:

4Q/15: LER 237/2015-003-00 Unit 2 Turbine Building to Reactor Building Interlock Doors Open Simultaneously, dated 10/30/15

1Q/15: LER 249/2014-001-00, Electromatic Relief Valve Failed to Actuate during Surveillance Testing, dated 1/5/2015

Mitigating Systems Performance Index, Emergency AC Power System

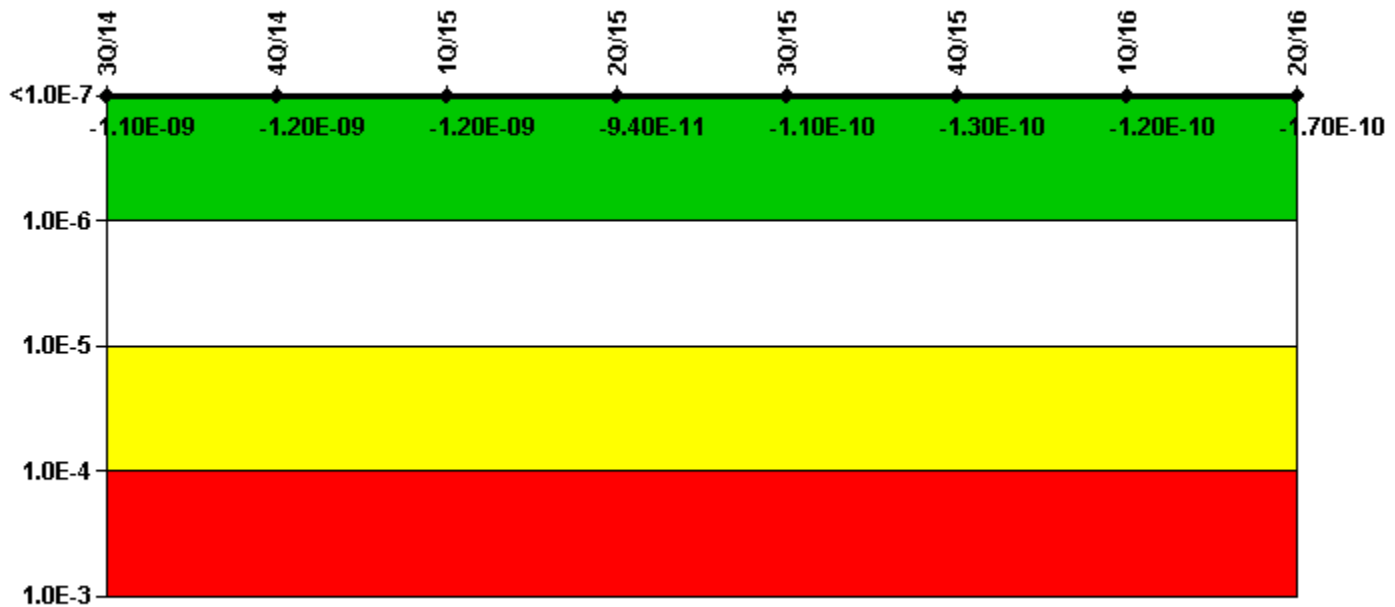

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
UAI (Δ CDF)	-1.05E-10	-1.62E-10	-1.62E-10	1.92E-11	8.60E-13	-3.67E-11	2.69E-11	0.00E+00
URI (Δ CDF)	-1.04E-09	-1.01E-09	-9.98E-10	-1.13E-10	-1.11E-10	-8.95E-11	-1.43E-10	-1.73E-10
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.10E-09	-1.20E-09	-1.20E-09	-9.40E-11	-1.10E-10	-1.30E-10	-1.20E-10	-1.70E-10

Licensee Comments:

2Q/15: An MSPI EDG failure that occurred in May 2015 (Issue Report 2507485) was reported to CDE via ICES 319646 in 2nd quarter 2016. ICES 319646 resulted in the re-calculation of EDG URI values from May 2015 onward.

Mitigating Systems Performance Index, High Pressure Injection System

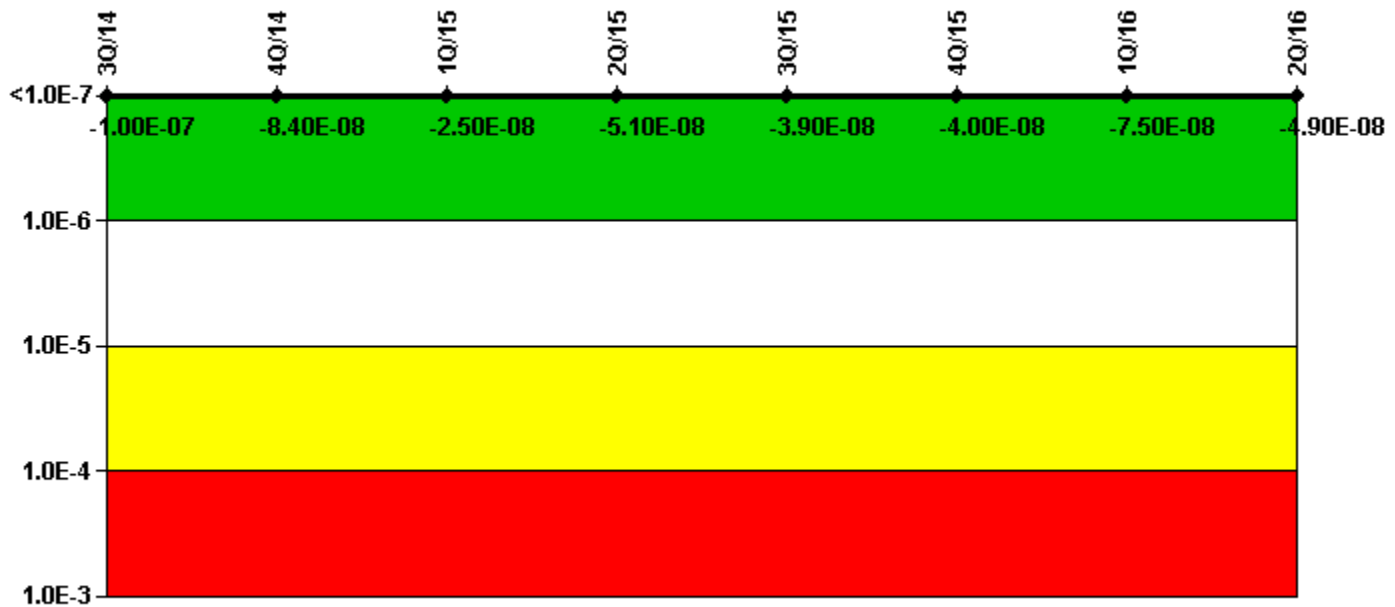


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
UAI (Δ CDF)	-3.79E-08	-1.89E-08	4.05E-08	1.49E-08	2.61E-08	2.54E-08	-9.19E-09	1.68E-08
URI (Δ CDF)	-6.54E-08	-6.54E-08	-6.54E-08	-6.54E-08	-6.54E-08	-6.54E-08	-6.54E-08	-6.55E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.00E-07	-8.40E-08	-2.50E-08	-5.10E-08	-3.90E-08	-4.00E-08	-7.50E-08	-4.90E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

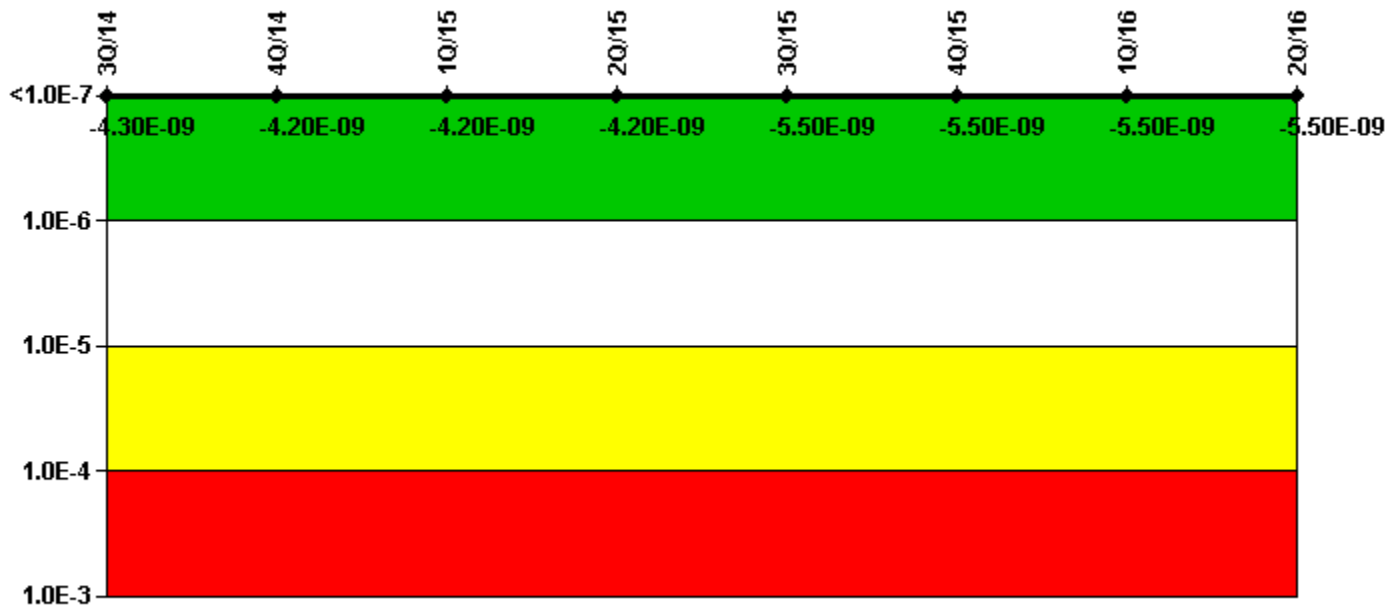


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
UAI (Δ CDF)	-4.17E-09	-4.15E-09	-4.15E-09	-4.15E-09	-5.43E-09	-5.43E-09	-5.43E-09	-5.43E-09
URI (Δ CDF)	-9.23E-11	-9.23E-11	-9.23E-11	-9.23E-11	-9.23E-11	-9.23E-11	-9.23E-11	-9.23E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.30E-09	-4.20E-09	-4.20E-09	-4.20E-09	-5.50E-09	-5.50E-09	-5.50E-09	-5.50E-09

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

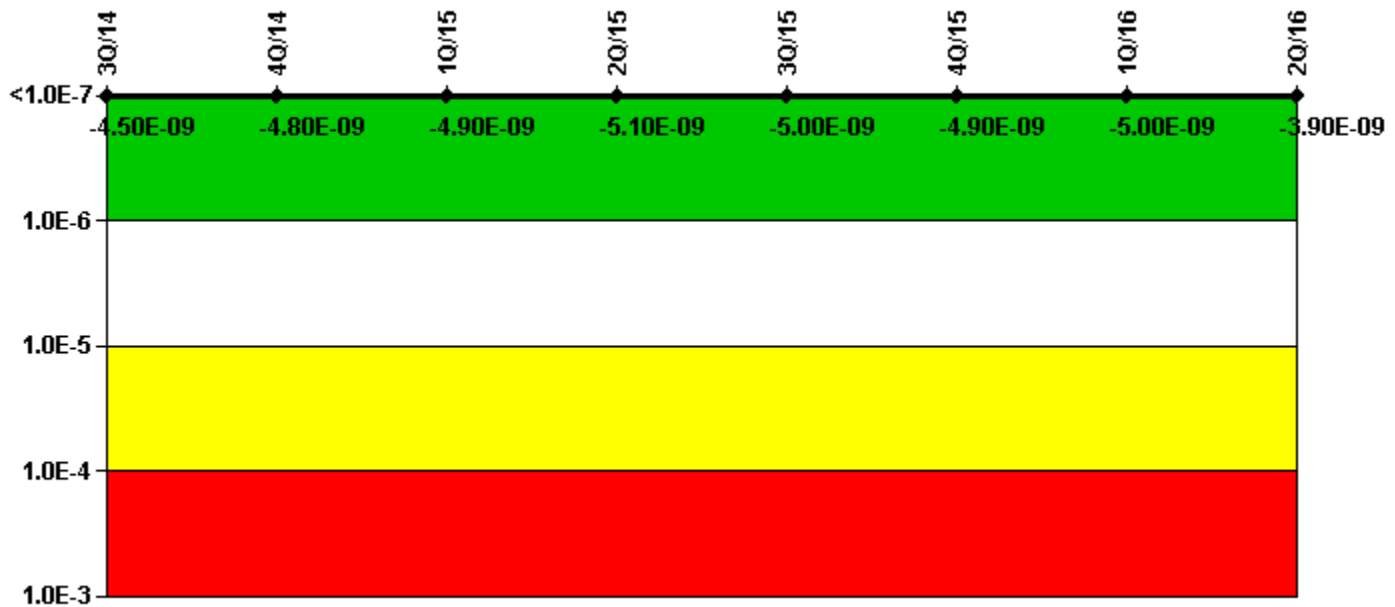


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
UAI (Δ CDF)	-1.10E-09	-1.10E-09	-1.10E-09	-1.25E-09	-9.85E-10	-8.99E-10	-9.02E-10	2.35E-10
URI (Δ CDF)	-3.38E-09	-3.66E-09	-3.76E-09	-3.89E-09	-3.98E-09	-3.99E-09	-4.08E-09	-4.17E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.50E-09	-4.80E-09	-4.90E-09	-5.10E-09	-5.00E-09	-4.90E-09	-5.00E-09	-3.90E-09

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

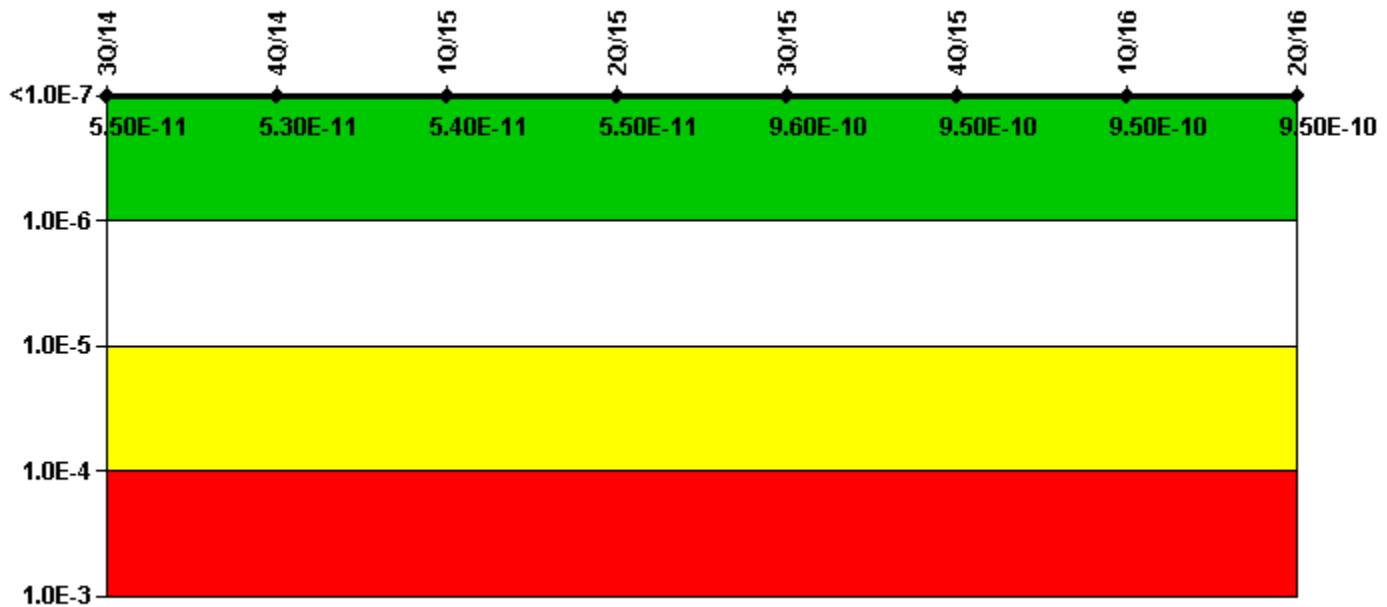


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
UAI (Δ CDF)	0.00E+00	0.00E+00	0.00E+00	0.00E+00	9.00E-10	8.86E-10	8.86E-10	8.86E-10
URI (Δ CDF)	5.48E-11	5.33E-11	5.36E-11	5.55E-11	5.54E-11	6.03E-11	6.06E-11	6.06E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	5.50E-11	5.30E-11	5.40E-11	5.50E-11	9.60E-10	9.50E-10	9.50E-10	9.50E-10

Licensee Comments: none

Reactor Coolant System Activity

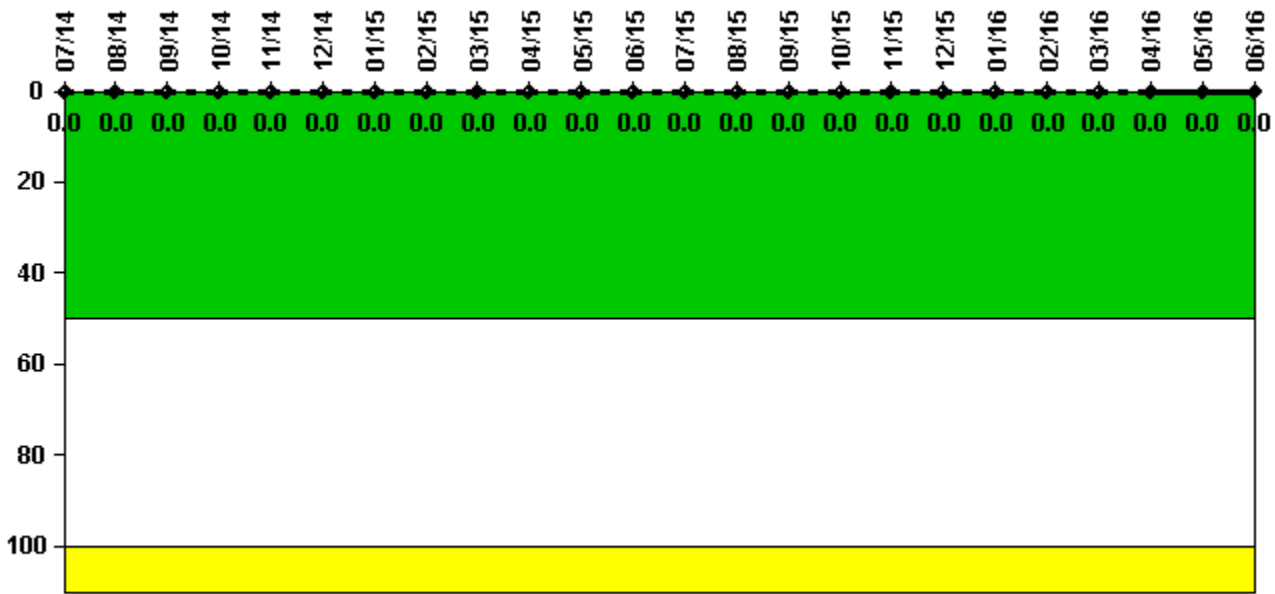

Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15
Maximum activity	0.000017	0.000014	0.000017	0.000019	0.000004	0.000004	0.000009	0.000007	0.000005	0.000009	0.000017	0.000010
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	7/15	8/15	9/15	10/15	11/15	12/15	1/16	2/16	3/16	4/16	5/16	6/16
Maximum activity	0.000012	0.000013	0.000013	0.000004	0.000006	0.000023	0.000008	0.000007	0.000016	0.000017	0.000023	0.000022
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage



Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	7/14	8/14	9/14	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15
Maximum leakage	1.585	1.550	1.560	1.567	1.557	1.602	1.610	1.548	1.547	1.550	1.560	1.563
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.3	6.2	6.2	6.3	6.2	6.4	6.4	6.2	6.2	6.2	6.2	6.3

Reactor Coolant System Leakage	7/15	8/15	9/15	10/15	11/15	12/15	1/16	2/16	3/16	4/16	5/16	6/16
Maximum leakage	1.558	1.560	1.547	1.552	1.557	1.545	1.552	1.547	1.558	1.560	1.572	1.558
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.2	6.2	6.2	6.2	6.2	6.2	6.2	6.2	6.2	6.2	6.3	6.2

Licensee Comments: none

Drill/Exercise Performance

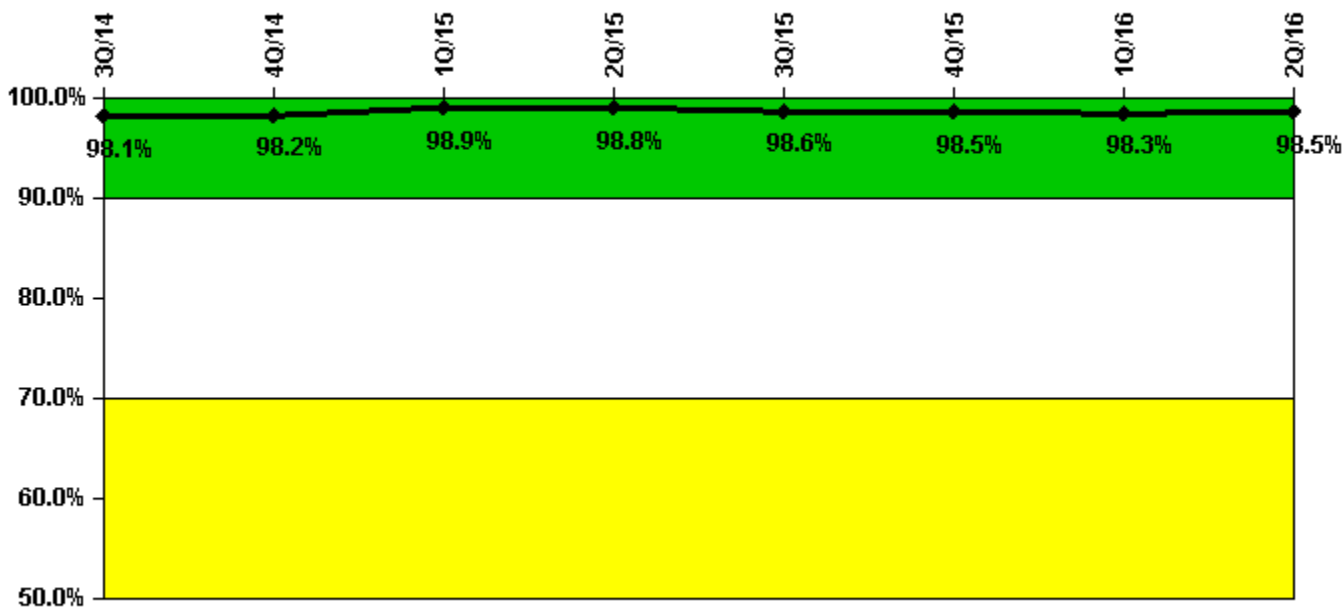


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
Successful opportunities	61.0	40.0	47.0	65.0	44.0	27.0	31.0	80.0
Total opportunities	63.0	40.0	47.0	67.0	45.0	27.0	32.0	80.0
Indicator value	98.1%	98.2%	98.9%	98.8%	98.6%	98.5%	98.3%	98.5%

Licensee Comments: none

ERO Drill Participation

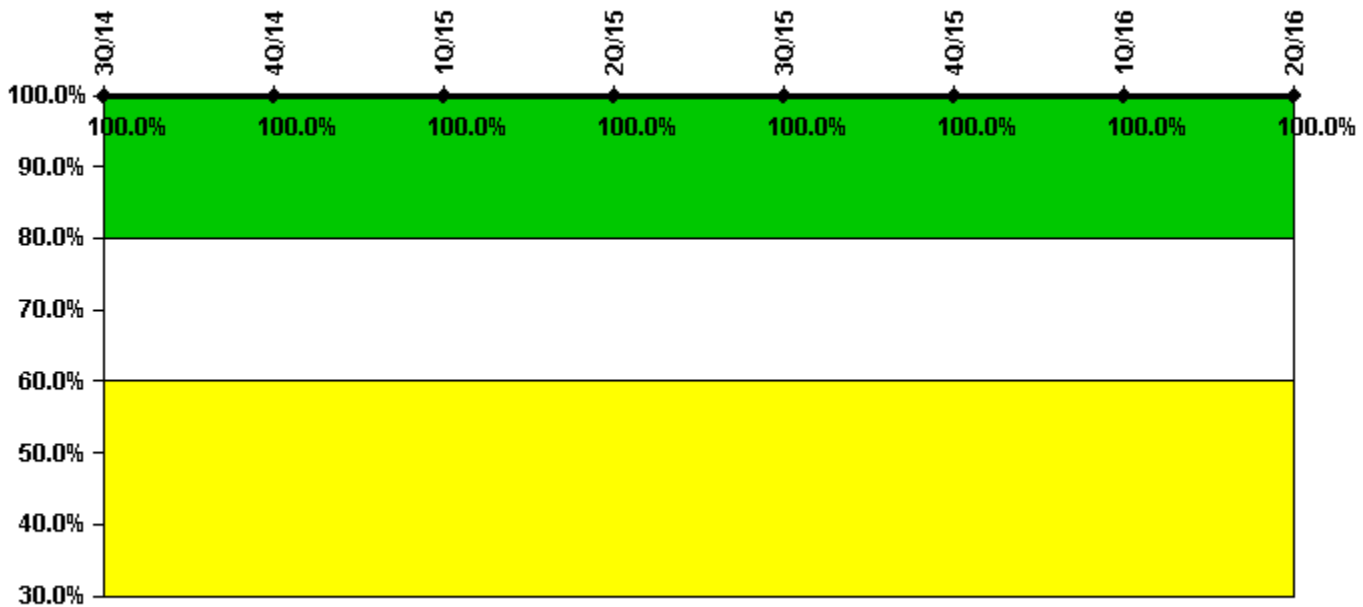


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
Participating Key personnel	78.0	78.0	72.0	75.0	72.0	77.0	70.0	64.0
Total Key personnel	78.0	78.0	72.0	75.0	72.0	77.0	70.0	64.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

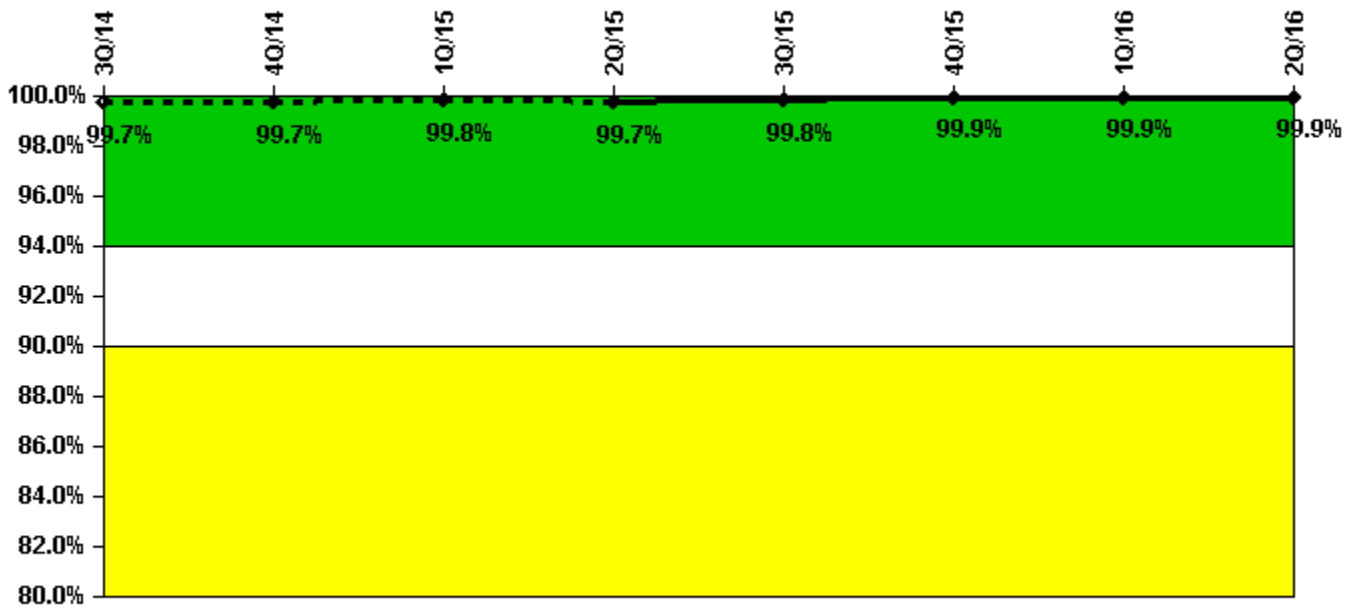


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
Successful siren-tests	2928	2940	2895	2937	2985	2943	2942	2942
Total sirens-tests	2944	2944	2898	2944	2990	2944	2944	2944
Indicator value	99.7%	99.7%	99.8%	99.7%	99.8%	99.9%	99.9%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness

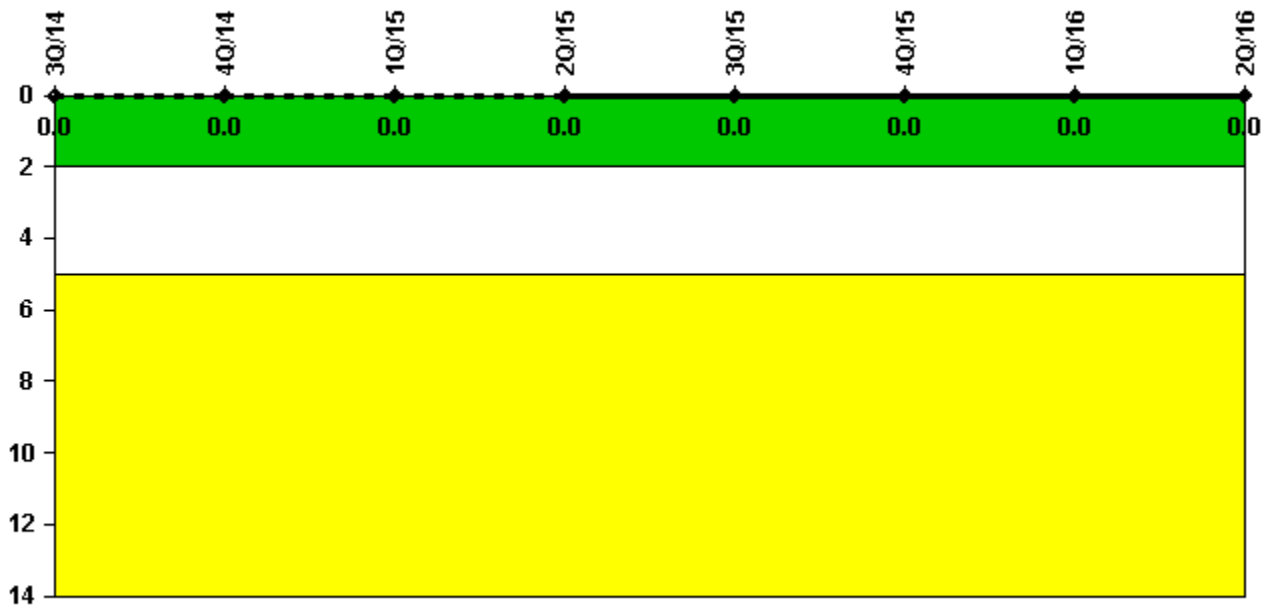

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: July 25, 2016