


Millstone 3

3Q/2016 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

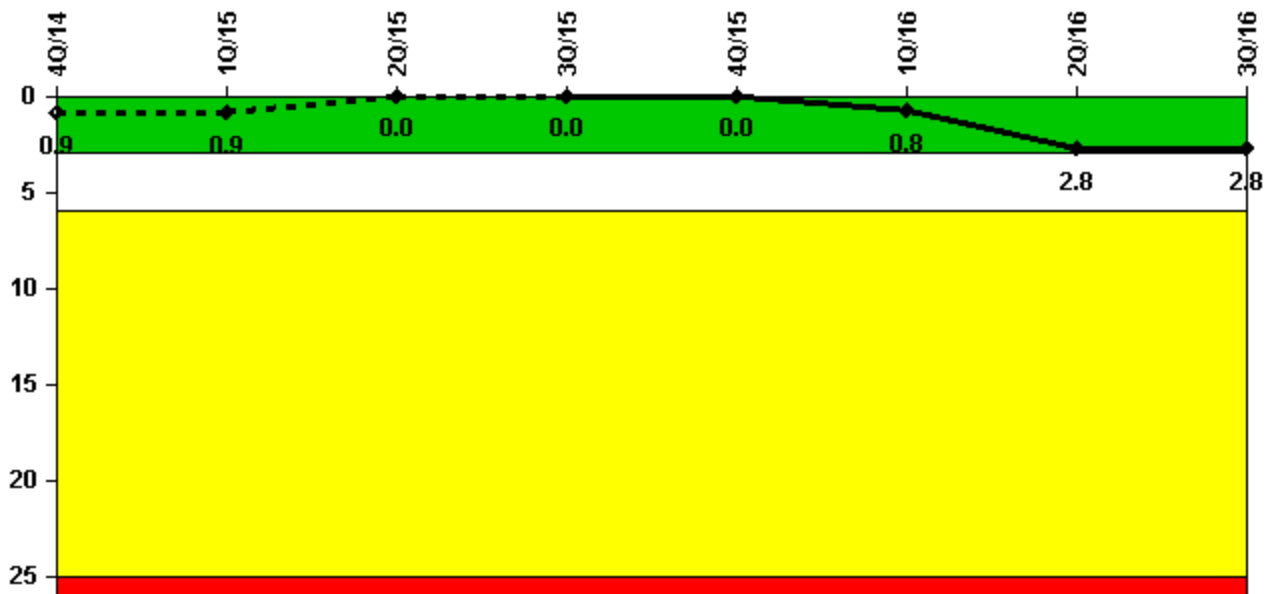


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
Unplanned scrams	0	0	0	0	0	1.0	2.0	0
Critical hours	1363.8	2159.0	2184.0	2208.0	2209.0	2097.9	1103.8	2208.0
Indicator value	0.9	0.9	0	0	0	0.8	2.8	2.8

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

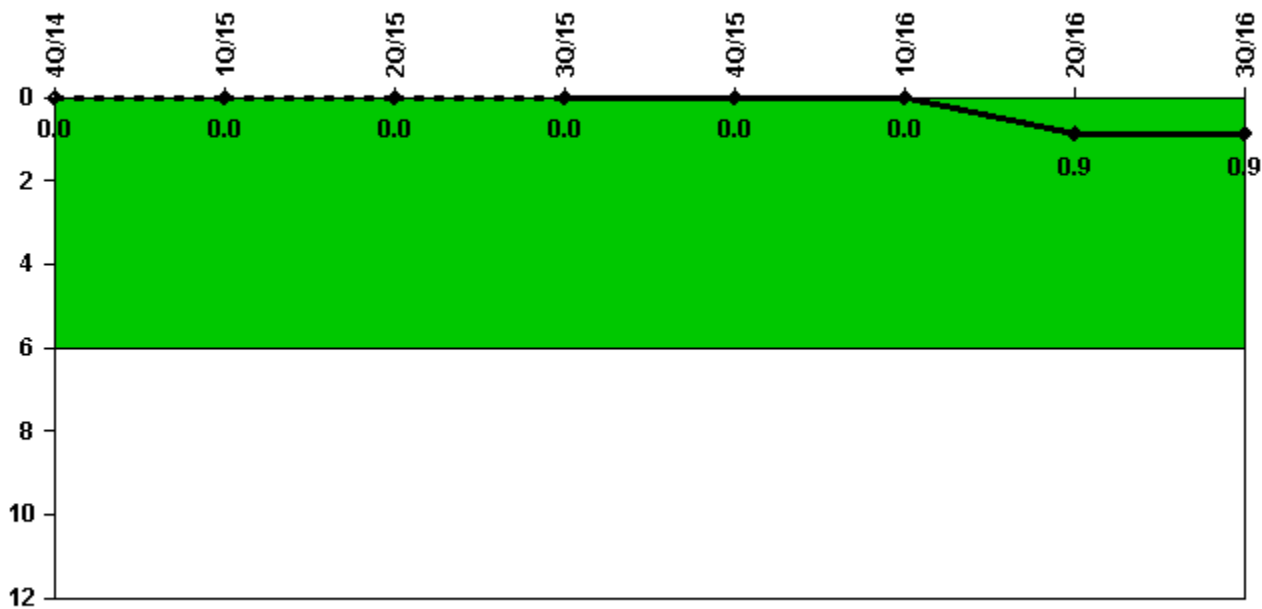


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
Unplanned power changes	0	0	0	0	0	0	1.0	0
Critical hours	1363.8	2159.0	2184.0	2208.0	2209.0	2097.9	1103.8	2208.0
Indicator value	0	0	0	0	0	0	0.9	0.9

Licensee Comments: none

Unplanned Scrams with Complications

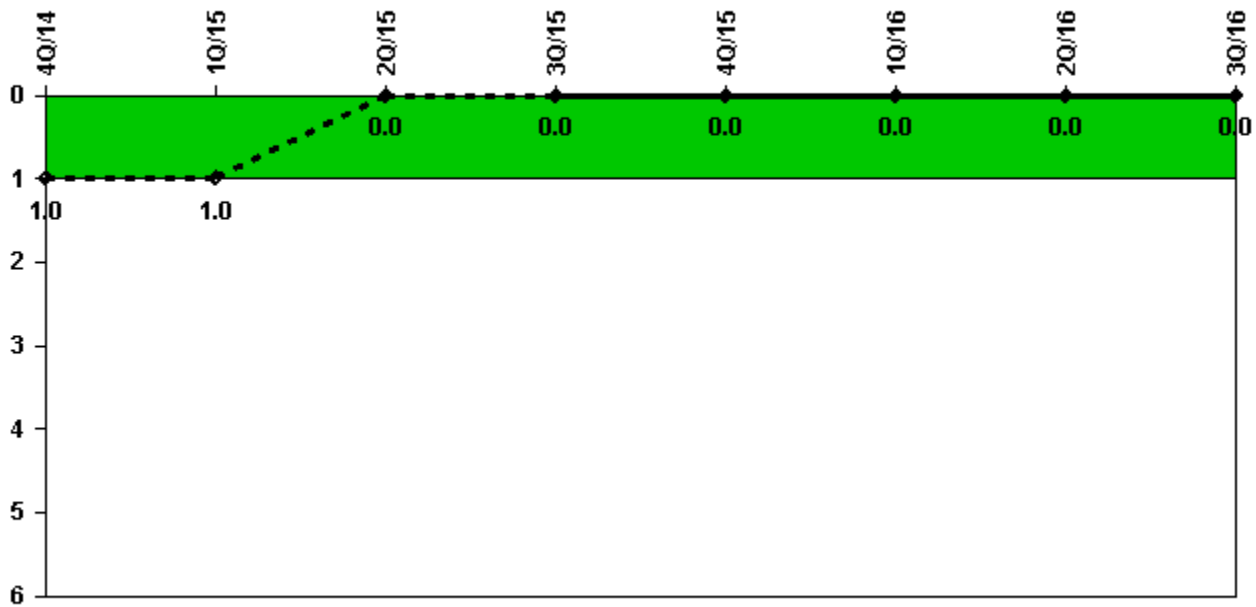


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

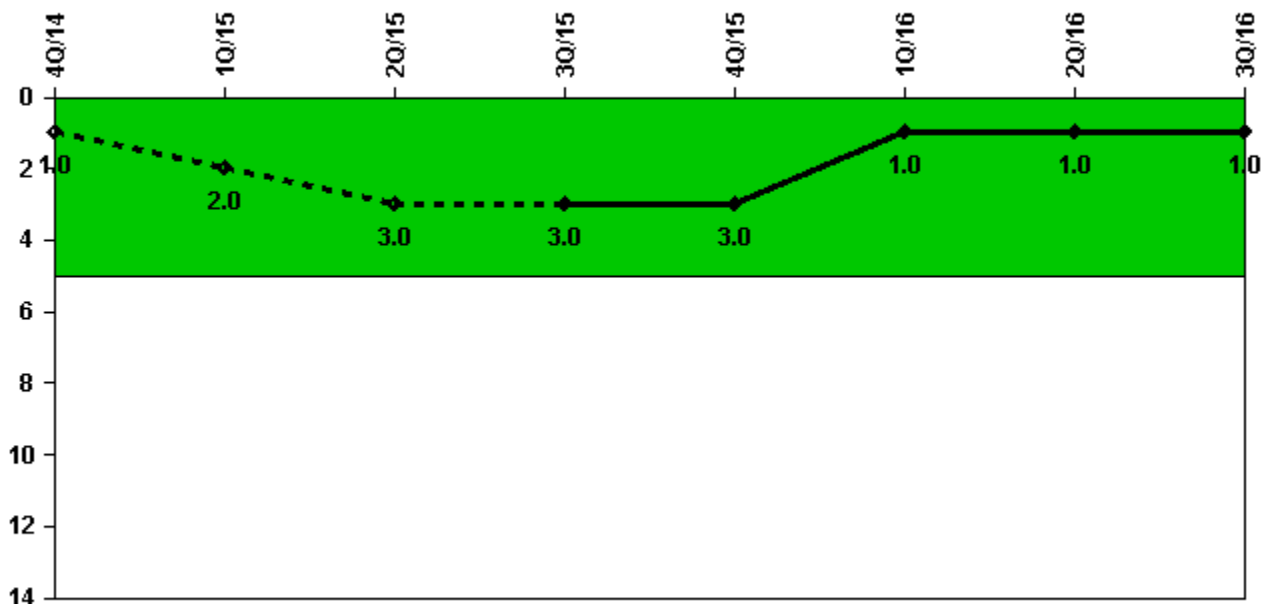

Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
Safety System Functional Failures	0	2	1	0	0	0	1	0
Indicator value	1	2	3	3	3	1	1	1


Licensee Comments:

2Q/16: LER 216-003-00, Loss of Safety Function - Supplementary Leak Collection and Release System

2Q/15: LER 2015-001-00, Unlatched Dual Train HELB Door Results in Potential Loss of Safety Function

1Q/15: LER 2014-004-00, Unlatched Dual Train HELB Door Results in Potential Loss of Safety Function.

Mitigating Systems Performance Index, Emergency AC Power System

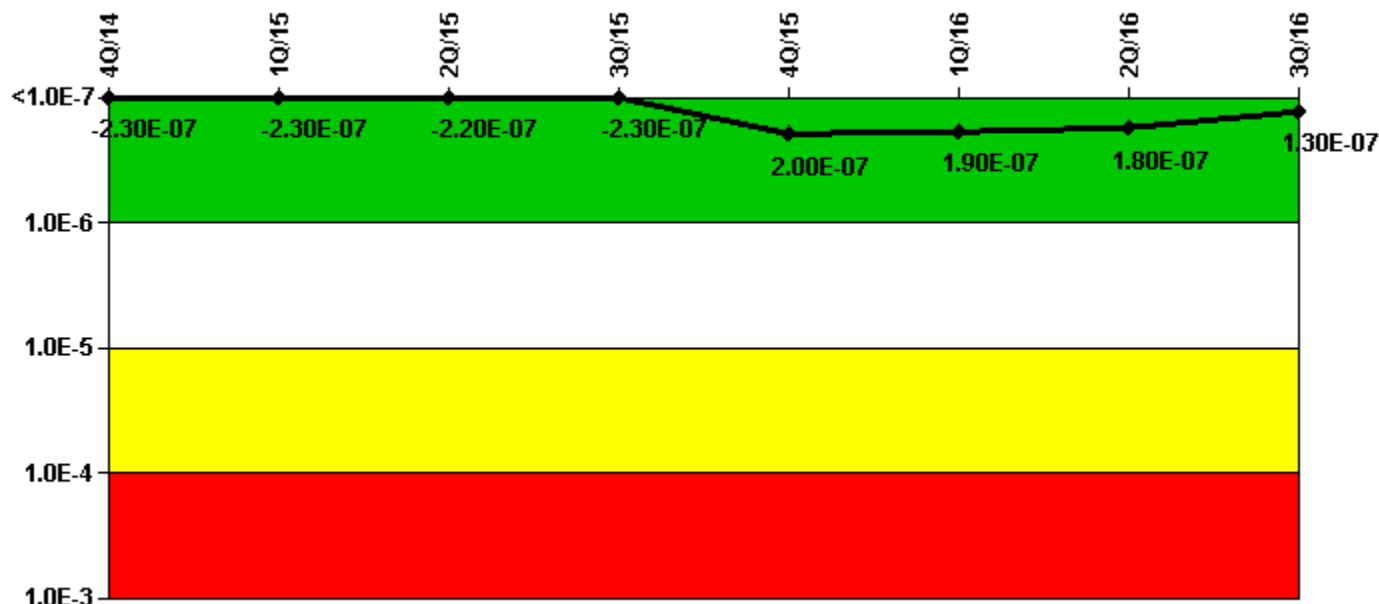

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Emergency AC Power System	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
UAI (ΔCDF)	-3.06E-08	-3.06E-08	-3.06E-08	-3.06E-08	4.82E-08	4.84E-08	4.93E-08	4.19E-08
URI (ΔCDF)	-2.03E-07	-2.00E-07	-1.91E-07	-1.95E-07	1.48E-07	1.46E-07	1.33E-07	8.55E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.30E-07	-2.30E-07	-2.20E-07	-2.30E-07	2.00E-07	1.90E-07	1.80E-07	1.30E-07

Licensee Comments:

3Q/16: Changed PRA Parameter(s). A modification was completed in May 2016 which implemented low leakage Reactor Coolant Pump seals. A supplemental PRA evaluation determined that this plant modification resulted in a factor of three change in the corrected Birnbaum value of monitored MSPI components. The MSPI Basis document Revision 6 was approved 9/29/16 which includes the recalculated PRA values. A supplemental evaluation is being used until the PRA model of record is updated. The revised values were incorporated into CDE effective the third quarter 2016. The MSPI Basis document also included a decrease to the diesel baseline unavailability based on changes to maintenance strategies. These revised values were incorporated into CDE effective the fourth quarter 2016.

4Q/14: Basis document updated in 4th quarter to update PRA values. No change to calculated MSPI.

Mitigating Systems Performance Index, High Pressure Injection System

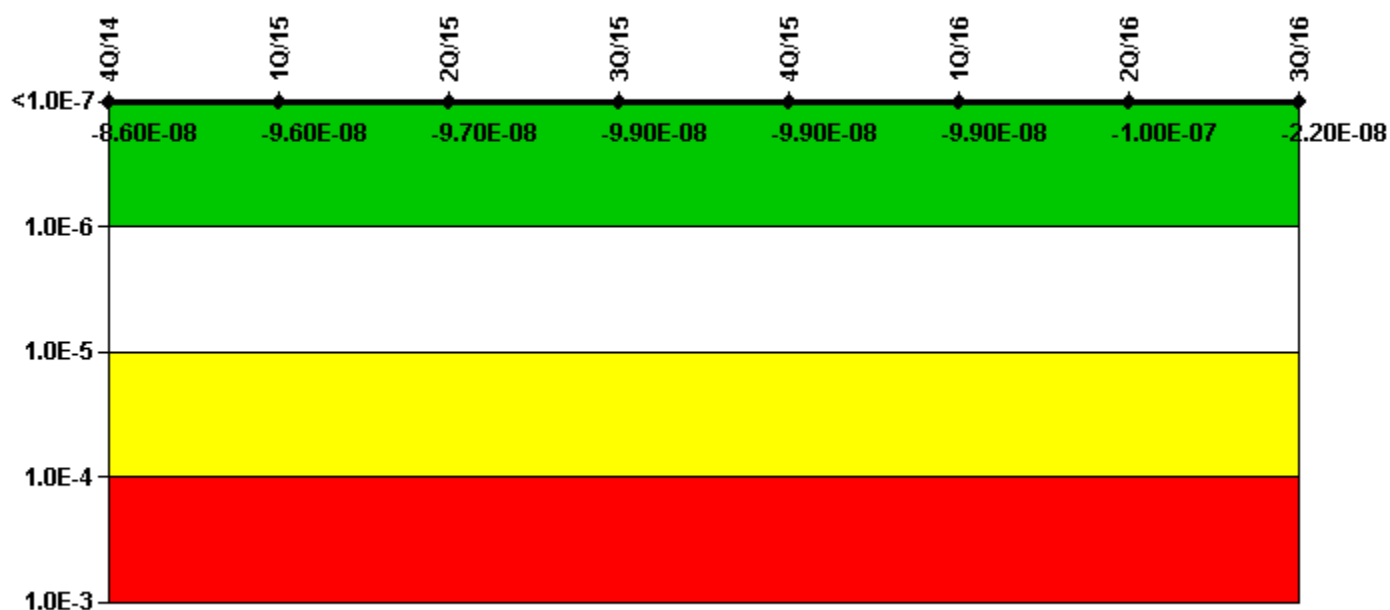

Thresholds: White $> 1.00E-6$ Yellow $> 1.00E-5$ Red $> 1.00E-4$

Notes


Mitigating Systems Performance Index, High Pressure Injection System	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
UAI (Δ CDF)	1.87E-08	1.35E-08	1.28E-08	1.11E-08	1.07E-08	1.14E-08	9.86E-09	-3.03E-12
URI (Δ CDF)	-1.04E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-2.20E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.60E-08	-9.60E-08	-9.70E-08	-9.90E-08	-9.90E-08	-9.90E-08	-1.00E-07	-2.20E-08

Licensee Comments:

3Q/16: Changed PRA Parameter(s). A modification was completed in May 2016 which implemented low leakage Reactor Coolant Pump seals. A supplemental PRA evaluation determined that this plant modification resulted in a factor of three change in the corrected Birnbaum value of monitored MSPI components. The MSPI Basis document Revision 6 was approved 9/29/16 which includes the recalculated PRA values. A supplemental evaluation is being used until the PRA model of record is updated. The revised values were incorporated into CDE effective the third quarter 2016.

4Q/14: Basis document updated in 4th quarter to update PRA values. No change to calculated MSPI.

Mitigating Systems Performance Index, Heat Removal System

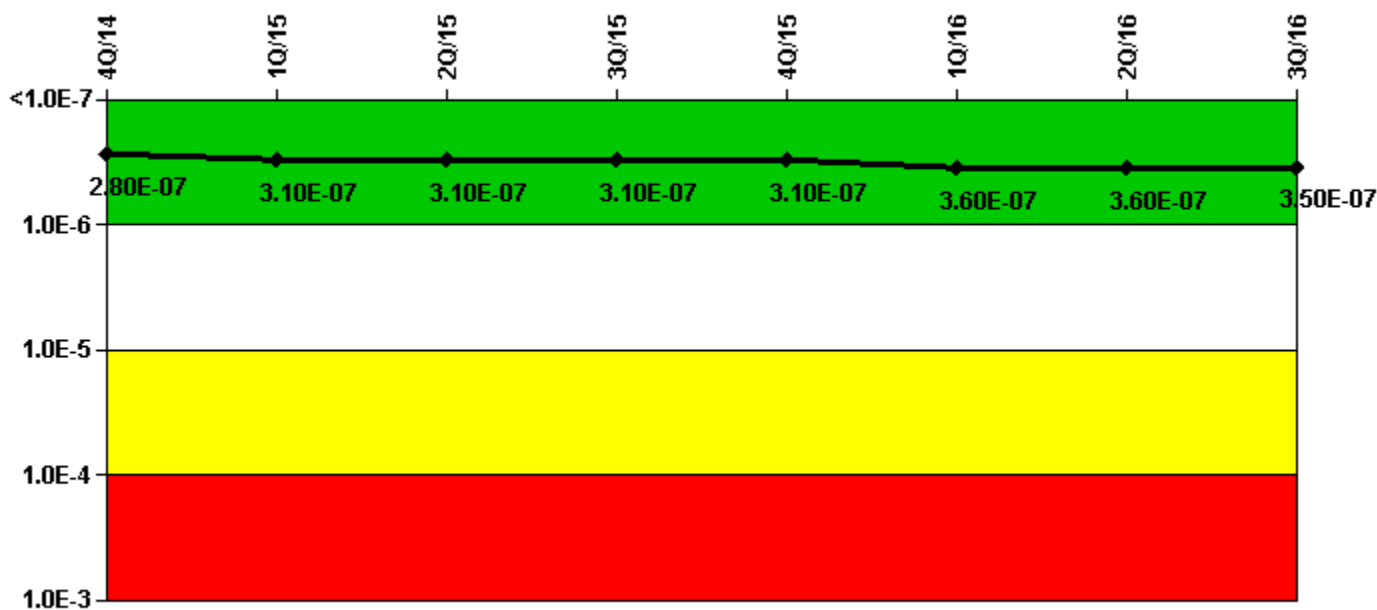

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Heat Removal System	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
UAI (ΔCDF)	7.83E-08	7.34E-08	7.41E-08	7.44E-08	7.42E-08	8.26E-08	8.40E-08	7.34E-08
URI (ΔCDF)	2.03E-07	2.37E-07	2.37E-07	2.34E-07	2.34E-07	2.78E-07	2.75E-07	2.73E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.80E-07	3.10E-07	3.10E-07	3.10E-07	3.10E-07	3.60E-07	3.60E-07	3.50E-07

Licensee Comments:

3Q/16: Changed PRA Parameter(s). A modification was completed in May 2016 which implemented low leakage Reactor Coolant Pump seals. A supplemental PRA evaluation determined that this plant modification resulted in a factor of three change in the corrected Birnbaum value of monitored MSPI components. The MSPI Basis document Revision 6 was approved 9/29/16 which includes the recalculated PRA values. A supplemental evaluation is being used until the PRA model of record is updated. The revised values were incorporated into CDE effective the third quarter 2016.

4Q/14: Basis document updated in 4th quarter to update PRA values. No change to calculated MSPI. The open issue for the turbine driven auxiliary feedwater pump identified in July 2014 was determined to be a failure.

Mitigating Systems Performance Index, Residual Heat Removal System

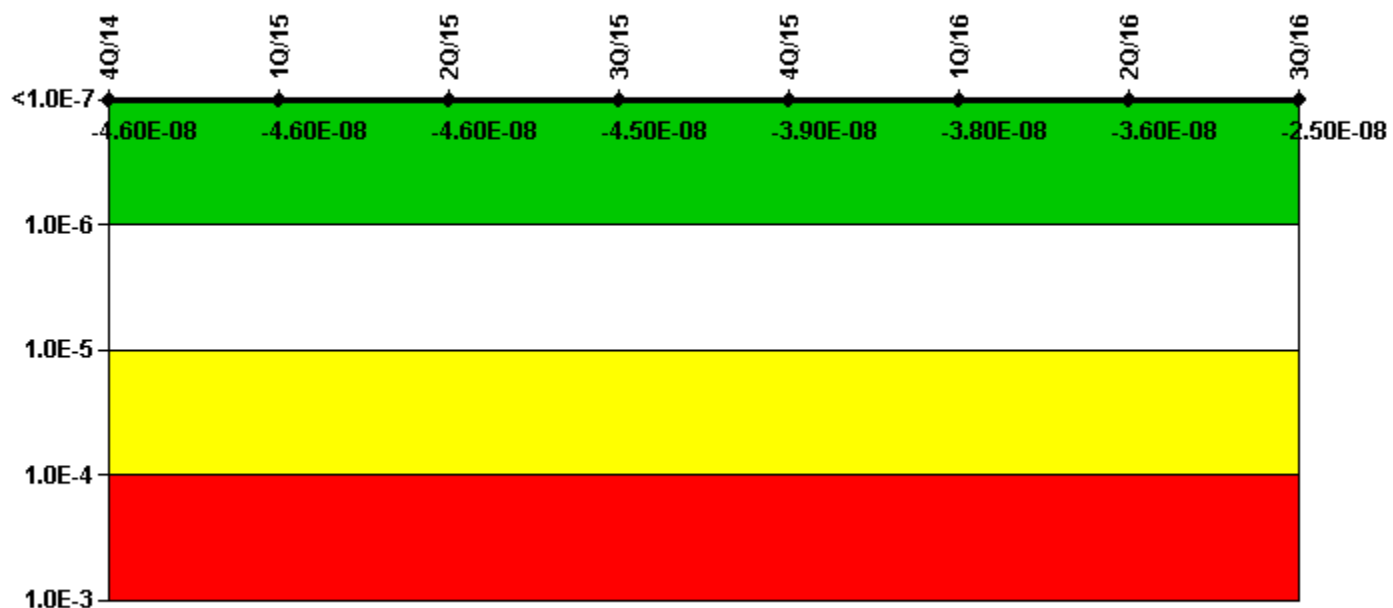

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
UAI (Δ CDF)	-1.13E-08	-1.30E-08	-1.30E-08	-1.30E-08	-6.71E-09	-6.64E-09	-6.32E-09	-5.31E-09
URI (Δ CDF)	-3.45E-08	-3.29E-08	-3.31E-08	-3.20E-08	-3.24E-08	-3.16E-08	-3.00E-08	-1.99E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.60E-08	-4.60E-08	-4.60E-08	-4.50E-08	-3.90E-08	-3.80E-08	-3.60E-08	-2.50E-08

Licensee Comments:

3Q/16: Changed PRA Parameter(s). A modification was completed in May 2016 which implemented low leakage Reactor Coolant Pump seals. A supplemental PRA evaluation determined that this plant modification resulted in a factor of three change in the corrected Birnbaum value of monitored MSPI components. The MSPI Basis document Revision 6 was approved 9/29/16 which includes the recalculated PRA values. A supplemental evaluation is being used until the PRA model of record is updated. The revised values were incorporated into CDE effective the third quarter 2016.

Mitigating Systems Performance Index, Cooling Water Systems

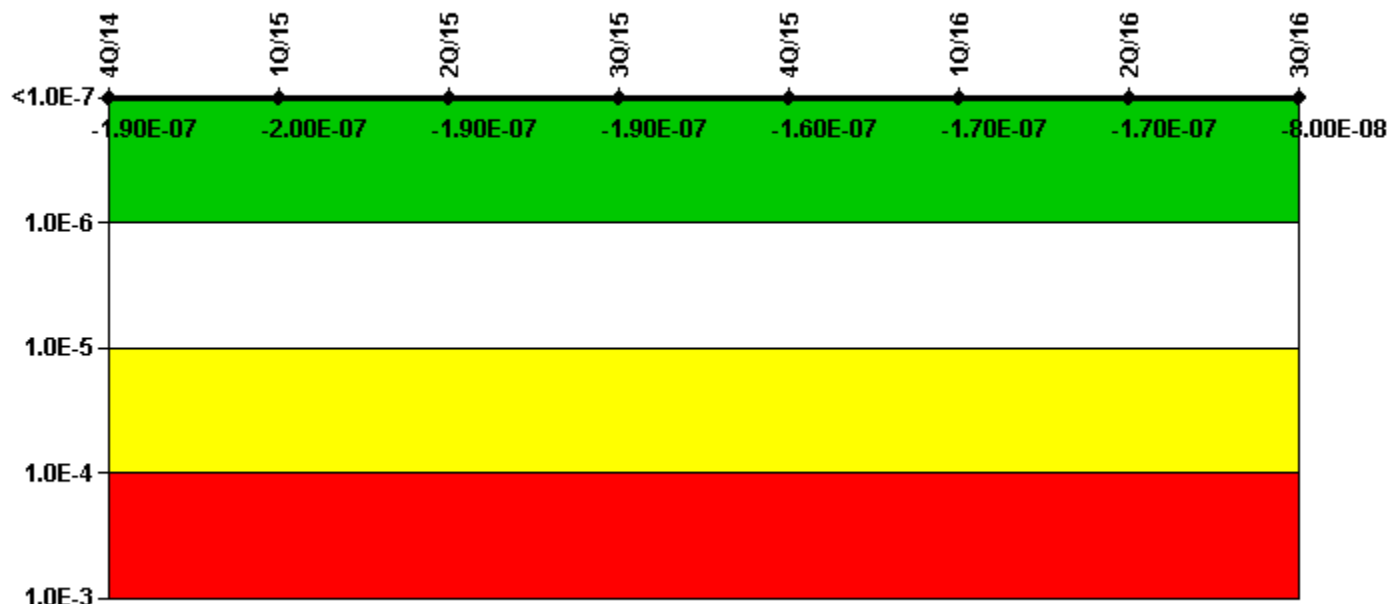

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
UAI (Δ CDF)	-1.64E-07	-1.65E-07	-1.64E-07	-1.64E-07	-1.30E-07	-1.45E-07	-1.43E-07	-4.35E-08
URI (Δ CDF)	-3.01E-08	-3.01E-08	-3.01E-08	-3.01E-08	-3.01E-08	-3.01E-08	-3.01E-08	-3.61E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.90E-07	-2.00E-07	-1.90E-07	-1.90E-07	-1.60E-07	-1.70E-07	-1.70E-07	-8.00E-08

Licensee Comments:

3Q/16: Changed PRA Parameter(s). A modification was completed in May 2016 which implemented low leakage Reactor Coolant Pump seals. A supplemental PRA evaluation determined that this plant modification resulted in a factor of three change in the corrected Birnbaum value of monitored MSPI components. The MSPI Basis document Revision 6 was approved 9/29/16 which includes the recalculated PRA values. A supplemental evaluation is being used until the PRA model of record is updated. The revised values were incorporated into CDE effective the third quarter 2016.

Reactor Coolant System Activity

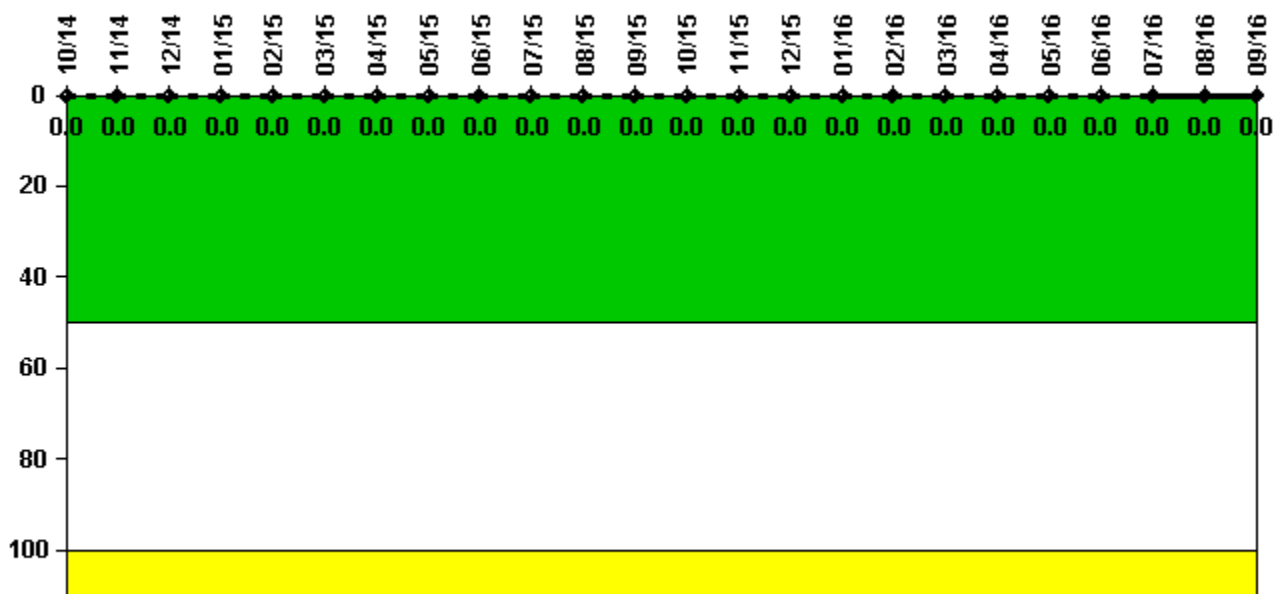


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15	7/15	8/15	9/15
Maximum activity	0.000176	0.000041	0.000084	0.000104	0.000084	0.000077	0.000100	0.000090	0.000089	0.000103	0.000089	0.000105
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	10/15	11/15	12/15	1/16	2/16	3/16	4/16	5/16	6/16	7/16	8/16	9/16
Maximum activity	0.000123	0.000112	0.000113	0.000124	0.000128	0.000134	0.000223	0.000034	0.000039	0.000070	0.000042	0.000044
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

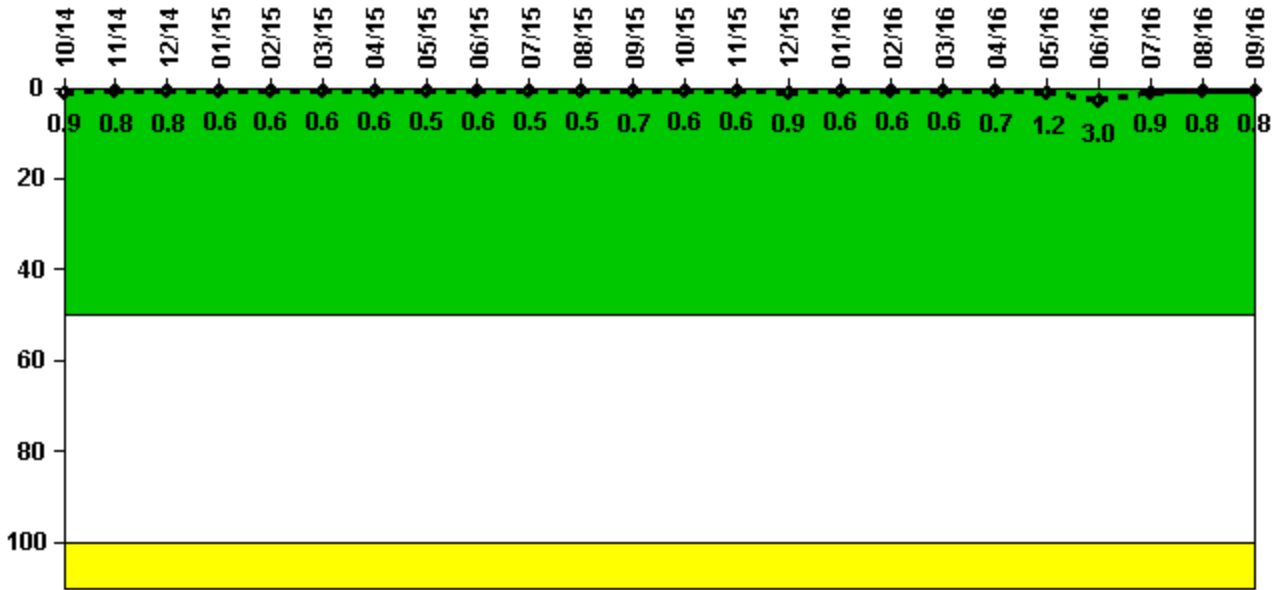


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15	7/15	8/15	9/15
Maximum leakage	0.085	0.076	0.078	0.061	0.063	0.055	0.055	0.054	0.057	0.052	0.050	0.067
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.9	0.8	0.8	0.6	0.6	0.6	0.6	0.5	0.6	0.5	0.5	0.7
Reactor Coolant System Leakage	10/15	11/15	12/15	1/16	2/16	3/16	4/16	5/16	6/16	7/16	8/16	9/16
Maximum leakage	0.058	0.059	0.087	0.059	0.058	0.059	0.071	0.120	0.297	0.092	0.080	0.084
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.6	0.6	0.9	0.6	0.6	0.6	0.7	1.2	3.0	0.9	0.8	0.8

Licensee Comments: none

Drill/Exercise Performance

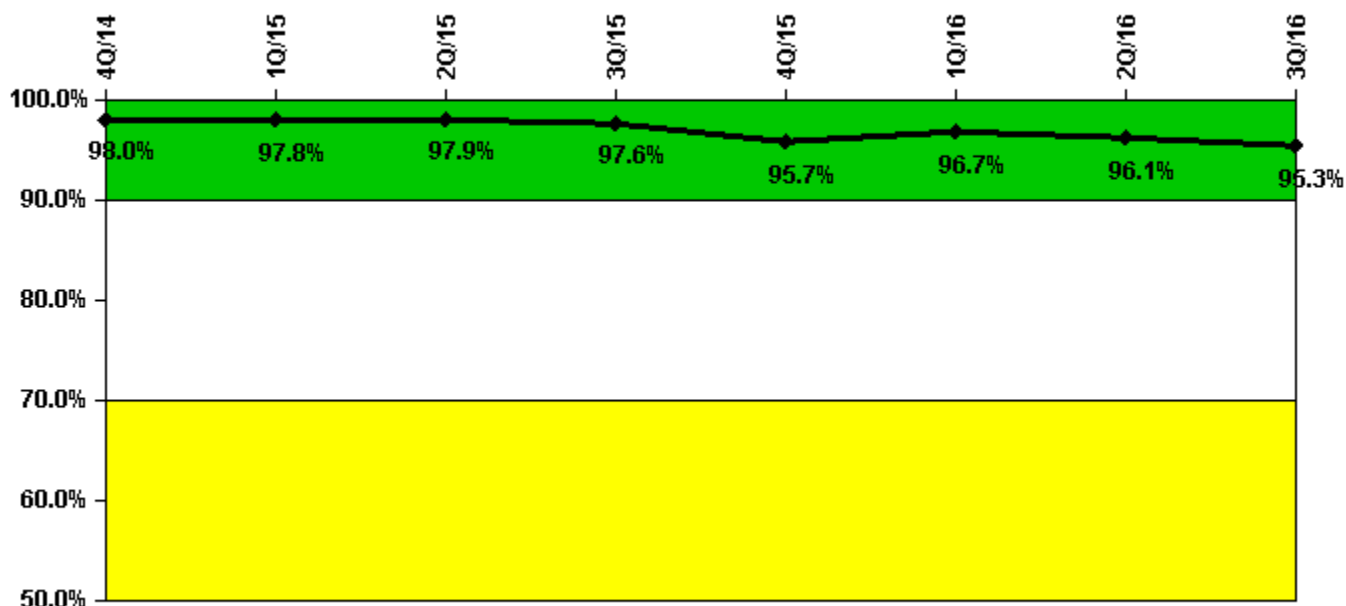


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
Successful opportunities	6.0	23.0	36.0	30.0	24.0	36.0	16.0	31.0
Total opportunities	6.0	23.0	36.0	32.0	28.0	37.0	17.0	33.0
Indicator value	98.0%	97.8%	97.9%	97.6%	95.7%	96.7%	96.1%	95.3%

Licensee Comments: none

ERO Drill Participation

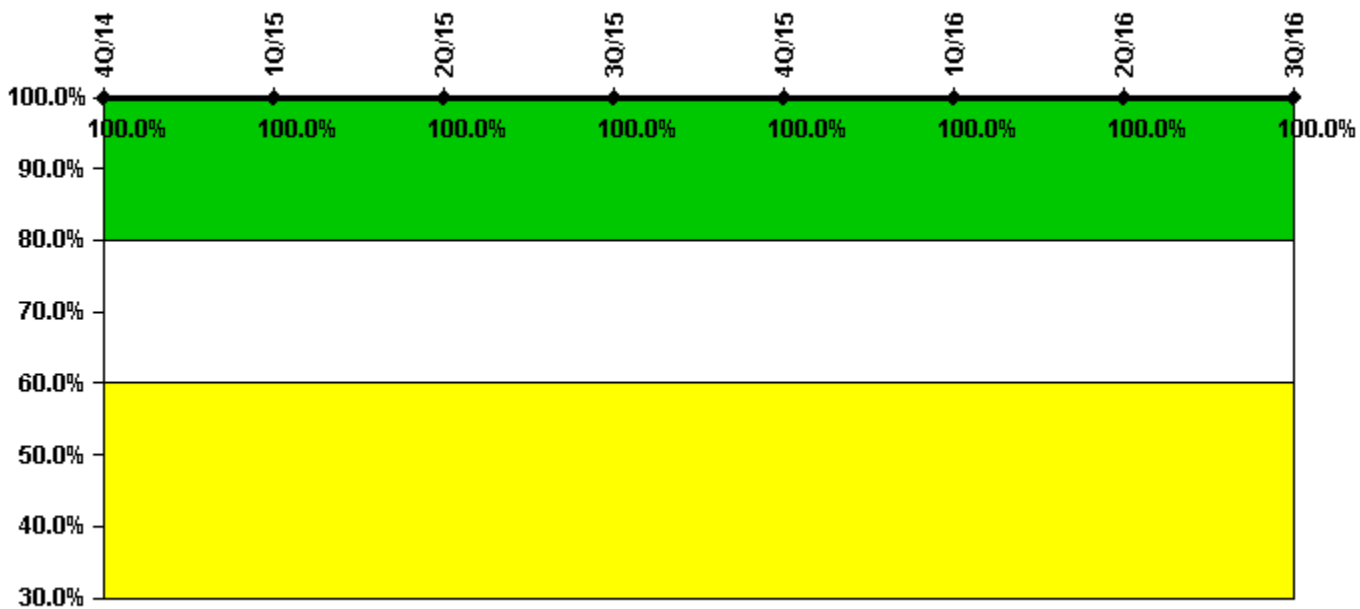


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
Participating Key personnel	126.0	127.0	123.0	120.0	120.0	120.0	114.0	118.0
Total Key personnel	126.0	127.0	123.0	120.0	120.0	120.0	114.0	118.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

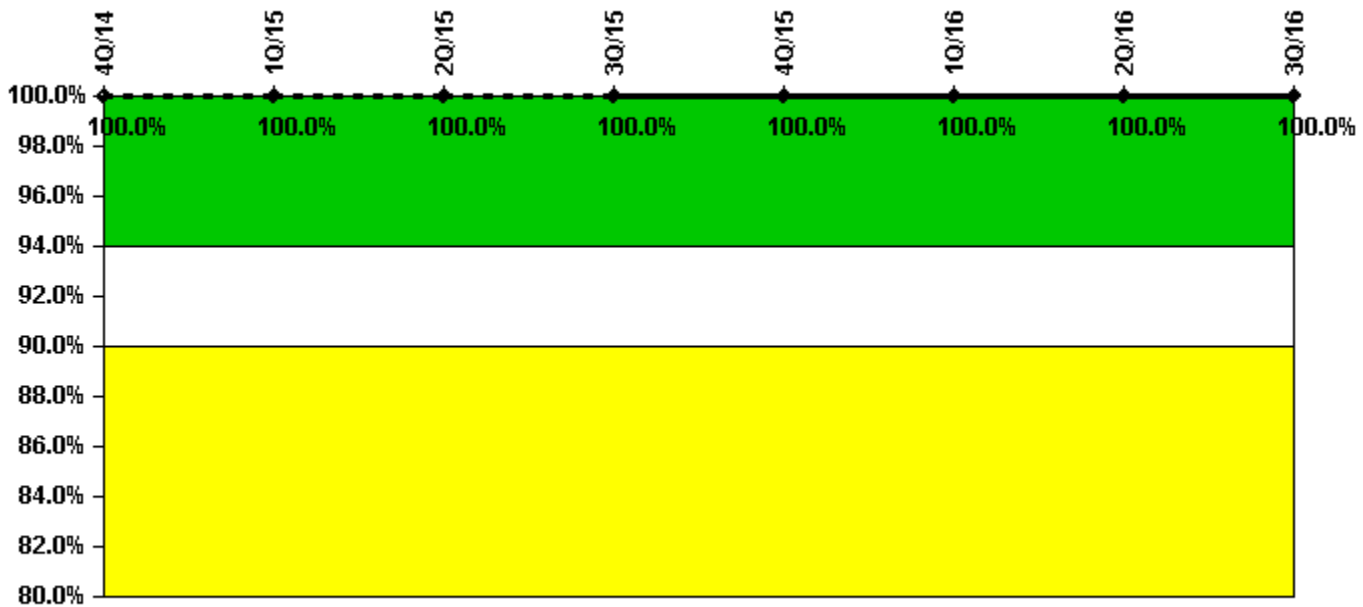


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
Successful siren-tests	553	474	553	528	499	553	474	553
Total sirens-tests	553	474	553	528	499	553	474	553
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

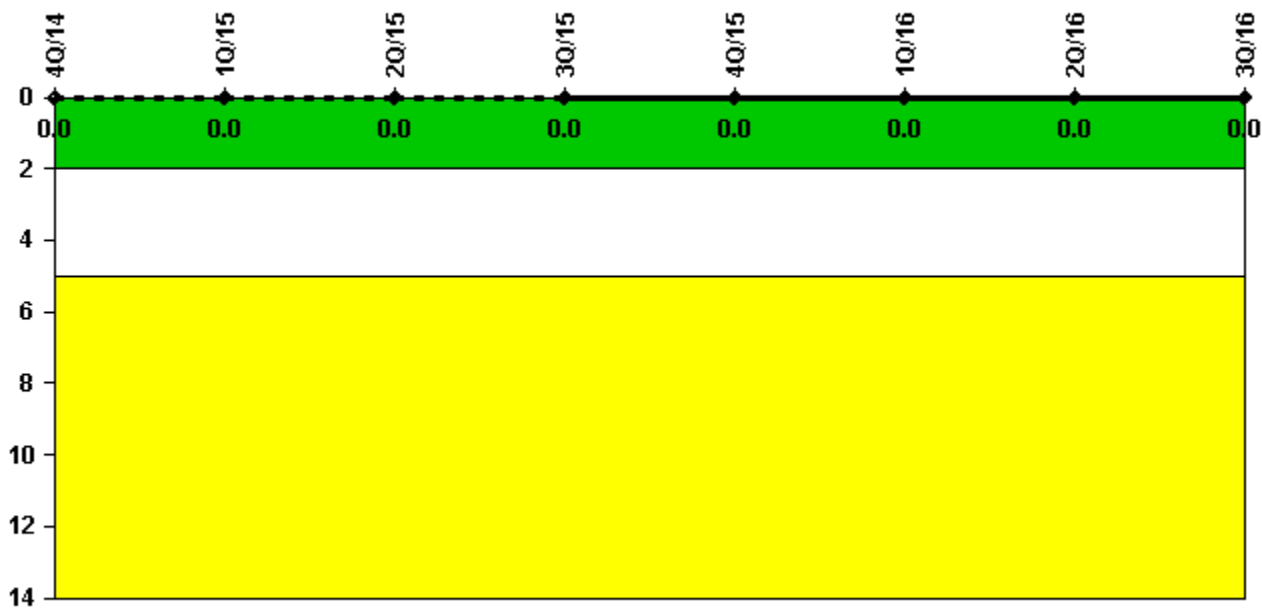


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

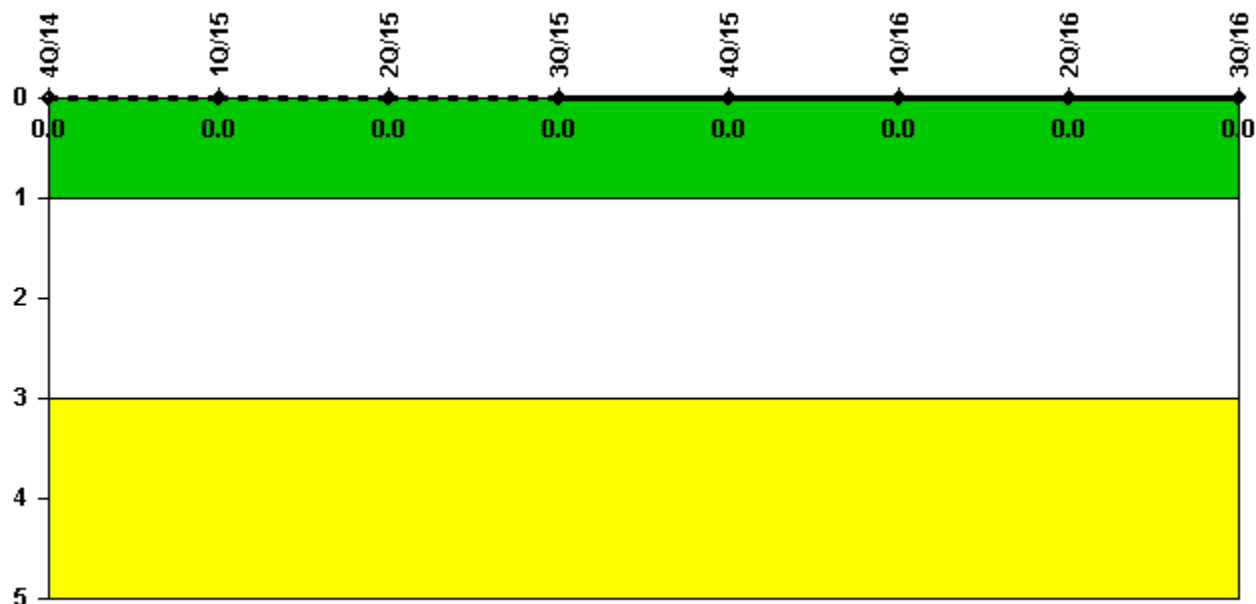

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: October 23, 2016