



Home > Nuclear Reactors > Operating Reactors > Reactor Oversight Process > Plant Summaries > Farley 1 > Quarterly Performance Indicators

Farley 1 – Quarterly Performance Indicators

1Q/2017 Performance Indicators


The solid trend line represents the current reporting period.

Licensee's General Comments: Wrong data was entered for 2016Q1 but corrected in 2017Q1. This change does not impact current color.

On this page:

- Unplanned Scrams (IE01)
- Unplanned Power Changes per 7000 Critical Hours (IE03)
- Unplanned Scrams with Complications (IE04)
- Safety System Functional Failures (MS05)
- Emergency AC Power Systems (MS06)
- High Pressure Injection Systems (MS07)
- Heat Removal Systems (MS08)
- Residual Heat Removal Systems (MS09)
- Cooling Water Systems (MS10)
- Reactor Coolant System Activity (BI01)
- Reactor Coolant System Leakage (BI02)
- Drill/Exercise Performance (EP01)
- Emergency Response Organization Drill Participation (EP02)
- Alert and Notification System Reliability (EP03)
- Occupational Exposure Control Effectiveness (OR01)
- RETS/OCDM Radiological Effluent Occurrence (PR01)
- Protected Area Equipment (PP01)

Unplanned Scrams per 7000 Critical Hrs

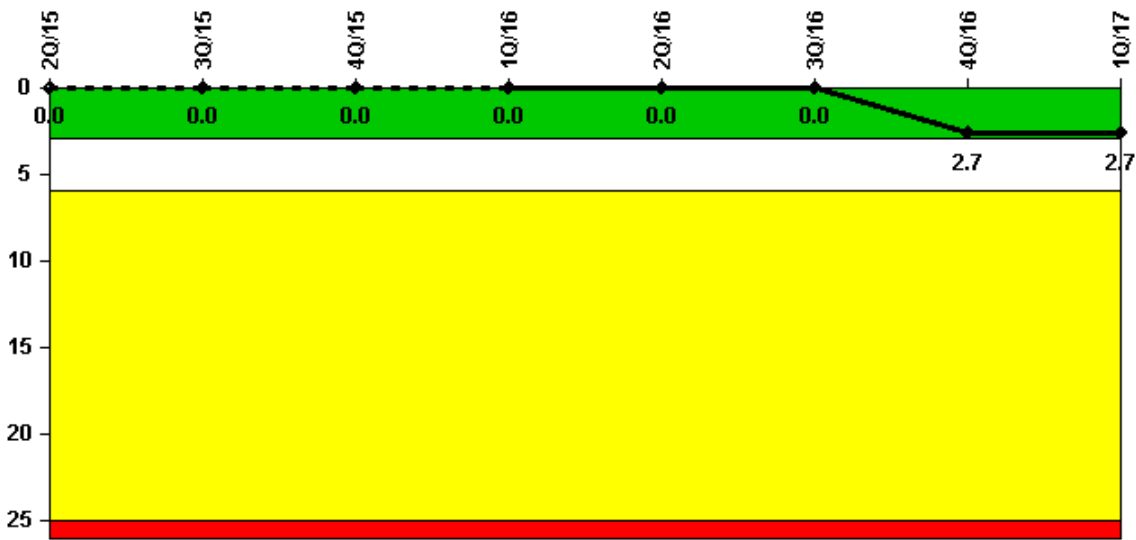

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
Unplanned scrams	0	0	0	0	0	0	3.0	0
Critical hours	1256.5	2208.0	2209.0	2183.0	2184.0	2208.0	1182.5	2159.0
Indicator value	0	0	0	0	0	0	2.7	2.7

▲ TOP

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

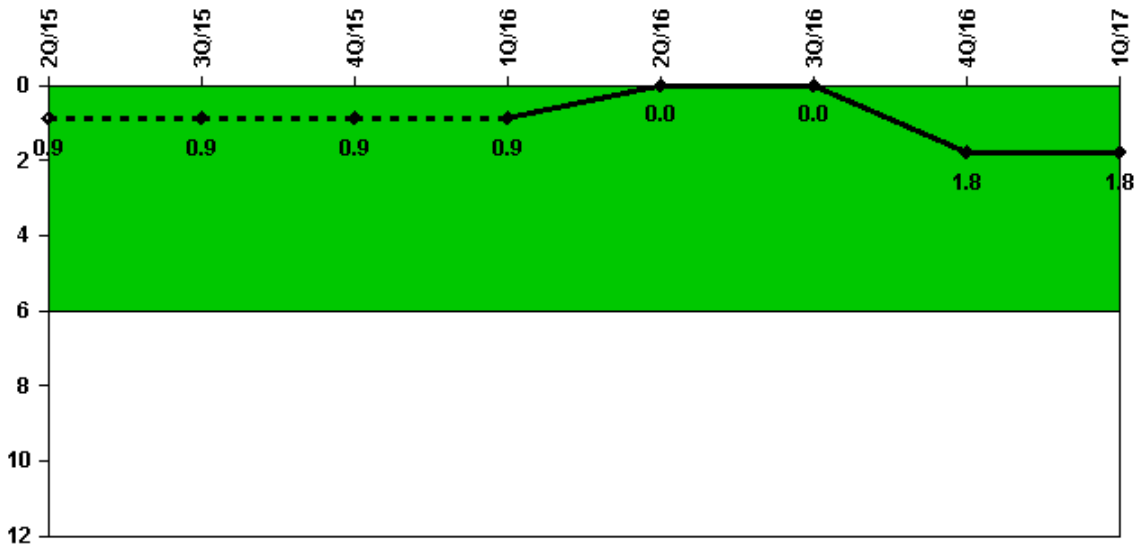

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
Unplanned power changes	1.0	0	0	0	0	0	2.0	0
Critical hours	1256.5	2208.0	2209.0	2183.0	2184.0	2208.0	1182.5	2159.0


Indicator value	0.9	0.9	0.9	0.9	0	0	1.8	1.8
-----------------	-----	-----	-----	-----	---	---	-----	-----

▲ TOP

Licensee Comments:

2Q/15: Unplanned losses due to loss of RCP & Turbine Trip

Unplanned Scrams with Complications

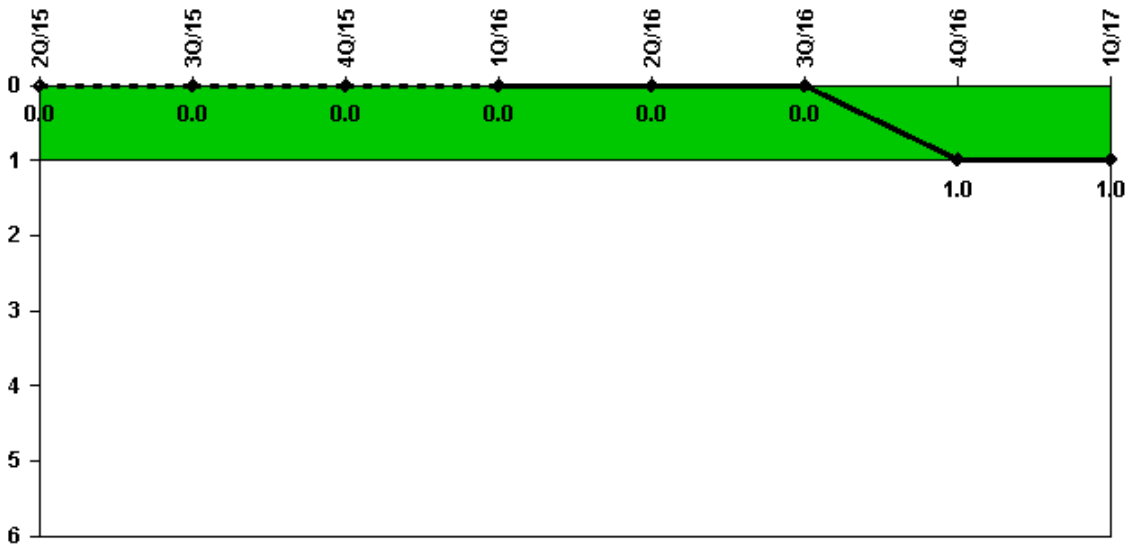

Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications 2Q/15 3Q/15 4Q/15 1Q/16 2Q/16 3Q/16 4Q/16 1Q/17


Scrams with complications 0 0 0 0 0 0 1.0 0

Indicator value 0.0 0.0 0.0 0.0 0.0 0.0 1.0 1.0

▲ TOP

Licensee Comments: none

Safety System Functional Failures (PWR)

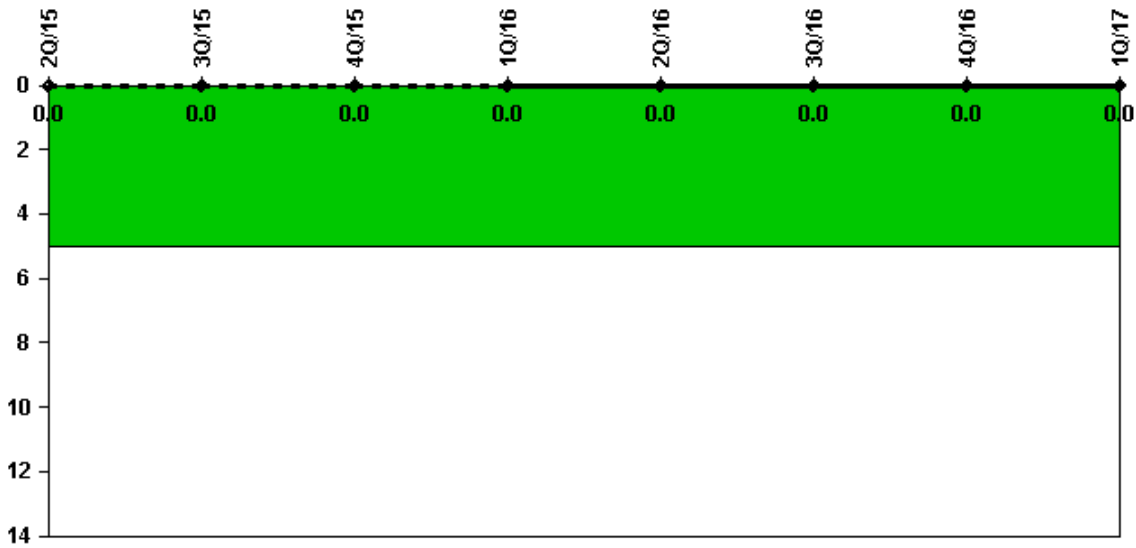

Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR) 2Q/15 3Q/15 4Q/15 1Q/16 2Q/16 3Q/16 4Q/16 1Q/17


Safety System Functional Failures 0 0 0 0 0 0 0 0 0

Indicator value 0 0 0 0 0 0 0 0 0

▲ TOP

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

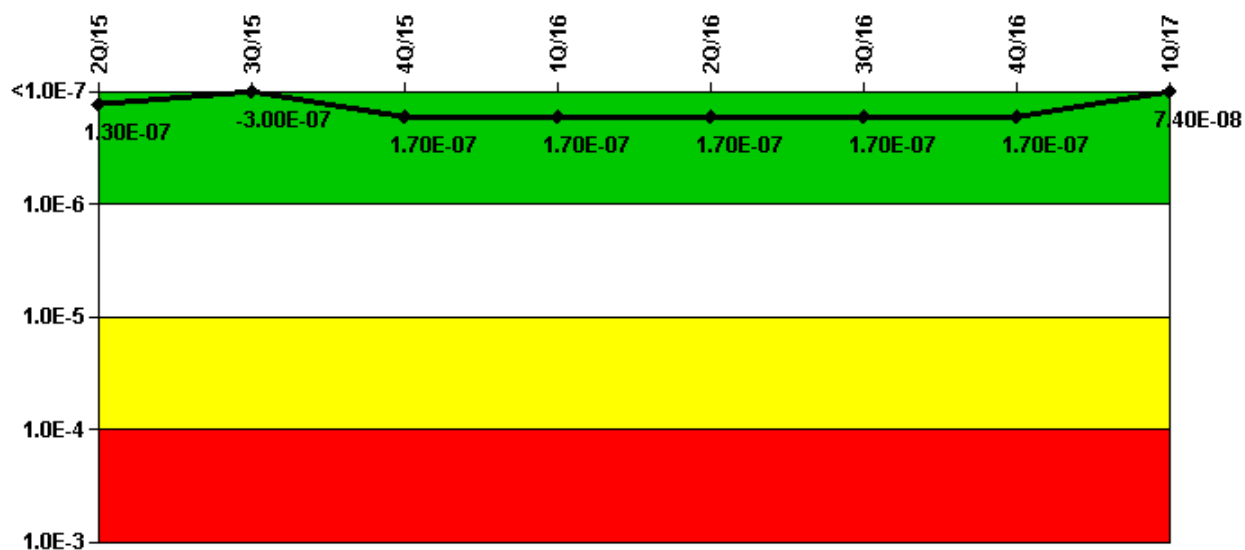

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System

	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
UAI (ΔCDF)	1.25E-07	-2.03E-08	-6.37E-09	-6.40E-09	-6.44E-09	-6.49E-09	-1.41E-08	-2.70E-08
URI (ΔCDF)	5.68E-10	-2.80E-07	1.80E-07	1.80E-07	1.80E-07	1.80E-07	1.88E-07	1.01E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.30E-07	-3.00E-07	1.70E-07	1.70E-07	1.70E-07	1.70E-07	1.70E-07	7.40E-08

▲ TOP


Licensee Comments:

4Q/16: Changed PRA Parameter(s).

3Q/15: Risk Cap Invoked.

2Q/15: Risk Cap Invoked.

Mitigating Systems Performance Index, High Pressure Injection System

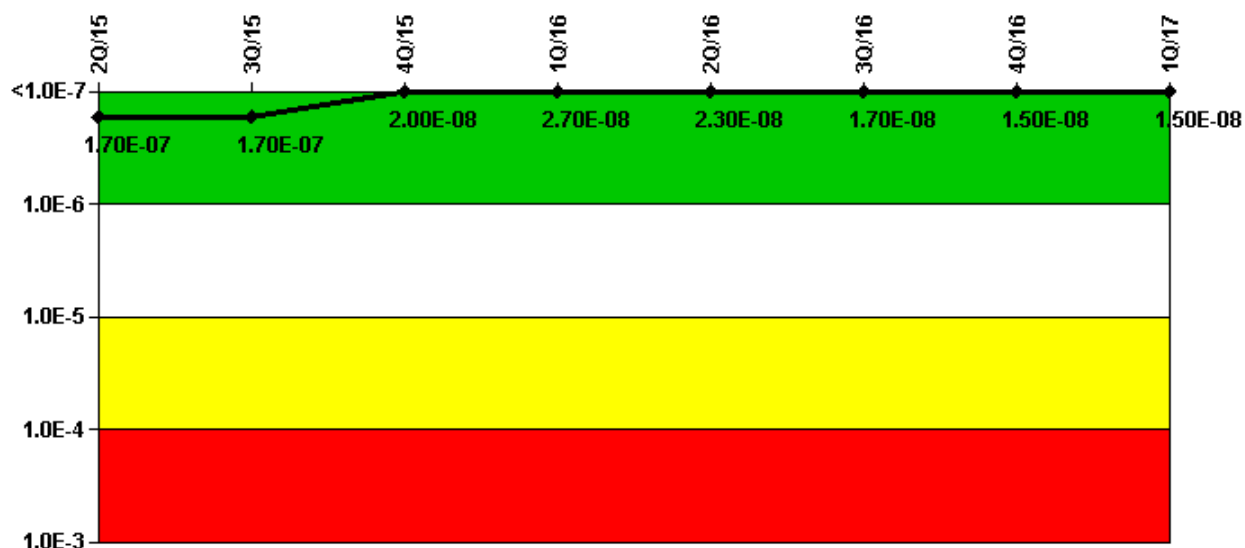

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System


	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
UAI (ΔCDF)	2.05E-07	2.09E-07	2.33E-08	3.00E-08	2.69E-08	2.00E-08	1.82E-08	1.89E-08
URI (ΔCDF)	-3.78E-08	-3.78E-08	-3.43E-09	-3.43E-09	-3.43E-09	-3.43E-09	-3.56E-09	-3.56E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.70E-07	1.70E-07	2.00E-08	2.70E-08	2.30E-08	1.70E-08	1.50E-08	1.50E-08

▲ TOP

Licensee Comments:

4Q/16: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Heat Removal System

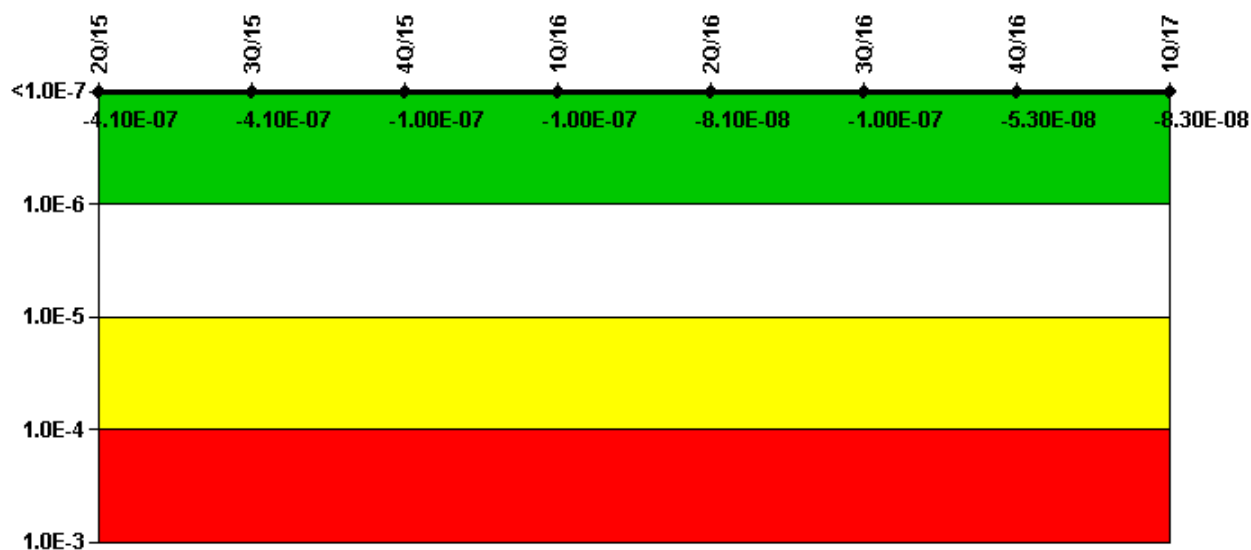

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System


	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
UAI (Δ CDF)	-8.17E-09	-1.32E-08	-1.97E-08	-2.13E-08	7.01E-11	-1.96E-08	-1.68E-08	-4.75E-08
URI (Δ CDF)	-4.00E-07	-4.00E-07	-8.15E-08	-8.15E-08	-8.15E-08	-8.15E-08	-3.59E-08	-3.59E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.10E-07	-4.10E-07	-1.00E-07	-1.00E-07	-8.10E-08	-1.00E-07	-5.30E-08	-8.30E-08

▲ TOP

Licensee Comments:

4Q/16: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Residual Heat Removal System

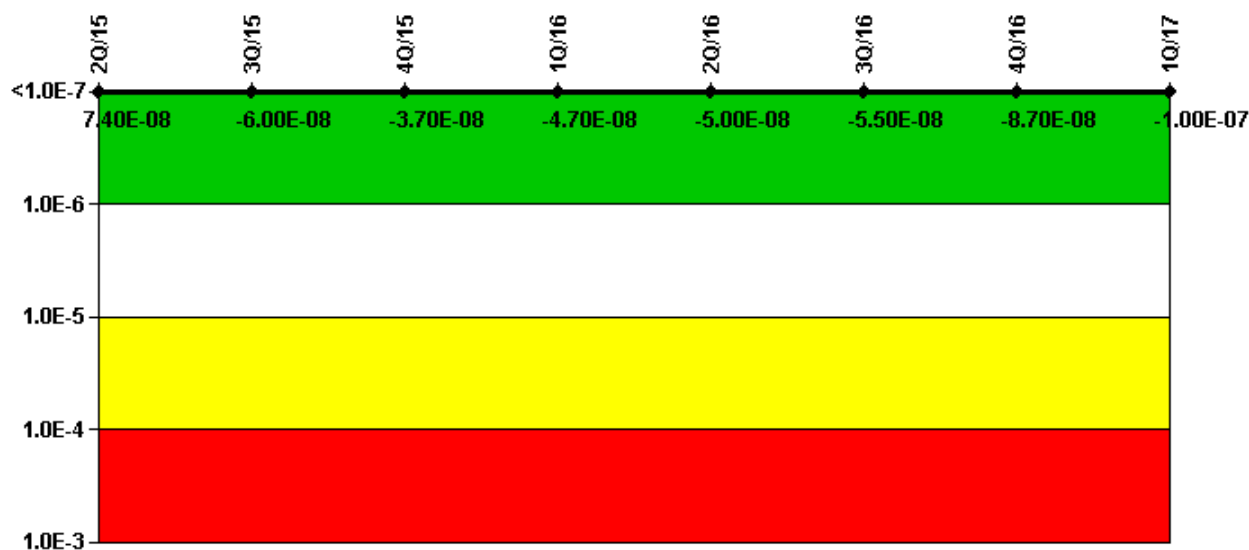

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System


	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
UAI (Δ CDF)	2.95E-07	1.60E-07	2.92E-08	1.89E-08	1.64E-08	1.10E-08	-1.33E-08	-2.84E-08
URI (Δ CDF)	-2.21E-07	-2.21E-07	-6.59E-08	-6.59E-08	-6.59E-08	-6.59E-08	-7.34E-08	-7.34E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	7.40E-08	-6.00E-08	-3.70E-08	-4.70E-08	-5.00E-08	-5.50E-08	-8.70E-08	-1.00E-07

▲ TOP

Licensee Comments:

4Q/16: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Cooling Water Systems

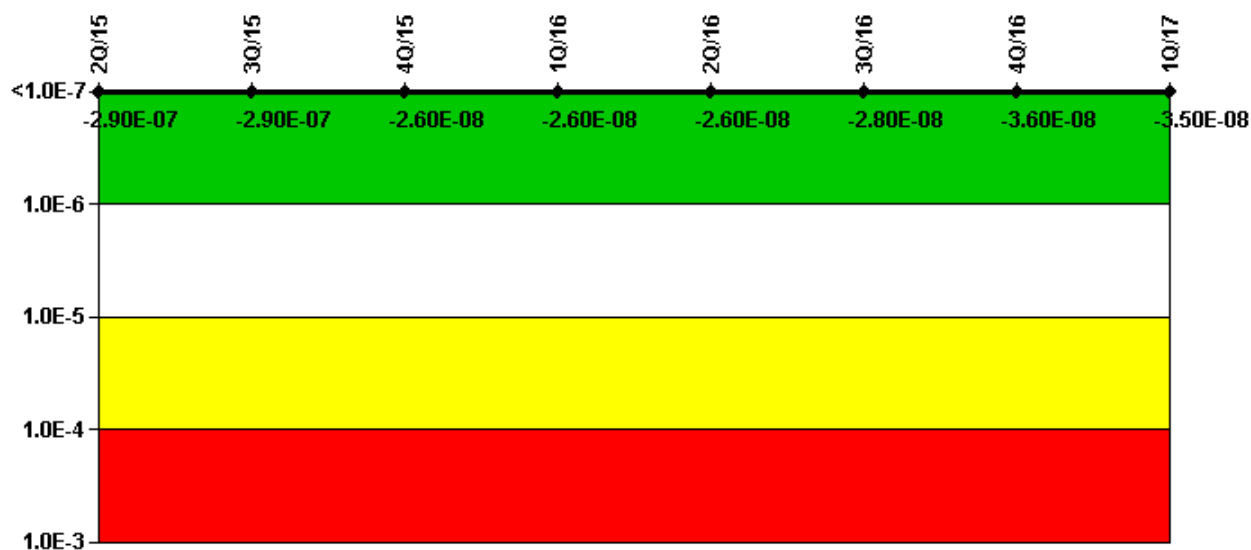

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems


	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
UAI (Δ CDF)	1.95E-08	2.48E-08	5.80E-09	5.18E-09	5.35E-09	3.10E-09	2.36E-09	2.90E-09
URI (Δ CDF)	-3.13E-07	-3.13E-07	-3.15E-08	-3.15E-08	-3.15E-08	-3.15E-08	-3.83E-08	-3.83E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.90E-07	-2.90E-07	-2.60E-08	-2.60E-08	-2.60E-08	-2.80E-08	-3.60E-08	-3.50E-08

▲ TOP

Licensee Comments:

4Q/16: Changed PRA Parameter(s).

Reactor Coolant System Activity

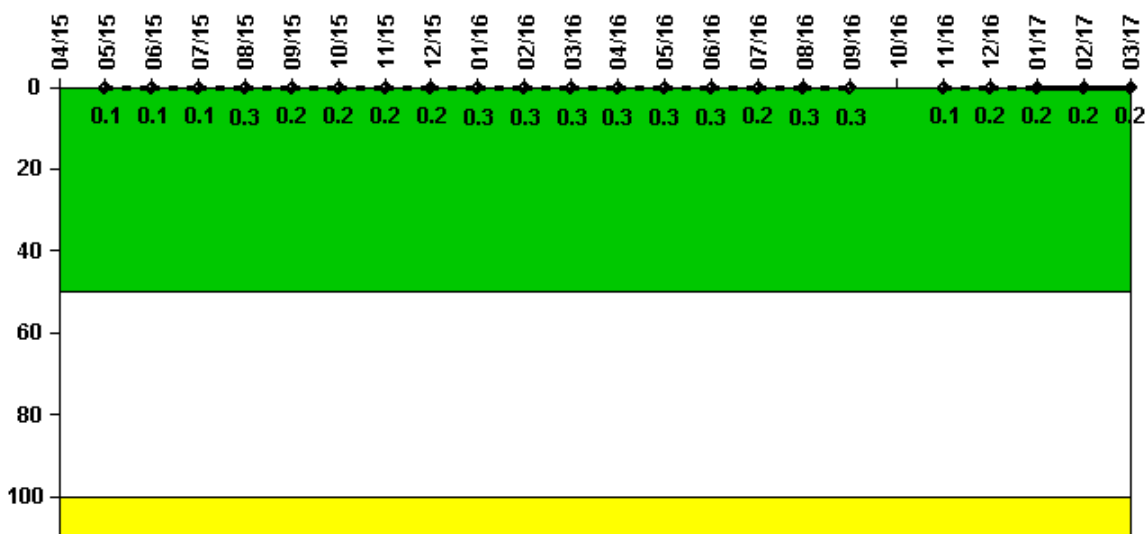

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/15	5/15	6/15	7/15	8/15	9/15	10/15	11/15	12/15	1/16	2/16	3/16
Maximum activity	N/A	0.000464	0.000705	0.000740	0.001610	0.000944	0.000935	0.001020	0.001040	0.001330	0.001360	0.001390
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	N/A	0.1	0.1	0.1	0.3	0.2	0.2	0.2	0.2	0.3	0.3	0.3
Reactor Coolant System Activity	4/16	5/16	6/16	7/16	8/16	9/16	10/16	11/16	12/16	1/17	2/17	3/17
Maximum activity	0.001330	0.001410	0.001490	0.001230	0.001380	0.001460	N/A	0.000745	0.000801	0.000894	0.000916	0.000959
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0.3	0.3	0.3	0.2	0.3	0.3	N/A	0.1	0.2	0.2	0.2	0.2

▲ TOP

Licensee Comments: none

Reactor Coolant System Leakage

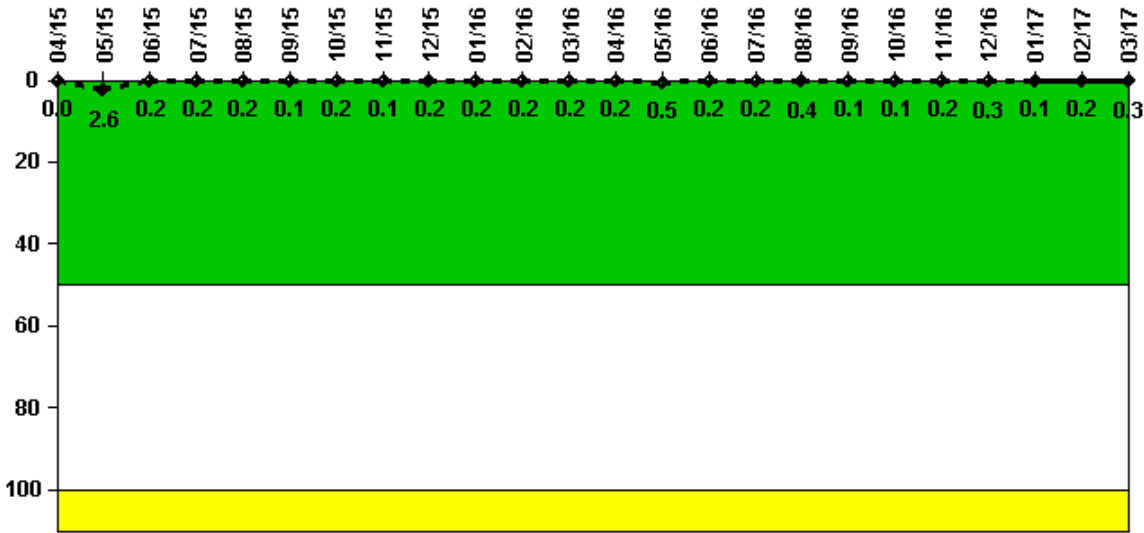

Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/15	5/15	6/15	7/15	8/15	9/15	10/15	11/15	12/15	1/16	2/16	3/16
Maximum leakage	0	0.264	0.024	0.022	0.015	0.013	0.018	0.013	0.017	0.016	0.020	0.020
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0


Indicator value	0	2.6	0.2	0.2	0.2	0.1	0.2	0.1	0.2	0.2	0.2	0.2
Reactor Coolant System Leakage	4/16	5/16	6/16	7/16	8/16	9/16	10/16	11/16	12/16	1/17	2/17	3/17
Maximum leakage	0.018	0.050	0.019	0.016	0.036	0.013	0.014	0.023	0.026	0.014	0.021	0.026
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0

Indicator value	0.2	0.5	0.2	0.2	0.4	0.1	0.1	0.2	0.3	0.1	0.2	0.3
-----------------	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----

▲ TOP

Licensee Comments: none

Drill/Exercise Performance

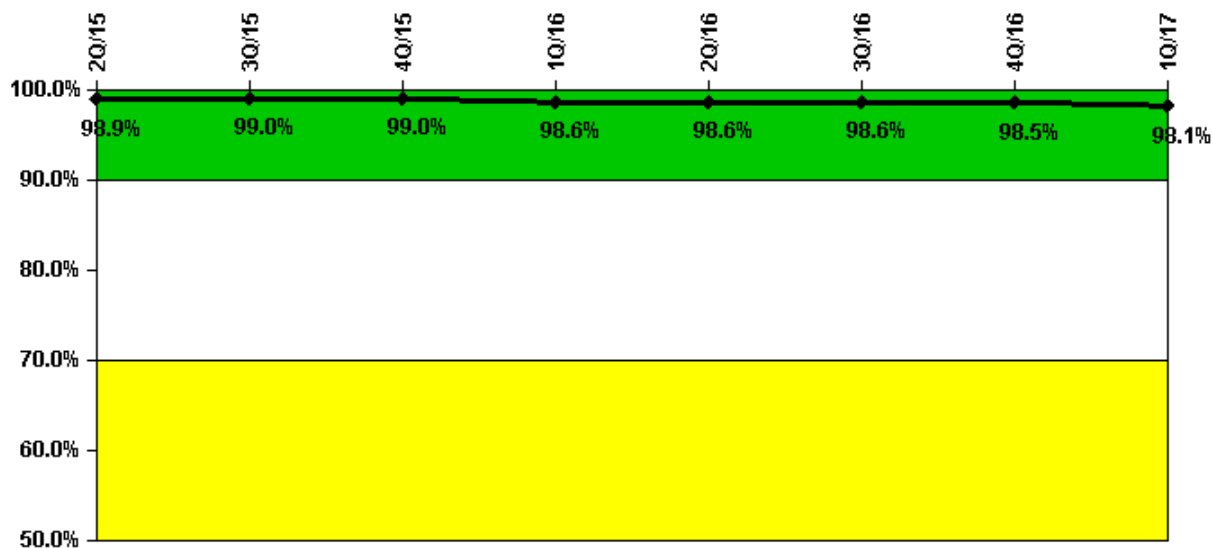

Thresholds: White < 90.0% Yellow < 70.0%

Notes


Drill/Exercise Performance	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
Successful opportunities	22.0	59.0	22.0	84.0	39.0	37.0	6.0	35.0
Total opportunities	23.0	59.0	22.0	87.0	40.0	37.0	6.0	36.0

Indicator value 98.9% 99.0% 99.0% 98.6% 98.6% 98.6% 98.5% 98.1%

▲ TOP

Licensee Comments: none

ERO Drill Participation

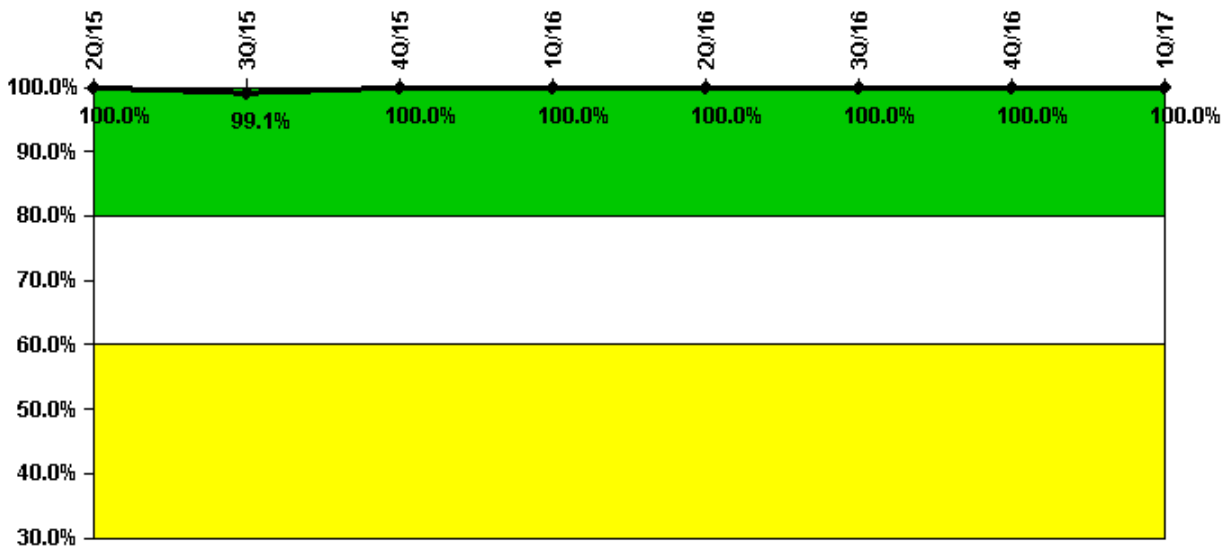

Thresholds: White < 80.0% Yellow < 60.0%

Notes


ERO Drill Participation	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
Participating Key personnel	115.0	114.0	120.0	120.0	116.0	120.0	121.0	113.0
Total Key personnel	115.0	115.0	120.0	120.0	116.0	120.0	121.0	113.0

Indicator value **100.0% 99.1% 100.0% 100.0% 100.0% 100.0% 100.0% 100.0%**

▲ TOP

Licensee Comments: none

Alert & Notification System

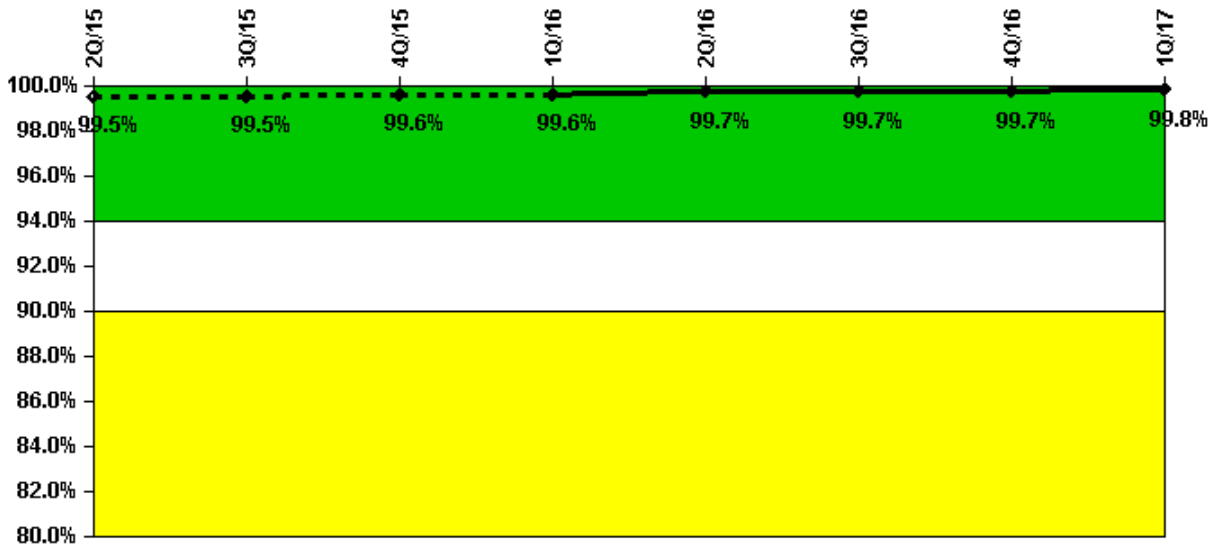

Thresholds: White < 94.0% Yellow < 90.0%

Notes


Alert & Notification System	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
Successful siren-tests	1154	1150	1244	1152	1157	1152	1244	1155
Total sirens-tests	1157	1157	1246	1157	1157	1157	1246	1157

Indicator value 99.5% 99.5% 99.6% 99.6% 99.7% 99.7% 99.7% 99.8%

▲ TOP

Licensee Comments: none

Occupational Exposure Control Effectiveness

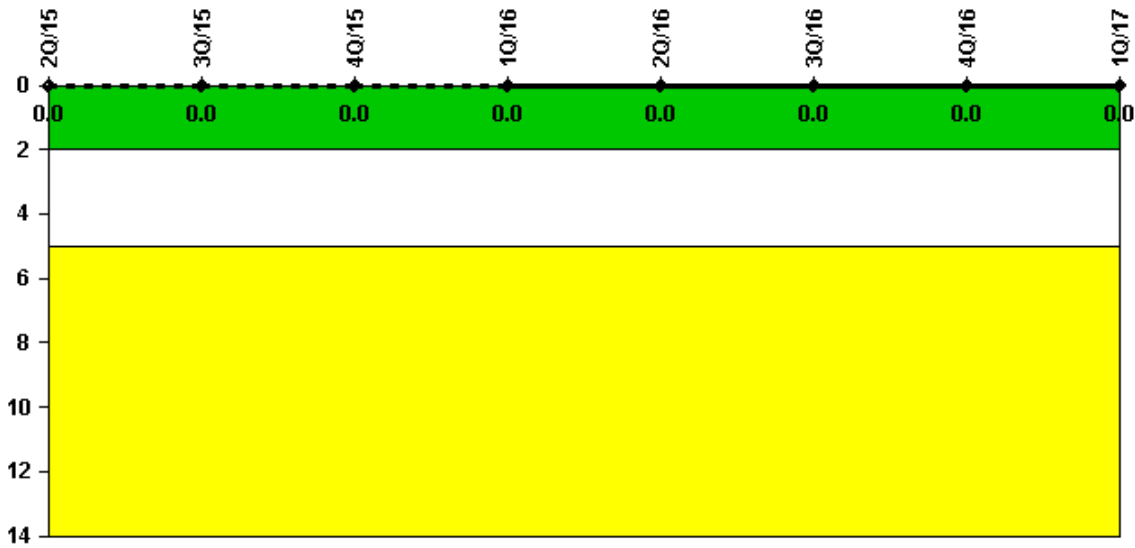

Thresholds: White > 2.0 Yellow > 5.0


Notes

Occupational Exposure Control Effectiveness	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

▲ TOP

Licensee Comments: none

RETS/ODCM Radiological Effluent

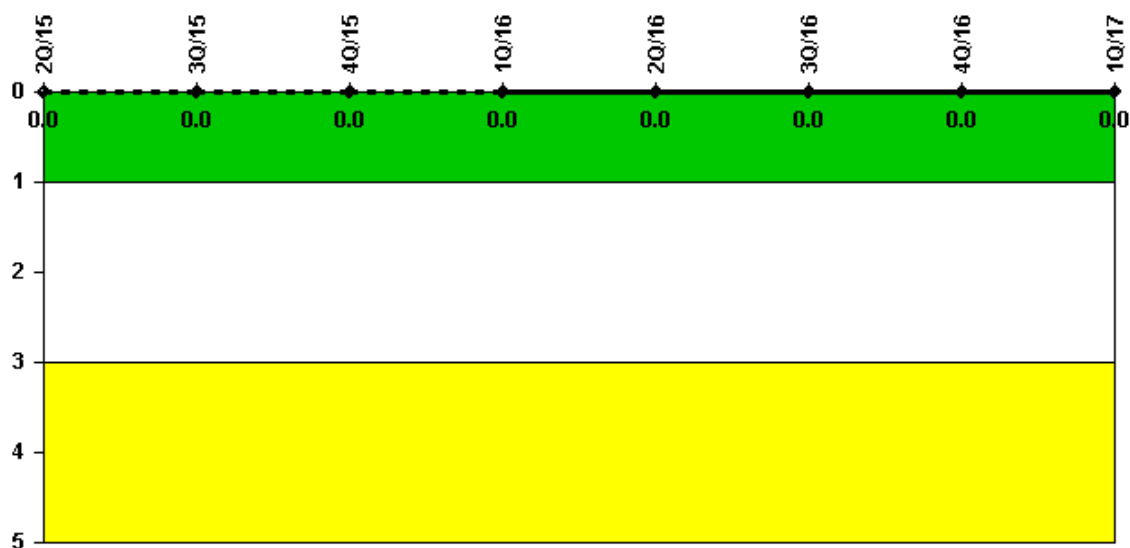

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent 2Q/15 3Q/15 4Q/15 1Q/16 2Q/16 3Q/16 4Q/16 1Q/17

RETS/ODCM occurrences 0 0 0 0 0 0 0 0

Indicator value 0 0 0 0 0 0 0 0

[TOP](#)

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

Current data as of: May 5, 2017

Page Last Reviewed/Updated Wednesday, June 07, 2017