



Home > Nuclear Reactors > Operating Reactors > Reactor Oversight Process > Plant Summaries > Vogtle 2 > Quarterly Performance Indicators

Vogtle 2 – Quarterly Performance Indicators

1Q/2017 Performance Indicators


The solid trend line represents the current reporting period.

Licensee's General Comments: Change file due to adding comments after Quarterly file was created. LER number was added to comments section for the SSFF that occurred in the 1Q2017. Pump Demands for NSCW Pump#5 were entered incorrectly in Oct 2016. This Data error did not impact the KPI report.

On this page:

- Unplanned Scrams (IE01)
- Unplanned Power Changes per 7000 Critical Hours (IE03)
- Unplanned Scrams with Complications (IE04)
- Safety System Functional Failures (MS05)
- Emergency AC Power Systems (MS06)
- High Pressure Injection Systems (MS07)
- Heat Removal Systems (MS08)
- Residual Heat Removal Systems (MS09)
- Cooling Water Systems (MS10)
- Reactor Coolant System Activity (BI01)
- Reactor Coolant System Leakage (BI02)
- Drill/Exercise Performance (EP01)
- Emergency Response Organization Drill Participation (EP02)
- Alert and Notification System Reliability (EP03)
- Occupational Exposure Control Effectiveness (OR01)
- RETS/OCDM Radiological Effluent Occurrence (PR01)
- Protected Area Equipment (PP01)

Unplanned Scrams per 7000 Critical Hrs

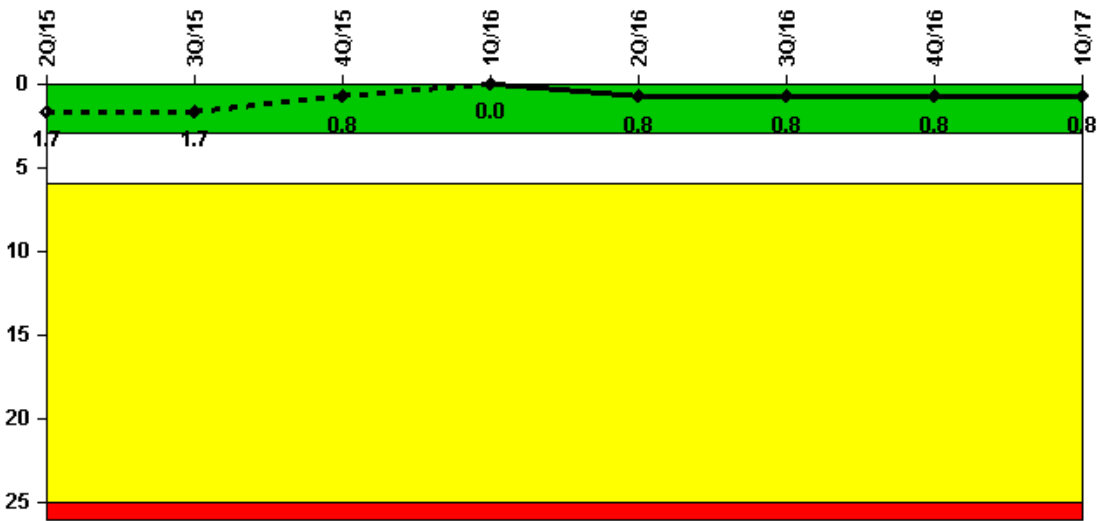

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes


Unplanned Scrams per 7000 Critical Hrs	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
Unplanned scrams	0	0	0	0	1.0	0	0	0
Critical hours	2184.0	2208.0	2209.0	1672.2	2160.7	2208.0	2209.0	2159.0

Indicator value	1.7	1.7	0.8	0	0.8	0.8	0.8	0.8
-----------------	-----	-----	-----	---	-----	-----	-----	-----

TOP

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

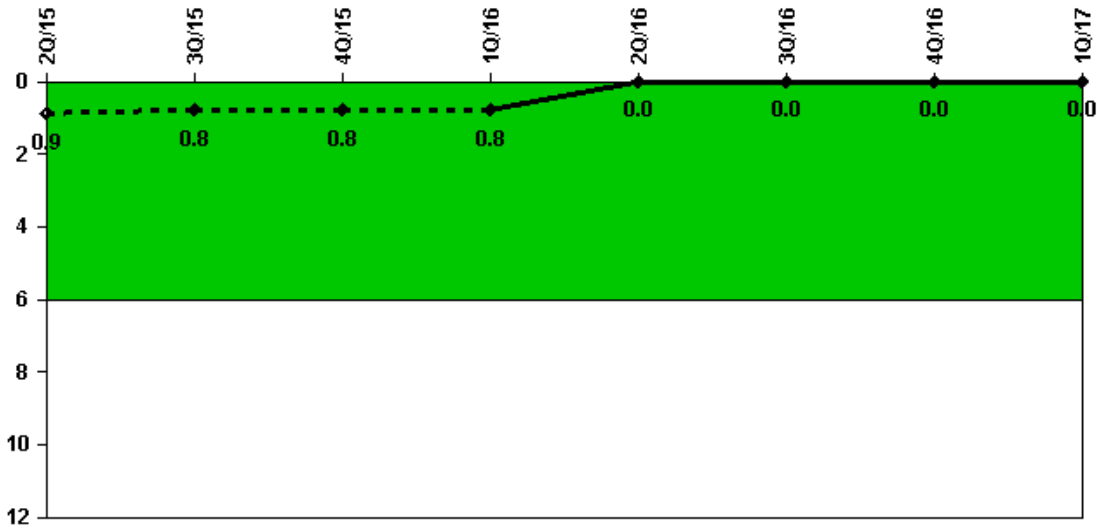

Thresholds: White > 6.0

Notes


Unplanned Power Changes per 7000 Critical Hrs	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
Unplanned power changes	1.0	0	0	0	0	0	0	0
Critical hours	2184.0	2208.0	2209.0	1672.2	2160.7	2208.0	2209.0	2159.0

Indicator value	0.9	0.8	0.8	0.8	0	0	0	0
------------------------	------------	------------	------------	------------	----------	----------	----------	----------

▲ TOP

Licensee Comments: none

Unplanned Scrams with Complications

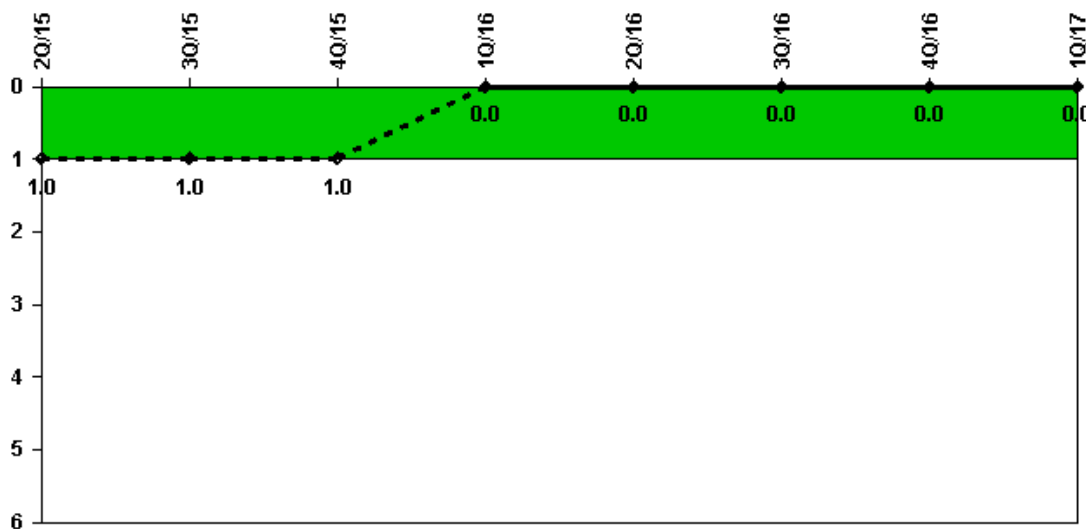

Thresholds: White > 1.0

Notes


Unplanned Scrams with Complications	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
Scrams with complications	0	0	0	0	0	0	0	0

Indicator value	1.0	1.0	1.0	0.0	0.0	0.0	0.0	0.0
------------------------	------------	------------	------------	------------	------------	------------	------------	------------

▲ TOP

Licensee Comments: none

Safety System Functional Failures (PWR)

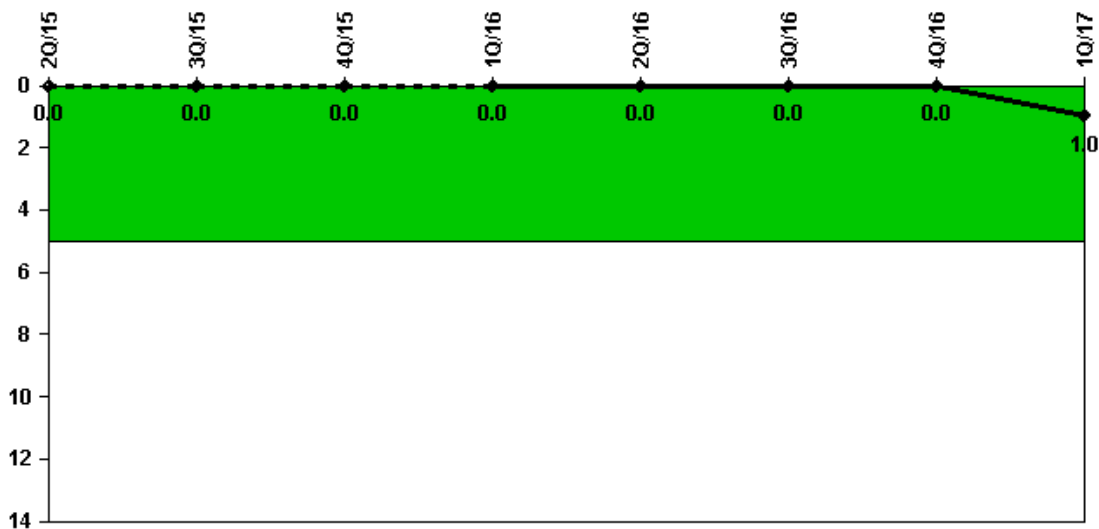

Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR) 2Q/15 3Q/15 4Q/15 1Q/16 2Q/16 3Q/16 4Q/16 1Q/17

Safety System Functional Failures 0 0 0 0 0 0 0 0 1


Indicator value 0 0 0 0 0 0 0 0 1

▲ TOP

Licensee Comments:

1Q/17: LER 2-2017-001-00

Mitigating Systems Performance Index, Emergency AC Power System

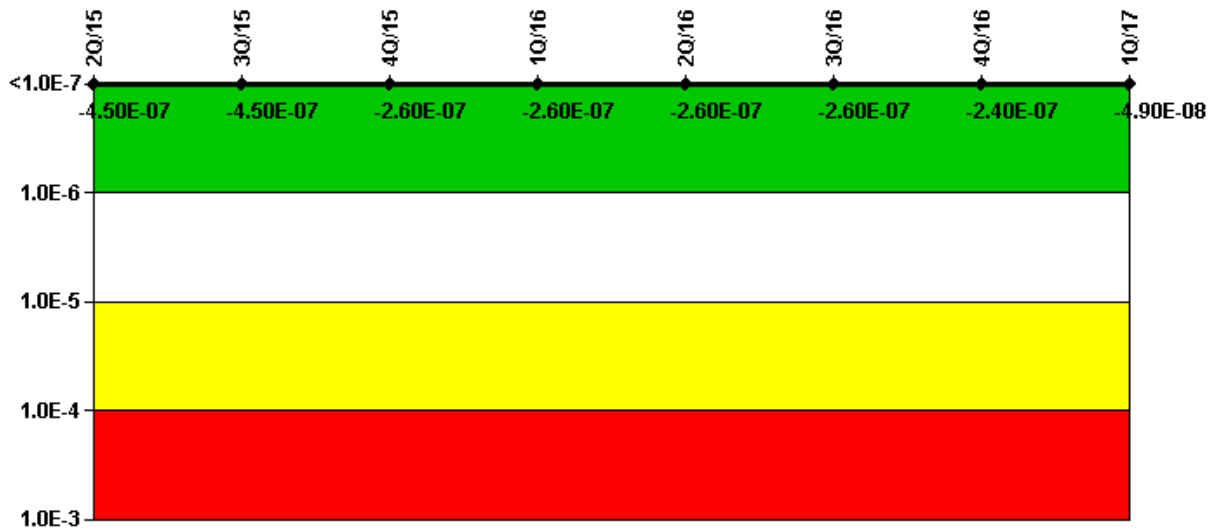

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System


	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
UAI (ΔCDF)	-4.32E-08	-4.32E-08	-2.07E-08	-2.07E-08	-2.72E-08	-2.72E-08	-3.58E-09	3.85E-09
URI (ΔCDF)	-4.08E-07	-4.07E-07	-2.35E-07	-2.35E-07	-2.33E-07	-2.34E-07	-2.35E-07	-5.30E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.50E-07	-4.50E-07	-2.60E-07	-2.60E-07	-2.60E-07	-2.60E-07	-2.40E-07	-4.90E-08

▲ TOP

Licensee Comments:

4Q/15: Changed PRA Parameter(s).

Mitigating Systems Performance Index, High Pressure Injection System

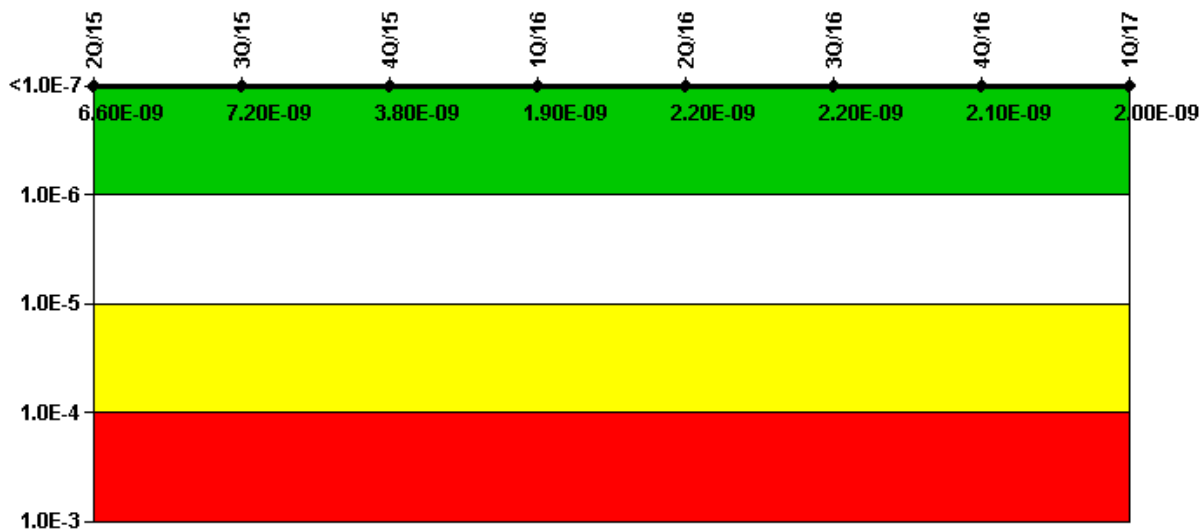

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System


	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
UAI (Δ CDF)	-6.06E-09	-6.06E-09	-2.94E-09	-2.91E-09	-2.91E-09	-2.91E-09	-2.91E-09	-2.91E-09
URI (Δ CDF)	1.26E-08	1.32E-08	6.77E-09	4.80E-09	5.07E-09	5.09E-09	5.04E-09	4.87E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	6.60E-09	7.20E-09	3.80E-09	1.90E-09	2.20E-09	2.20E-09	2.10E-09	2.00E-09

▲ TOP

Licensee Comments:

4Q/15: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Heat Removal System

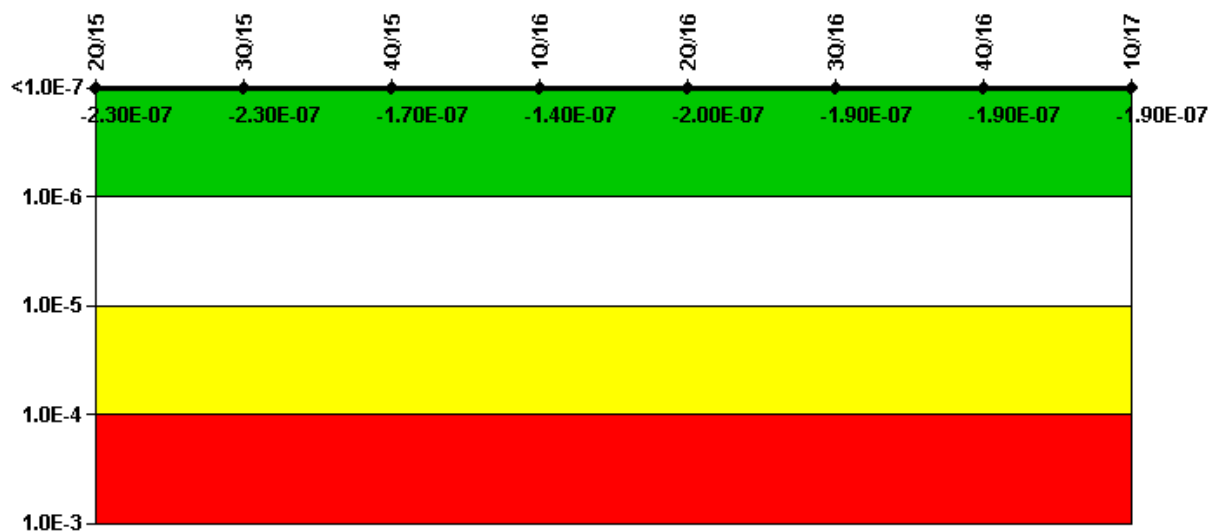

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System


	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
UAI (Δ CDF)	1.12E-07	1.13E-07	4.94E-08	8.55E-08	2.60E-08	2.66E-08	2.67E-08	2.29E-08
URI (Δ CDF)	-3.42E-07	-3.42E-07	-2.24E-07	-2.23E-07	-2.21E-07	-2.21E-07	-2.12E-07	-2.12E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.30E-07	-2.30E-07	-1.70E-07	-1.40E-07	-2.00E-07	-1.90E-07	-1.90E-07	-1.90E-07

TOP

Licensee Comments:

4Q/15: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Residual Heat Removal System

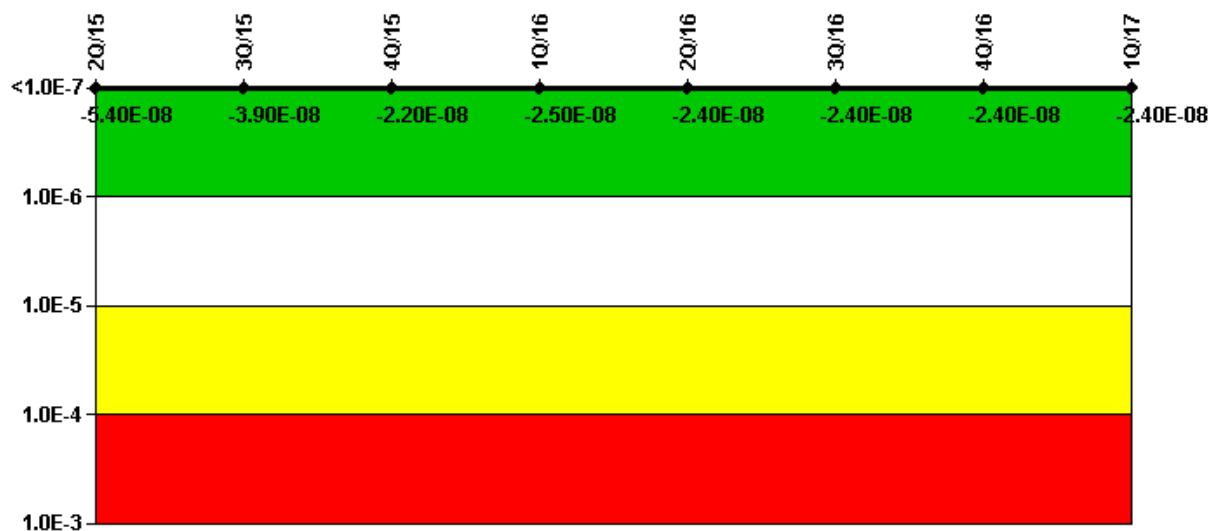

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System


	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
UAI (Δ CDF)	-1.11E-08	3.77E-09	1.74E-09	-1.81E-09	-1.11E-09	-1.12E-09	-1.16E-09	-1.35E-09
URI (Δ CDF)	-4.25E-08	-4.25E-08	-2.37E-08	-2.35E-08	-2.26E-08	-2.26E-08	-2.26E-08	-2.26E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.40E-08	-3.90E-08	-2.20E-08	-2.50E-08	-2.40E-08	-2.40E-08	-2.40E-08	-2.40E-08

▲ TOP

Licensee Comments:

4Q/15: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Cooling Water Systems

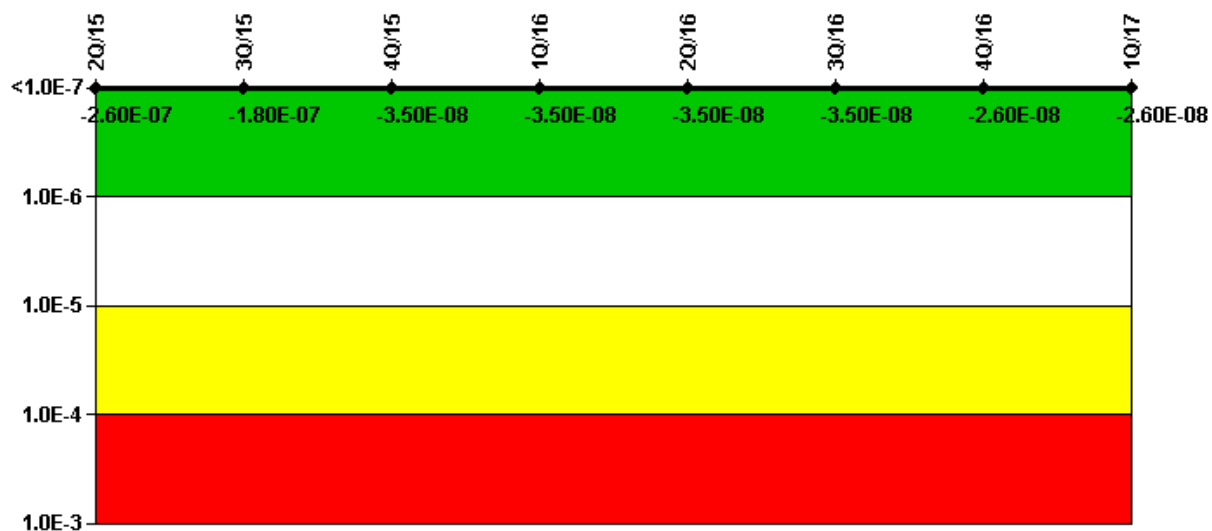

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems


	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
UAI (ΔCDF)	-1.79E-07	-1.02E-07	-1.81E-08	-1.82E-08	-1.83E-08	-1.83E-08	-1.83E-08	-1.83E-08
URI (ΔCDF)	-8.22E-08	-8.21E-08	-1.66E-08	-1.66E-08	-1.66E-08	-1.66E-08	-7.92E-09	-7.75E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.60E-07	-1.80E-07	-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08	-2.60E-08	-2.60E-08

▲ TOP

Licensee Comments:

4Q/16: Pump Demands for NSCW Pump#5 were entered incorrectly. This Data error did not impact the KPI report. Ref CR#10331455
 4Q/15: Changed PRA Parameter(s).

Reactor Coolant System Activity

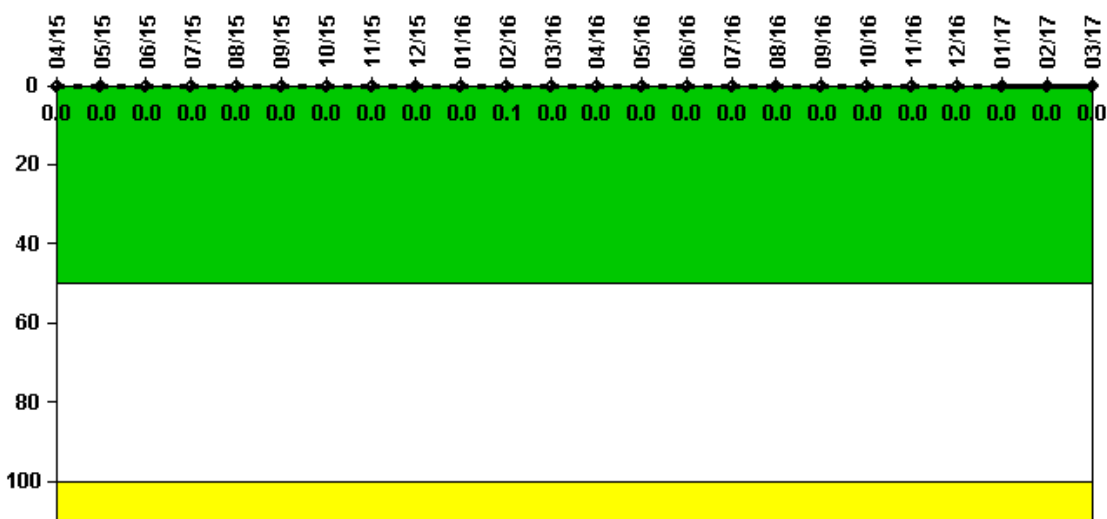

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/15	5/15	6/15	7/15	8/15	9/15	10/15	11/15	12/15	1/16	2/16	3/16
Maximum activity	0.000250	0.000255	0.000436	0.000314	0.000313	0.000330	0.000336	0.000357	0.000381	0.000434	0.000509	0.000205
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0.1	0
Reactor Coolant System Activity	4/16	5/16	6/16	7/16	8/16	9/16	10/16	11/16	12/16	1/17	2/17	3/17
Maximum activity	0.000143	0.000140	0.000161	0.000173	0.000174	0.000042	0.000187	0.000205	0.000219	0.000224	0.000245	0.000236
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

▲ TOP

Licensee Comments: none

Reactor Coolant System Leakage

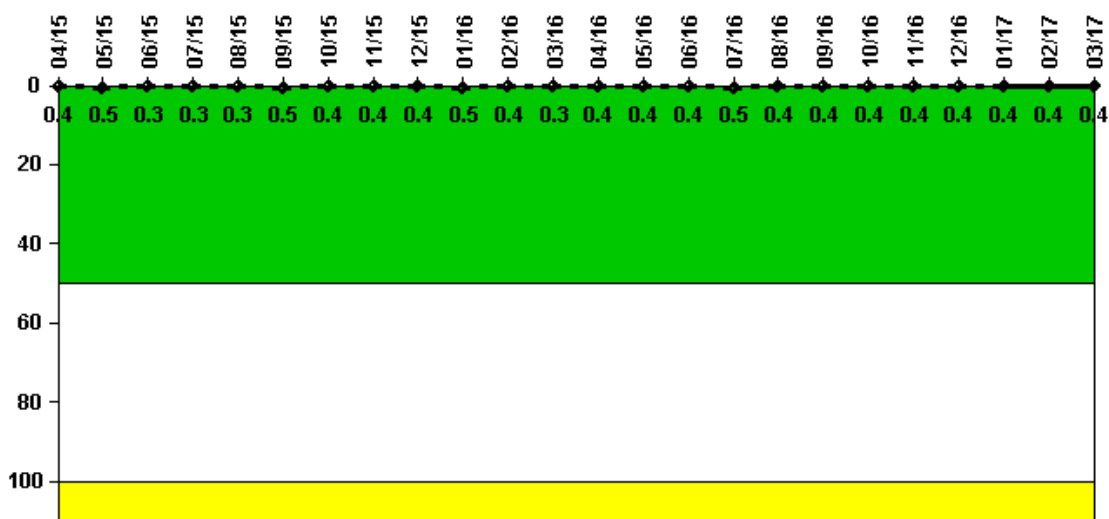

Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/15	5/15	6/15	7/15	8/15	9/15	10/15	11/15	12/15	1/16	2/16	3/16
Maximum leakage	0.039	0.047	0.033	0.032	0.030	0.050	0.036	0.037	0.037	0.045	0.035	0.031
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0


Indicator value	0.4	0.5	0.3	0.3	0.3	0.5	0.4	0.4	0.4	0.5	0.4	0.3
Reactor Coolant System Leakage	4/16	5/16	6/16	7/16	8/16	9/16	10/16	11/16	12/16	1/17	2/17	3/17
Maximum leakage	0.039	0.041	0.038	0.045	0.035	0.036	0.042	0.039	0.040	0.041	0.043	0.039
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0

Indicator value	0.4	0.4	0.4	0.5	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4
------------------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

TOP

Licensee Comments: none

Drill/Exercise Performance

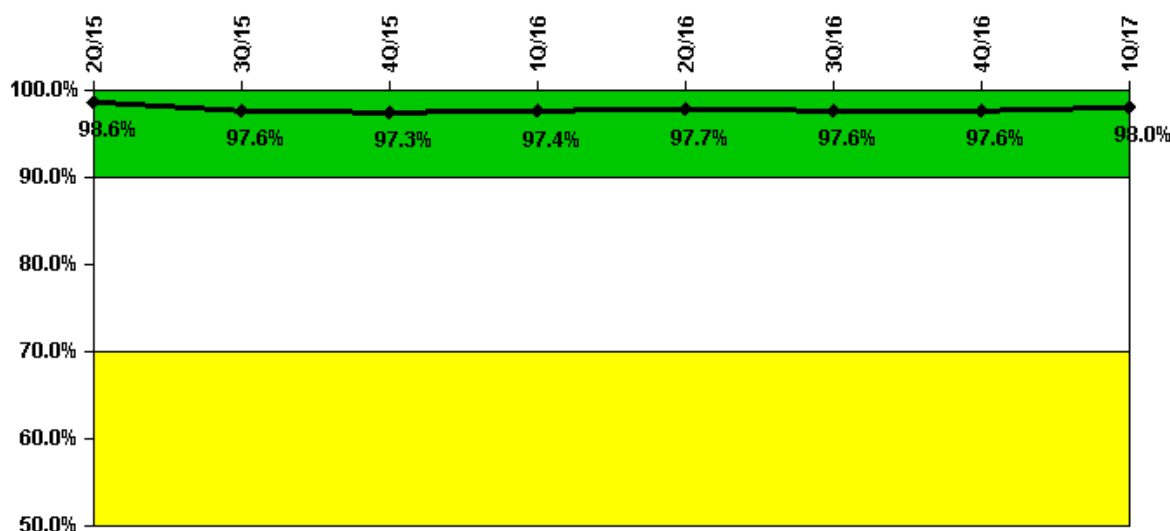

Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
Successful opportunities	38.0	34.0	20.0	46.0	93.0	57.0	27.0	24.0
Total opportunities	38.0	38.0	20.0	46.0	94.0	58.0	28.0	24.0


Indicator value **98.6% 97.6% 97.3% 97.4% 97.7% 97.6% 97.6% 98.0%**

▲ TOP

Licensee Comments:

- 4Q/15: Two siren-tests determined to be unsuccessful upon review by Emergency Planning. This does not affect the indicator color.
- 3Q/15: Drill and Exercise Performance data has been revised for 2nd and 3rd Quarters. Emergency Planning reviewed participation records and determined two additional opportunities resulting in additional successes. This does not affect the indicator color.
- 2Q/15: Drill and Exercise Performance data has been revised. Emergency Planning reviewed participation records and determined two additional opportunities resulting in additional successes. This does not affect the indicator color.
- 2Q/15: Drill and Exercise Performance data has been revised for 2nd and 3rd Quarters. Emergency Planning reviewed participation records and determined two additional opportunities resulting in additional successes. This does not affect the indicator color.

ERO Drill Participation

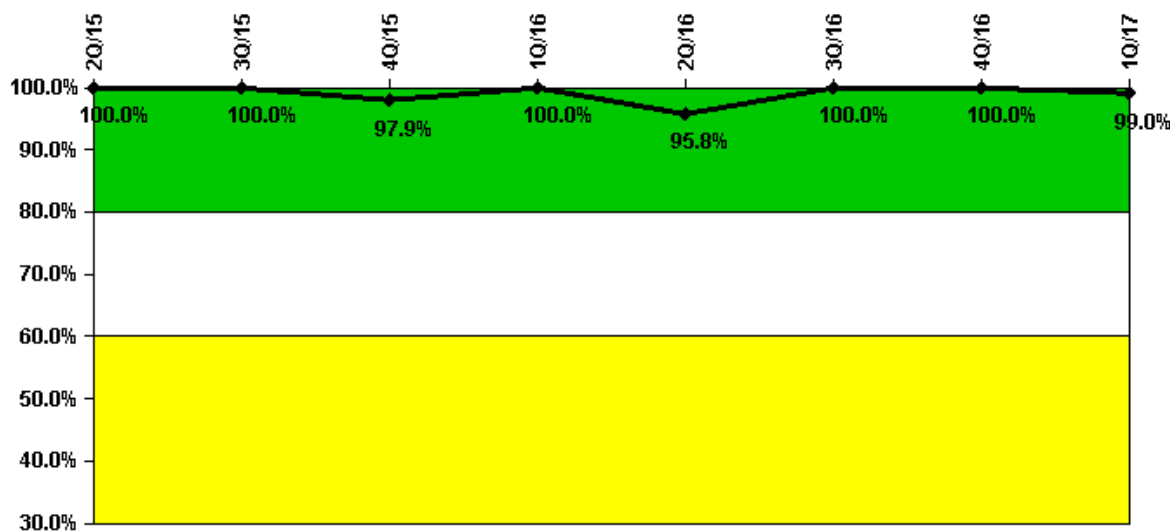

Thresholds: White < 80.0% Yellow < 60.0%

Notes


ERO Drill Participation	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
Participating Key personnel	97.0	96.0	93.0	89.0	92.0	96.0	105.0	103.0
Total Key personnel	97.0	96.0	95.0	89.0	96.0	96.0	105.0	104.0

Indicator value **100.0% 100.0% 97.9% 100.0% 95.8% 100.0% 100.0% 99.0%**

▲ TOP

Licensee Comments: none

Alert & Notification System

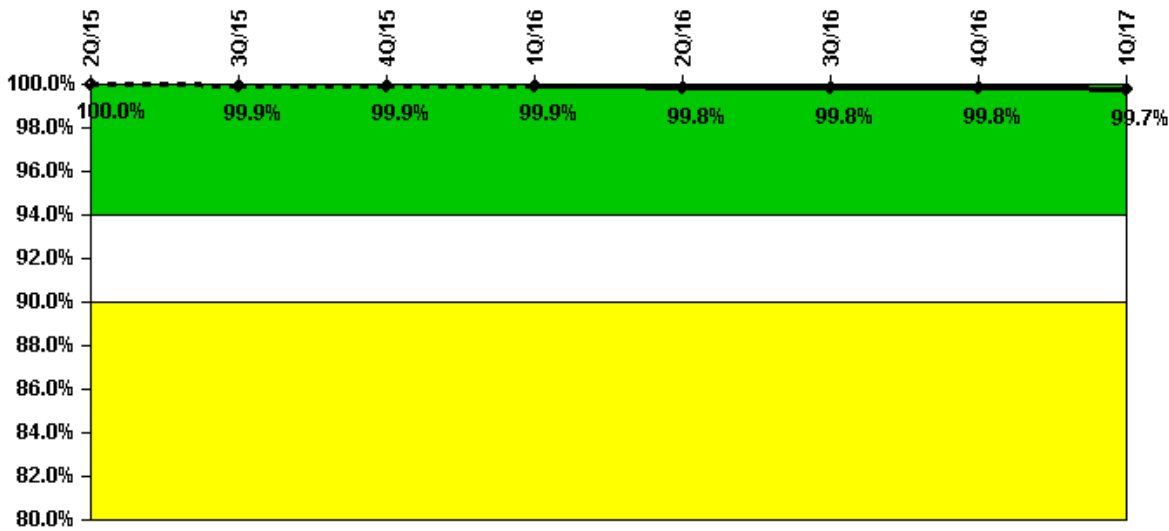

Thresholds: White < 94.0% Yellow < 90.0%

Notes


Alert & Notification System	2Q/15	3Q/15	4Q/15	1Q/16	2Q/16	3Q/16	4Q/16	1Q/17
Successful siren-tests	611	610	609	611	608	610	609	610
Total sirens-tests	611	611	611	611	611	611	611	611

Indicator value **100.0% 99.9% 99.9% 99.9% 99.8% 99.8% 99.8% 99.7%**

▲ TOP

Licensee Comments: none

Occupational Exposure Control Effectiveness

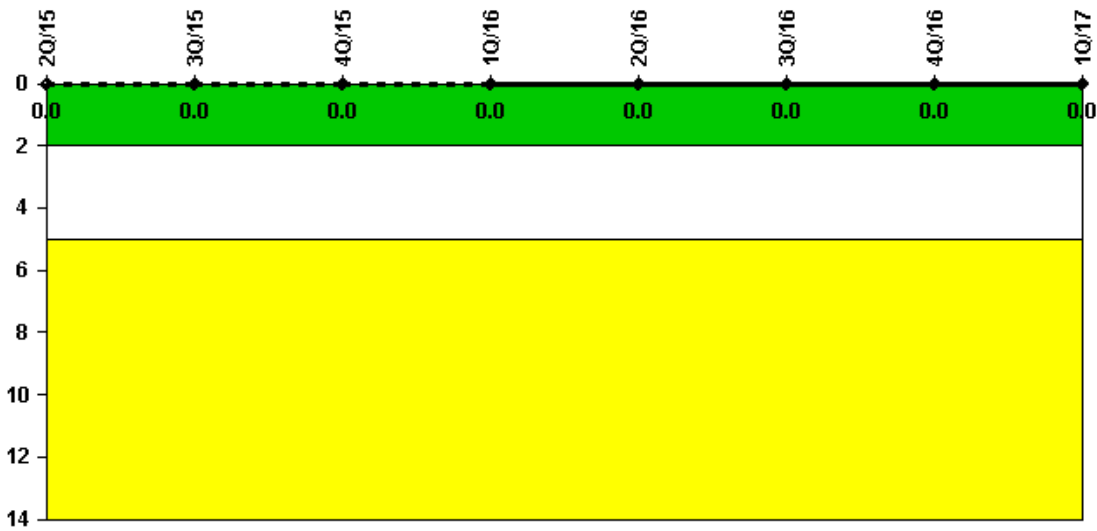

Thresholds: White > 2.0 Yellow > 5.0

Notes


Occupational Exposure Control Effectiveness 2Q/15 3Q/15 4Q/15 1Q/16 2Q/16 3Q/16 4Q/16 1Q/17

High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

TOP

Licensee Comments: none

RETS/ODCM Radiological Effluent

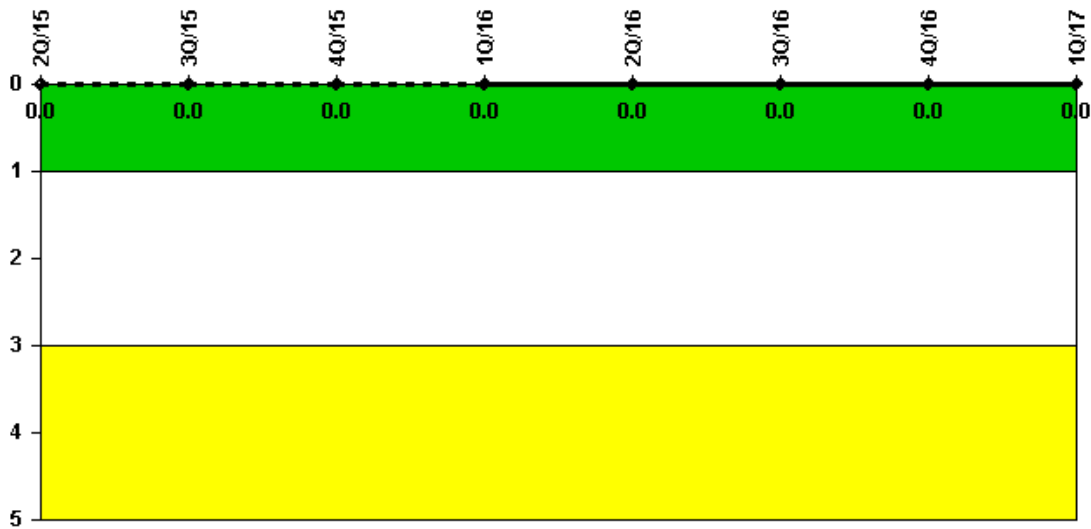

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent 2Q/15 3Q/15 4Q/15 1Q/16 2Q/16 3Q/16 4Q/16 1Q/17

RETS/ODCM occurrences 0 0 0 0 0 0 0 0

Indicator value 0 0 0 0 0 0 0 0

[TOP](#)

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

Current data as of: May 5, 2017

Page Last Reviewed/Updated Wednesday, June 07, 2017